LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/17/2024 Expiration Date: 06/16/2025 Permit#24-60093

Property Owner: Talking Timbers LLC

Mailing Address: [redacted]

Installer: Darwin Pluid License #: 164

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House and bathroom in barn.

Parcel Description:

Legal: THE RANCH AT EUREKA, S22, T37 N, R27 W, LOT 1, ACRES 22.92, PM 7272

Property Address: 110 Paradise Loop, Eureka, MT 59917 Assessment Code: 60093

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with bathroom in barn, with 3 Laterals @ 50', with reduction given for chambers.

# of Bedrooms: 3 +bathroom in barn Septic Tank Size: 1500/500 gallons Trench Width: 36"

# of Laterals: 3 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 6/28/24

__✓__ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

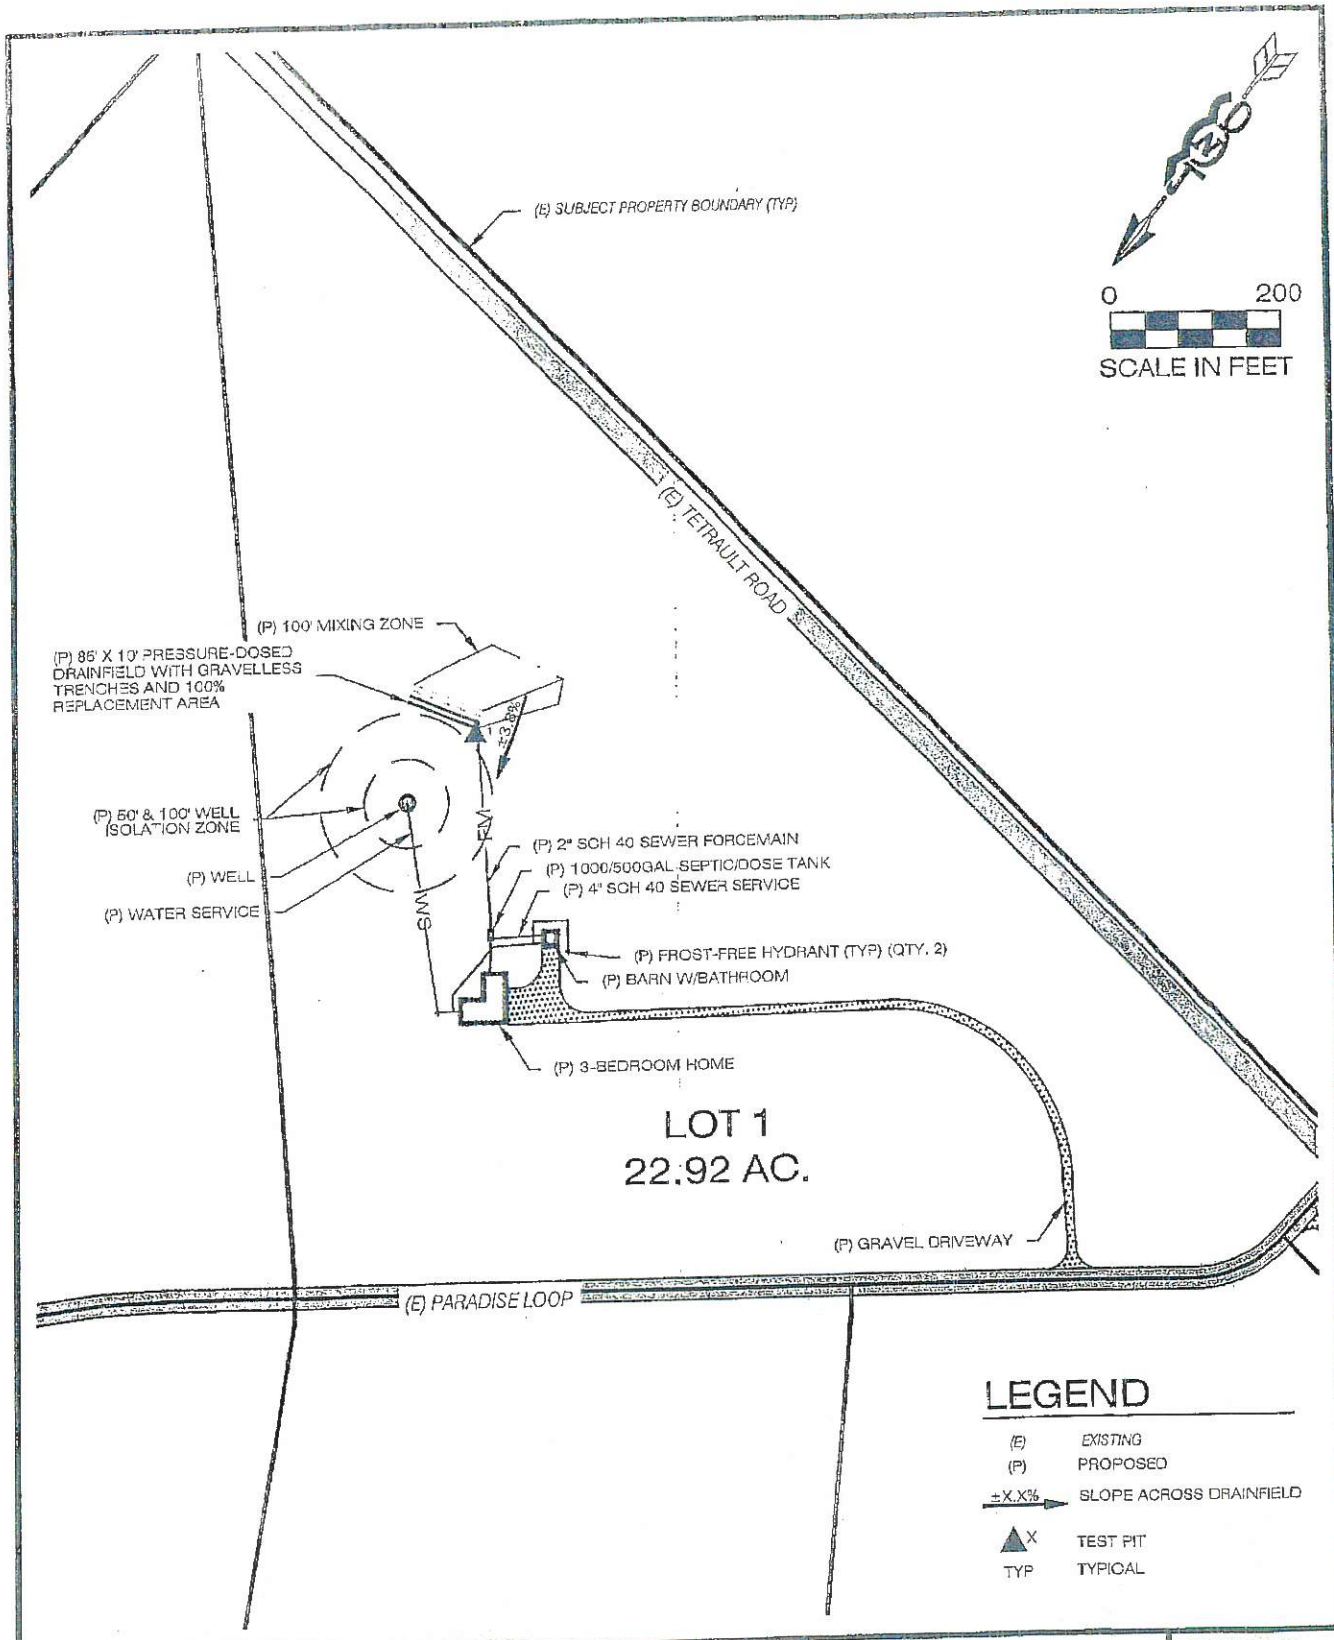

406 ENGINEERING
CIVIL ENGINEERING
LAND USE CONSULTING
1201 S. 6th St. W.
Missoula, MT 59801
(406) 317-1131
35 8th St. E.
Kalispell, MT 59901
(406) 257-0679
www.406engineering.com

SITE MAP
110 PARADISE LOOP SEPTIC PERMIT
LOT 1 OF THE RANCH AT EUREKA
SEC. 22, T37N, R27W, P.M.M.
LINCOLN COUNTY, MT

PRO#: 20-106
TAB: SEPTIC
DRAFTER: SG
DATE: MAY 2024
SHEET 1 OF 1

PLOT DATE: 5/24/2024 10:54 AM
DWG LOCATION: C:\USERS\SOPHIA GARRUBBO\406\406 ENGINEERING - DOCUMENTS\406 WORK\01_PROJECTS\2020 PROJECTS\20-106 TALKING TIMBERS\8_DRAFTING\8.1_DRAWINGS\D-SEPTIC-LOT 1.DWG