# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/05/2015 Expiration Date: 02/06/2016

Property Owner: Charles Tapia c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: License No. 99

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers – sizing reduction allowed per "Drainfield Size" below.

*Parcel Description*:

Legal: Lot 17 in Rouse Tracts

Address or Location: 412 Pioneer Road

*Approved Design Criteria*:

# Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 110 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Kendra J. Lind, R.S.

*Closure Statement:*

*I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Duane Smith *Date:* 7-6-15

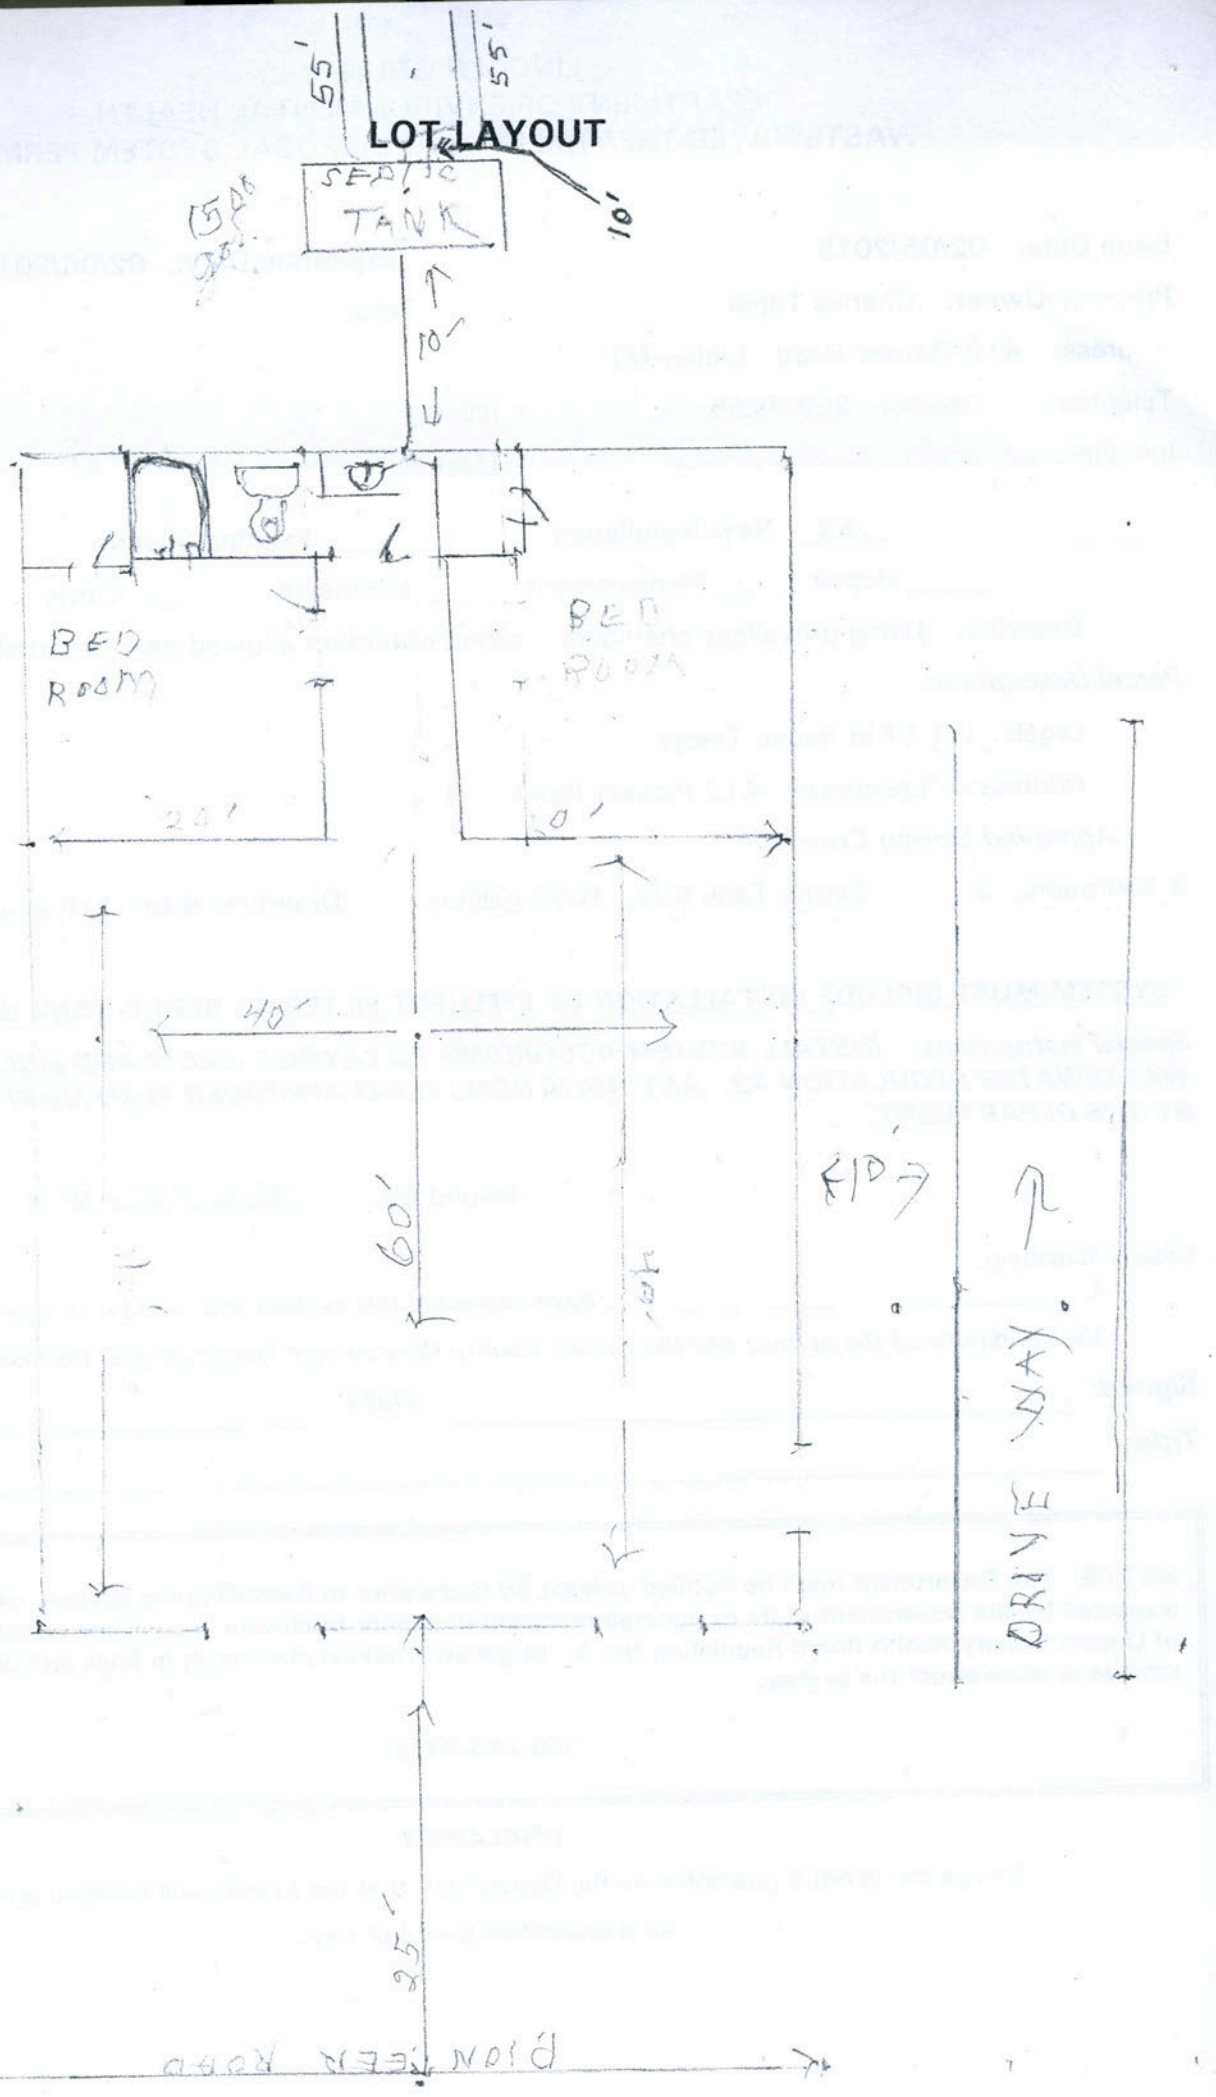
*Title:* EXCAV. E.T.C.

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT LAYOUT
55'
55'
SEPTIC TANK
10'
10'
BED ROOM
BED ROOM
24'
40'
60'
FID
DRIVE WAY
PIONEER ROAD