LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/19/2025 Expiration Date: 11/18/2026 Permit#25-7911

Property Owner: Westmont Properties LLC.

Mailing Address: [redacted]

Installer: Tony Berget License #: 23

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of dry well system for 2 Bedroom House to replace failing system.

Legal: RIVERSIDE DRIVE, S32, T31 N, R31 W, ACRES 0.17, LOT 3B1A *7911*

Property Address: 41 Talsma Rd., Libby, MT, 59923 Assessment Code: 7911

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of dry well system for 2 Bedroom House to replace failing system with 4 dry well rings. Existing well to be abandoned. Septic tank must be pumped and size and working condition verified.

# of Bedrooms: 2 Septic Tank Size: 1000 Trench Width: NA

# of Laterals: 4 Dry Wells Length of Laterals: NA Trench Depth: NA

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

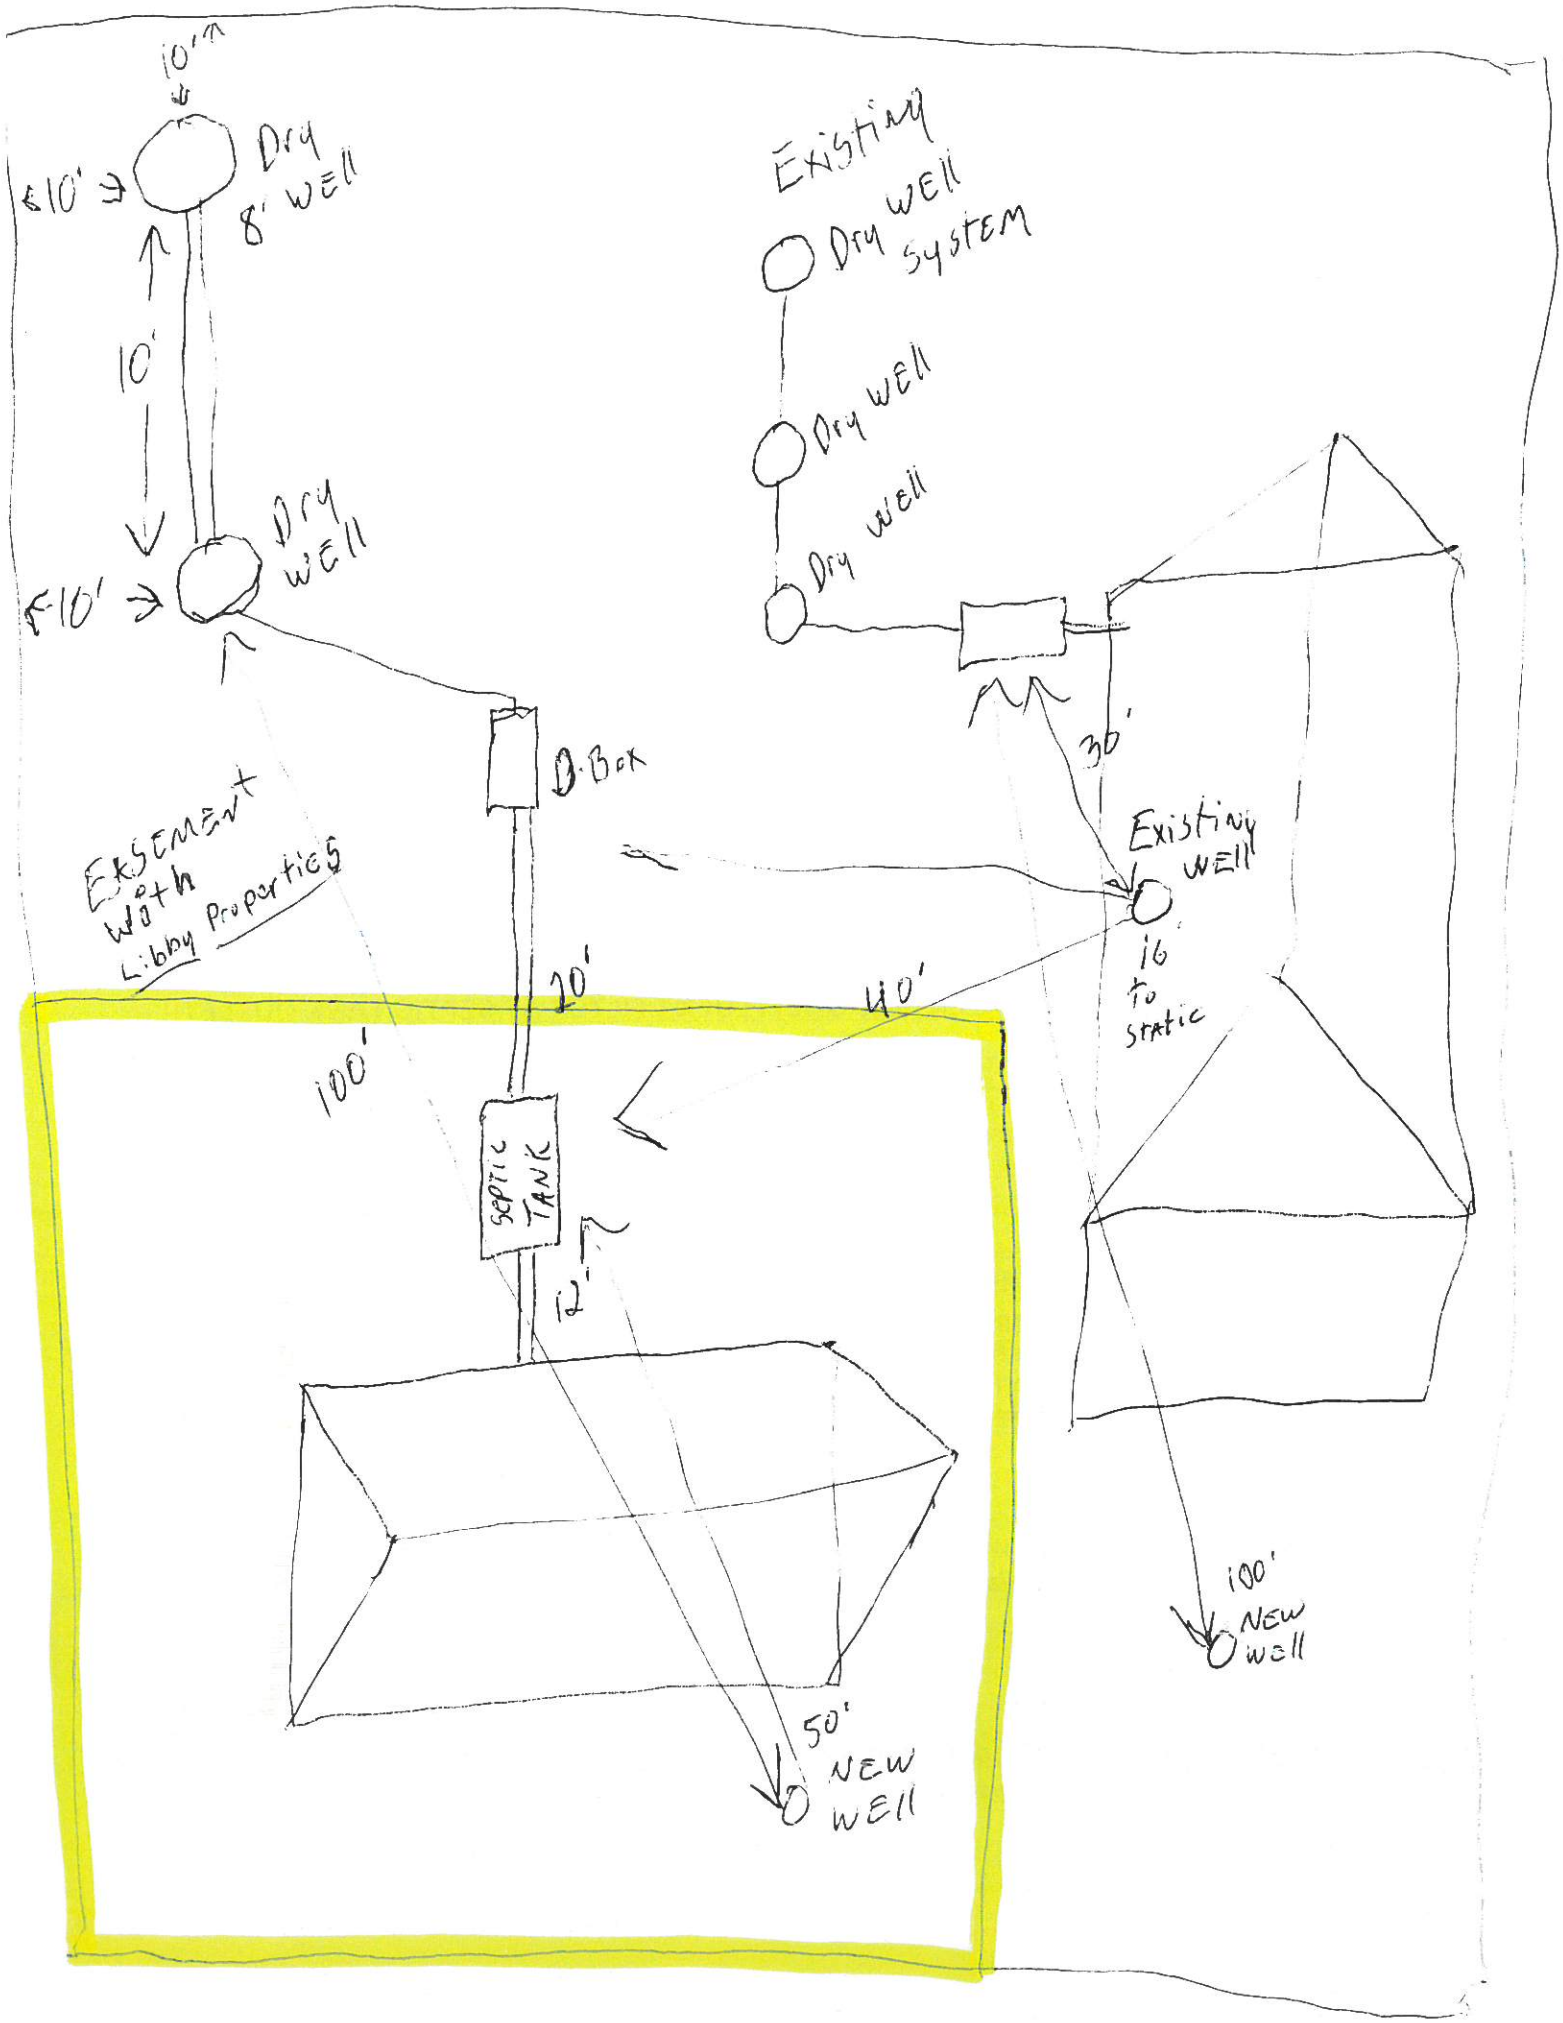
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


10'
10'
Dry well
8' well
10'
10'
Dry well
Existing
Dry well system
Dry well
Dry well
D. Box
Easement with Libby Properties
30'
Existing well
16' to static
20'
40'
100'
SEPTIC TANK
12'
100'
New well
50'
New well