LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/14/2014 Expiration Date: 05/15/2015

Property Owner: Yaak Community Church c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Charles Wilson License No. 86

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Public Wastewater Treatment System, per DEQ approved plan -- E.Q. No. 09-1065, for the Yaak Community Church.

.

Parcel Description:

Legal: S4 T35 R32 Lot 5 in Yaak River Estates --- public system for Church building

Address or Location: 32529 Yaak River Road

Approved Design Criteria for the Yaak Community Church Public Wastewater Treatment System:

Grease Trap Size: 1000 gallons Septic Tank Size: 1000 gallons Drainfield Size: 880 Square Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: ***INSTALL YAAK COMMUNITY CHURCH SYSSTEM ACCORDING TO EFI GLOBAL'S DEQ APPROVED ENGINEERED PLAN, CIRCULAR DEQ-4, AND LINCOLN COUNTY WASTEWATER REGULATION. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.*** **EFI GLOBAL MUST ALSO SIGN-OFF ON THE CLOSURE STATEMENT.**

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I have installed and/or inspected this system and confirm that it is in compliance with the DEQ approved engineered plan (E.Q. #09-1065), the conditions of this permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:*

Licensed Installer

Signed: _____ *Date:*


, PE #

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

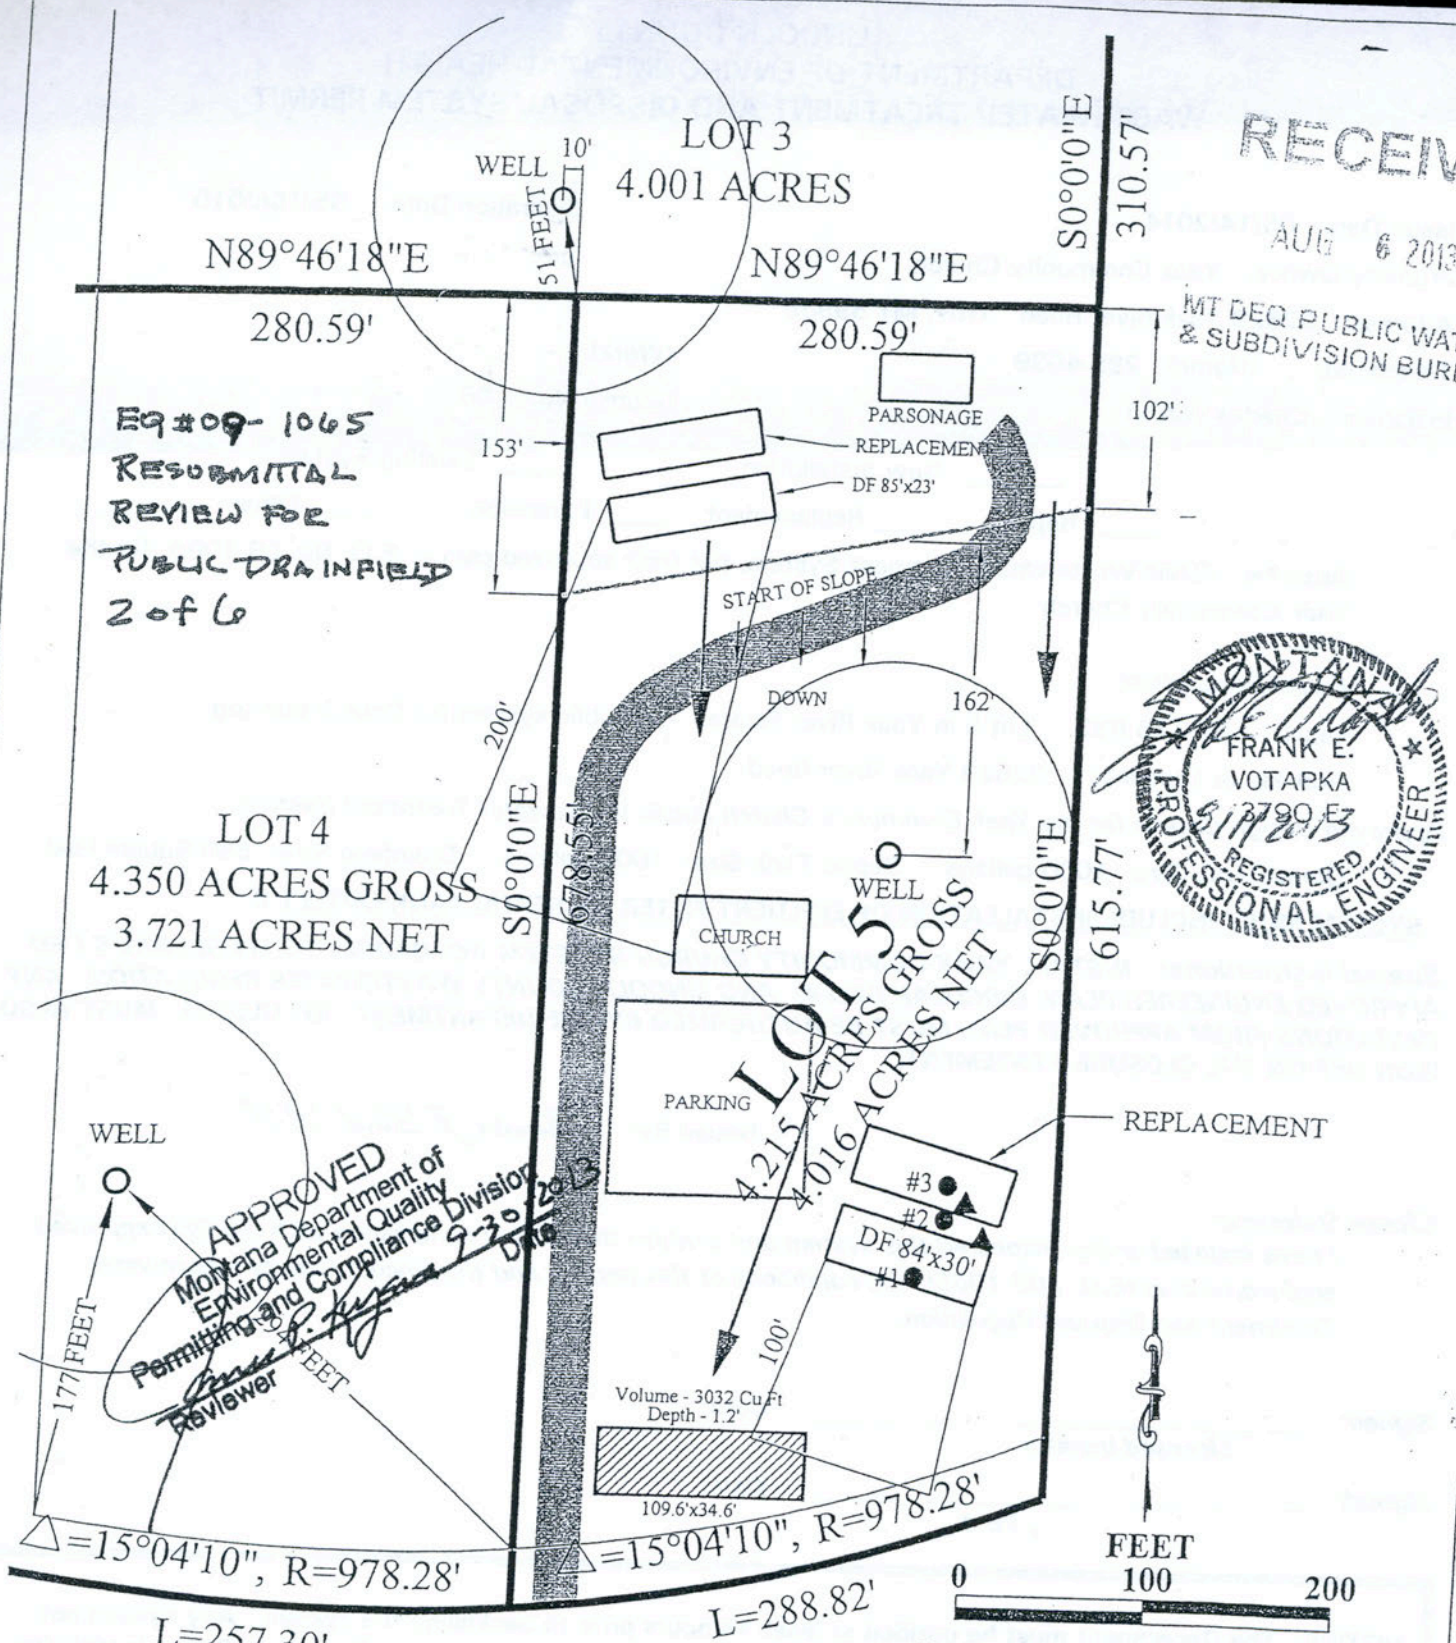

RECEIVED
AUG 6 2013
MT DEQ PUBLIC WATER & SUBDIVISION BUREAU

MONTANA
FRANK E. VOTAPKA
8790 E
8/1/2013
REGISTERED PROFESSIONAL ENGINEER

APPENDIX C

LEGEND	
▲ SOIL PIT	DETENTION BASIN
● PERC. TEST	
○ WELL	DIRECTION OF STORMWATER
DF DRAINFIELD	

TLC ENGINEERING, PE, LLC

Revised By:	Date:

YAAK COMMUNITY CHURCH

STORMWATER PLAN

YAAK, MT
SECTION 4, T.35N., R.32W.

Scale:	Date:	Compiled By:	Drafted By:
1"=100 FEET	11/20/08	Frank Votapka	Tallmadge GIS