LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/02/2013 Expiration Date: 12/03/2014

Property Owner: Paul & Vicky Buti c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Terry Oedewaldt License No. 2

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Replacing failing dry-well system. Using ARC gravelless chambers for installation.

Parcel Description:

Legal: S26 T31 R31 Tract 5I – CS #635 – Collinson O. S.

Address or Location: 665 Florence Road

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

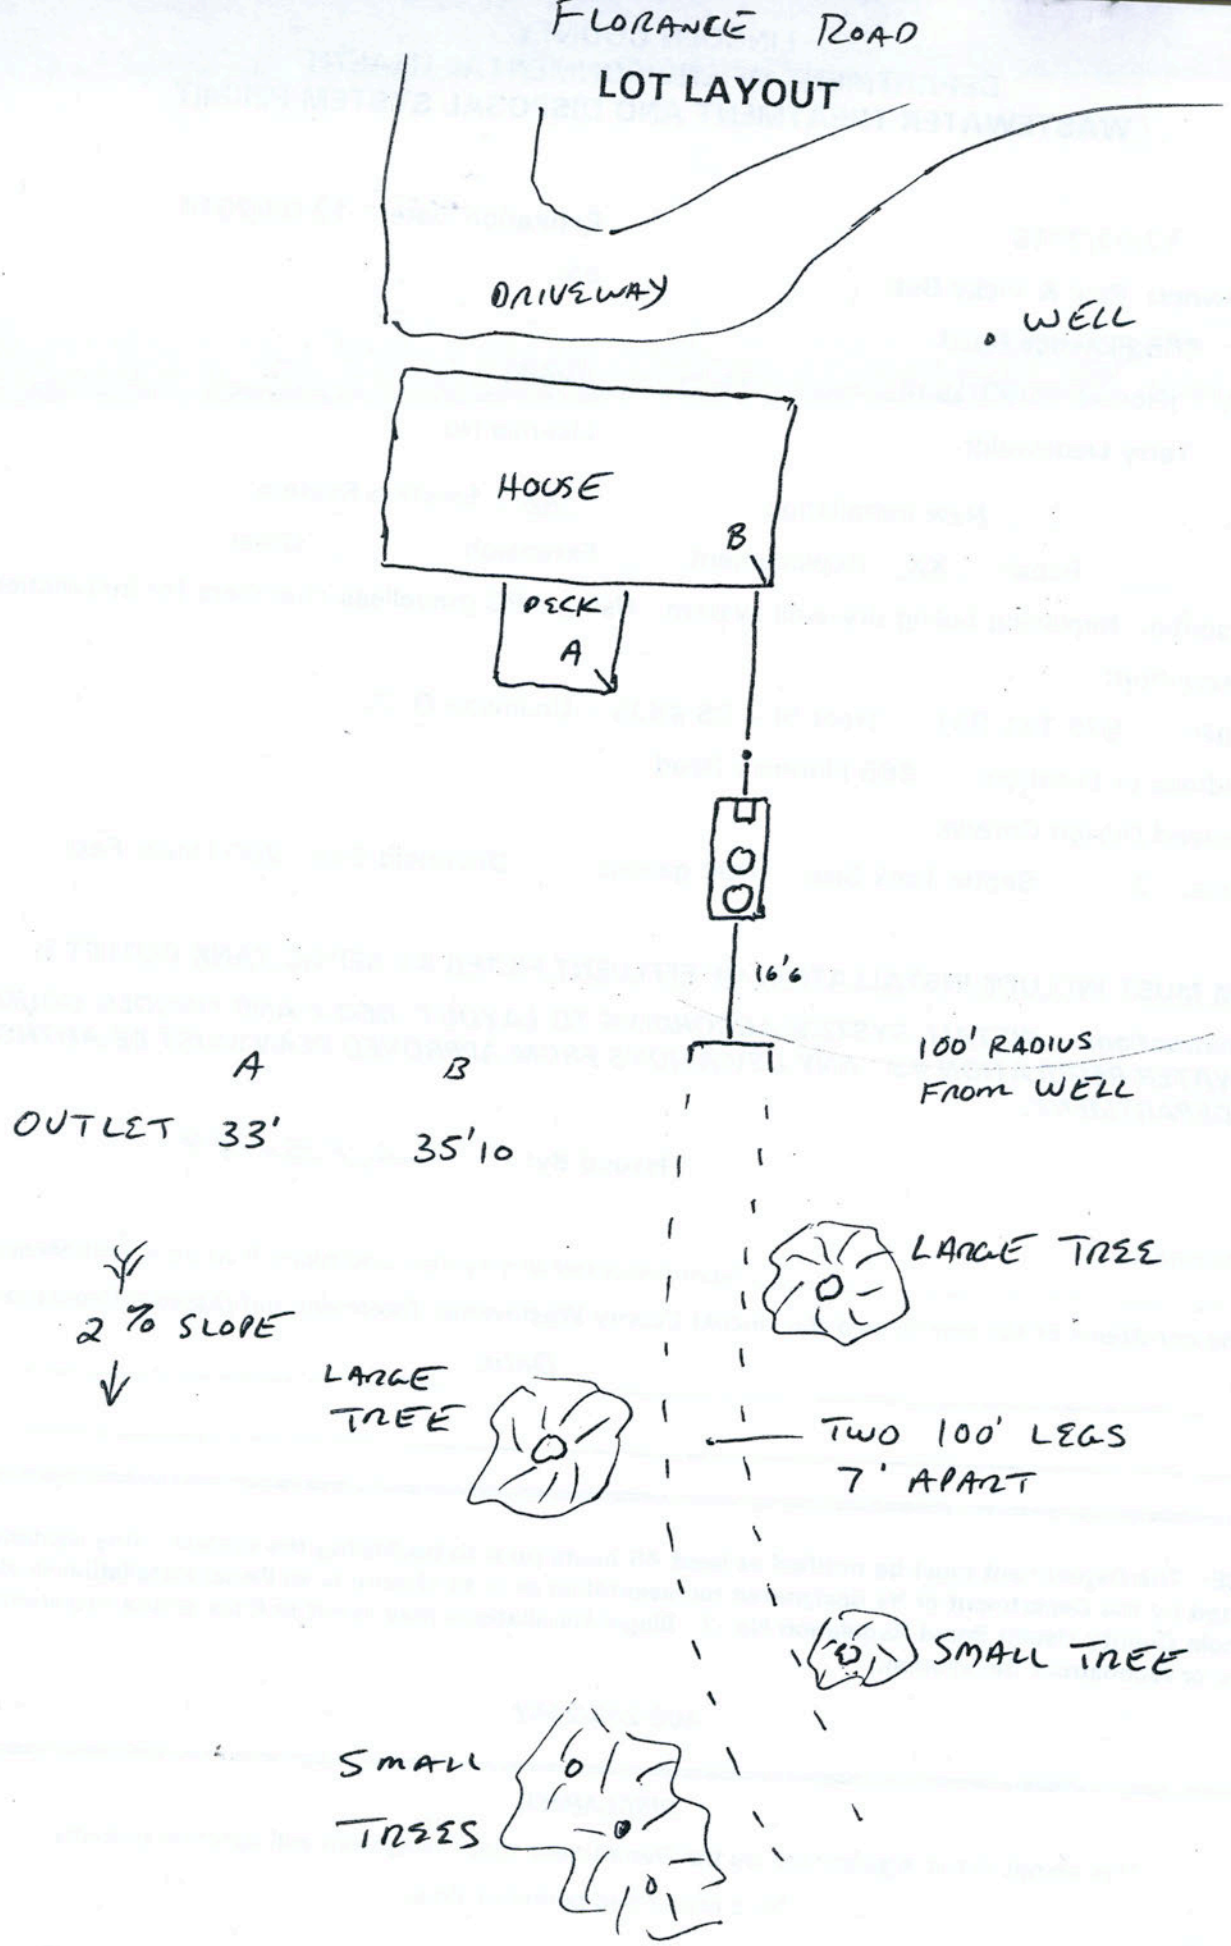
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


FLORANCE ROAD
LOT LAYOUT
DRIVEWAY
WELL
HOUSE
B
DECK
A
16'6
100' RADIUS
FROM WELL
A
B
OUTLET 33'
35'10
2 % SLOPE
LARGE TREE
LARGE
TREE
TWO 100' LEGS
7' APART
SMALL TREE
SMALL
TREES