LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/02/2014 Expiration Date: 05/03/2015

Property Owner: Justin & Melanie Courteau c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Thompson Contracting License No. 73

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing pressure-dosed system – three 98-foot lines in 3-foot wide trenches.

Parcel Description:

Legal: Lot 28 of Edgewater Estates Phase 2

Address or Location: 460 Edgewater Drive

Approved Design Criteria:

Bedrooms: 4 Septic Tank Size: 1500 gallons Drainfield Size: 882 Square Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

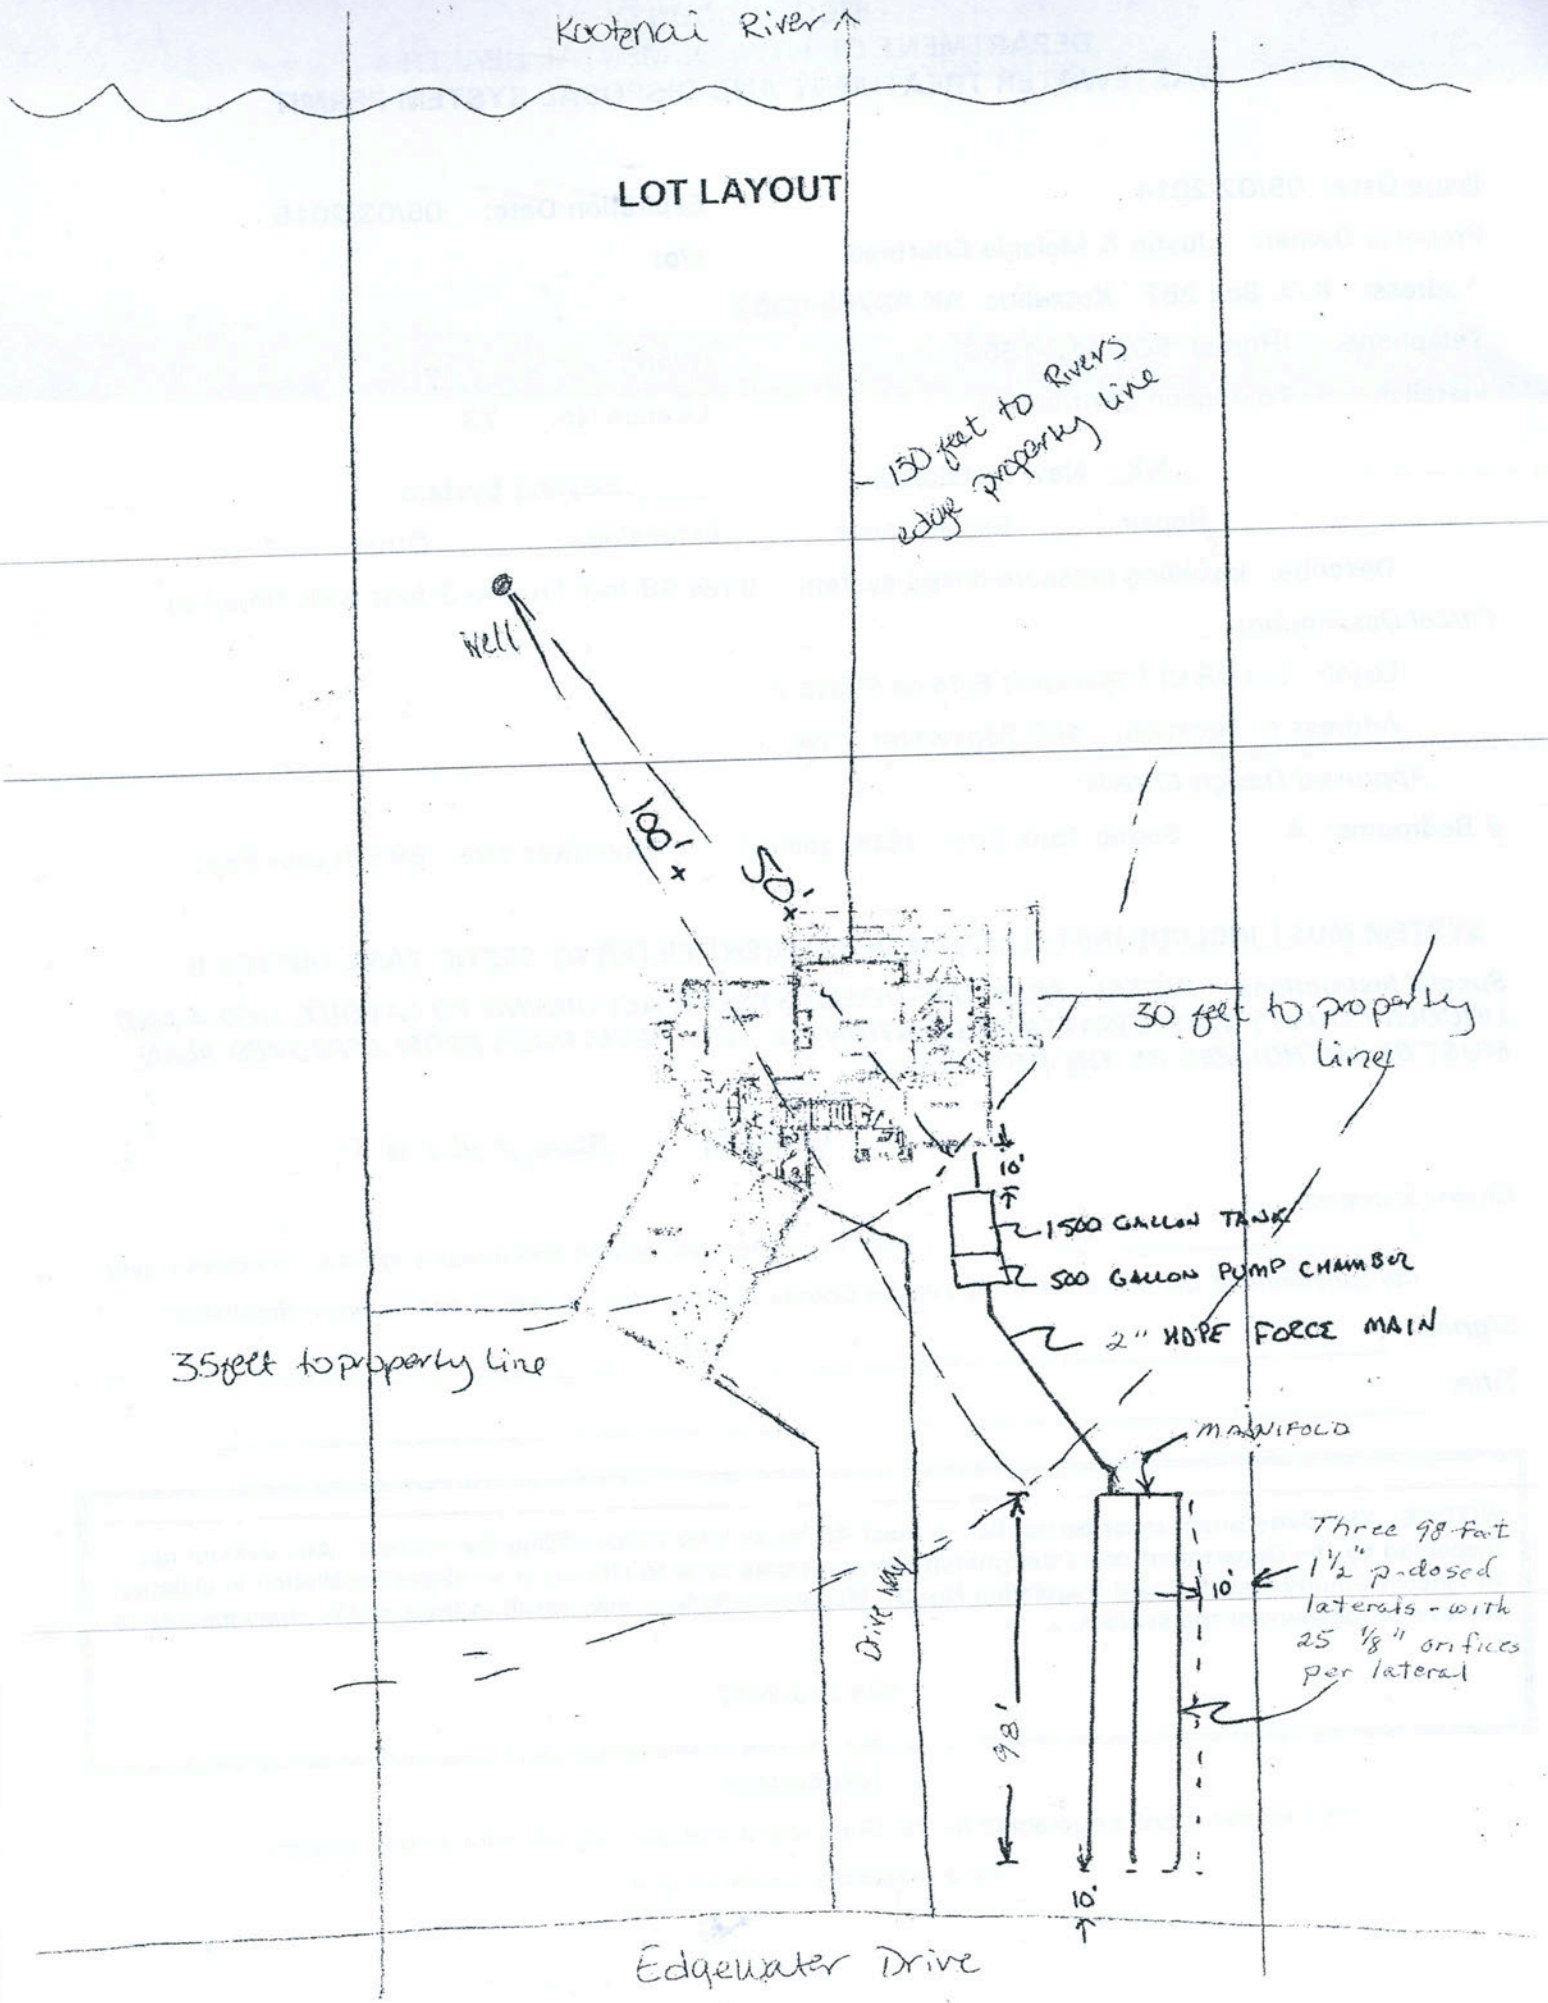
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Kootenai River
LOT LAYOUT
150 feet to Rivers edge property line
well
180'
50'
30 feet to property line
10'
1500 GALLON TANK
500 GALLON PUMP CHAMBER
2" HDPE FORCE MAIN
35feet to property line
MANIFOLD
Three 98 foot 1½" pressured laterals - with 25 ⅛" orifices per lateral
10'
Drive Way
98'
10'
Edgewater Drive