LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/30/2025 Expiration Date: 10/29/2026 Permit#25-54792

Property Owner: William Davis

Mailing Address: [redacted]

Installer: Donavan Truman License #: 109

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 5 Bedroom House.

Legal: S24, T37 N, R27 W, COS 654, ACRES 20.01, TRACT 5 IN SENW

Property Address: 5076 US HWY 93., Eureka, MT 59917 Assessment Code: 54792

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new gravity system for 5 Bedroom House with 5 Laterals @ 80'.

# of Bedrooms: 5 Septic Tank Size: 1500 Trench Width: 24"

# of Laterals: 5 Length of Laterals: 80' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: John Blanton *Date:* 12/2/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

WILLIAM J DAVIS – 5076 US HWY 93 N

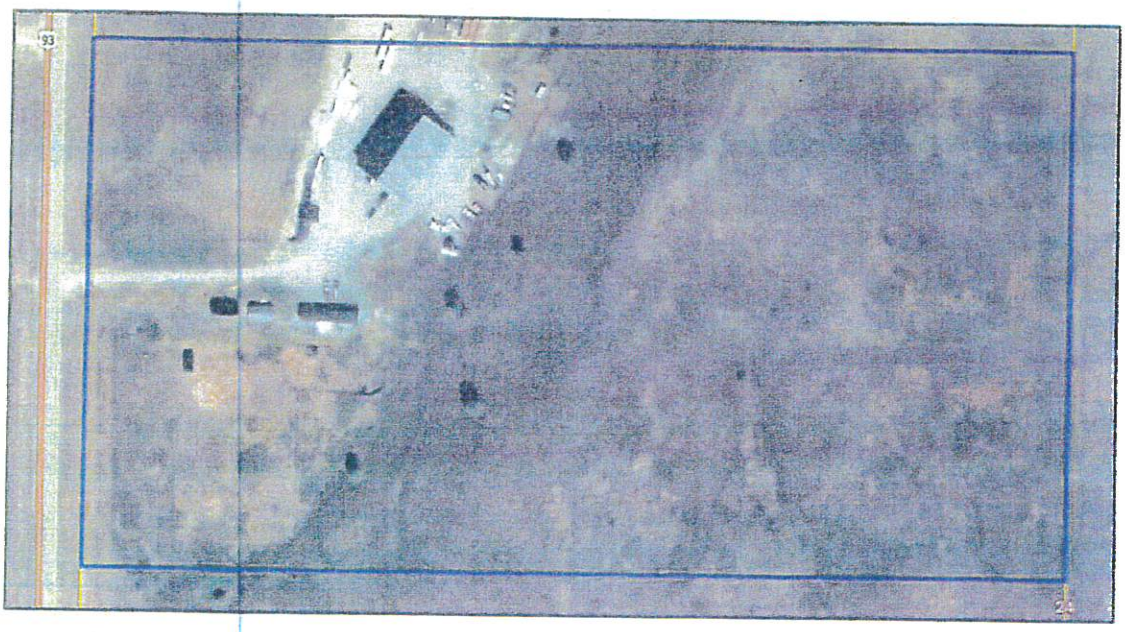

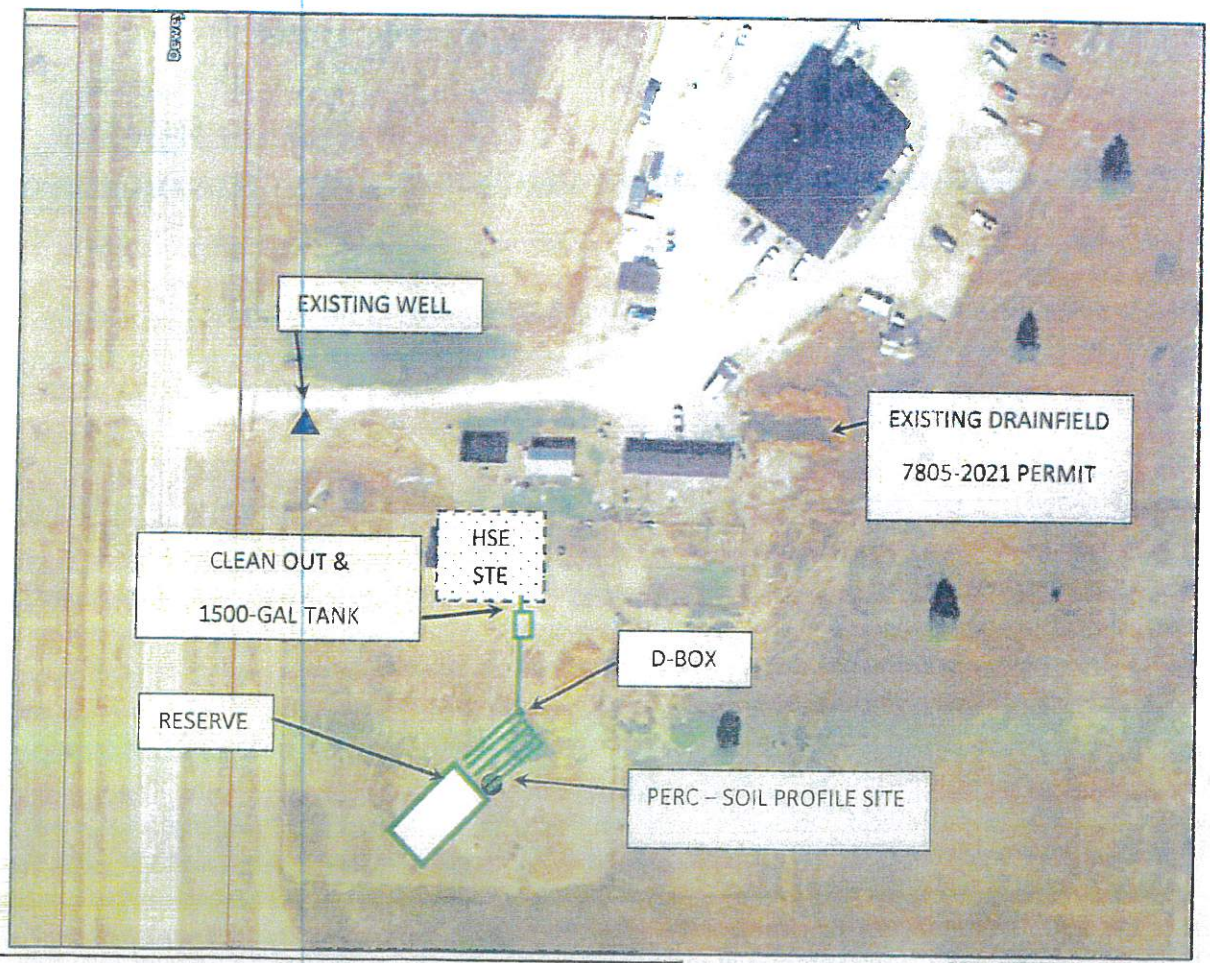

- **GRAVITY SYSTEM – 1500 GAL TANK**
- D-BOX - (5) 83.5' LATERALS, 4" SCH 3034 PERF PIPE
- EXISTING DRAINFIELD SERVES SHOP & TRLR
- DISTANCE FROM WELL TO DRAINFIELD ~ 275 FT

N

S24, T37 N, R27 W, C.O.S. 654, ACRES 20.01, TRACT 5 IN SENW