LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/20/2010 Expiration Date: 09/19/2011

Property Owner: Bob Payne c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☐ Repair ☒ Replacement ☐ Extension ☐ Other _____

Describe: Infiltrator system

Parcel Description:

Legal: S24 T27N R28W

Address or Location: Crystal Lake

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 130 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

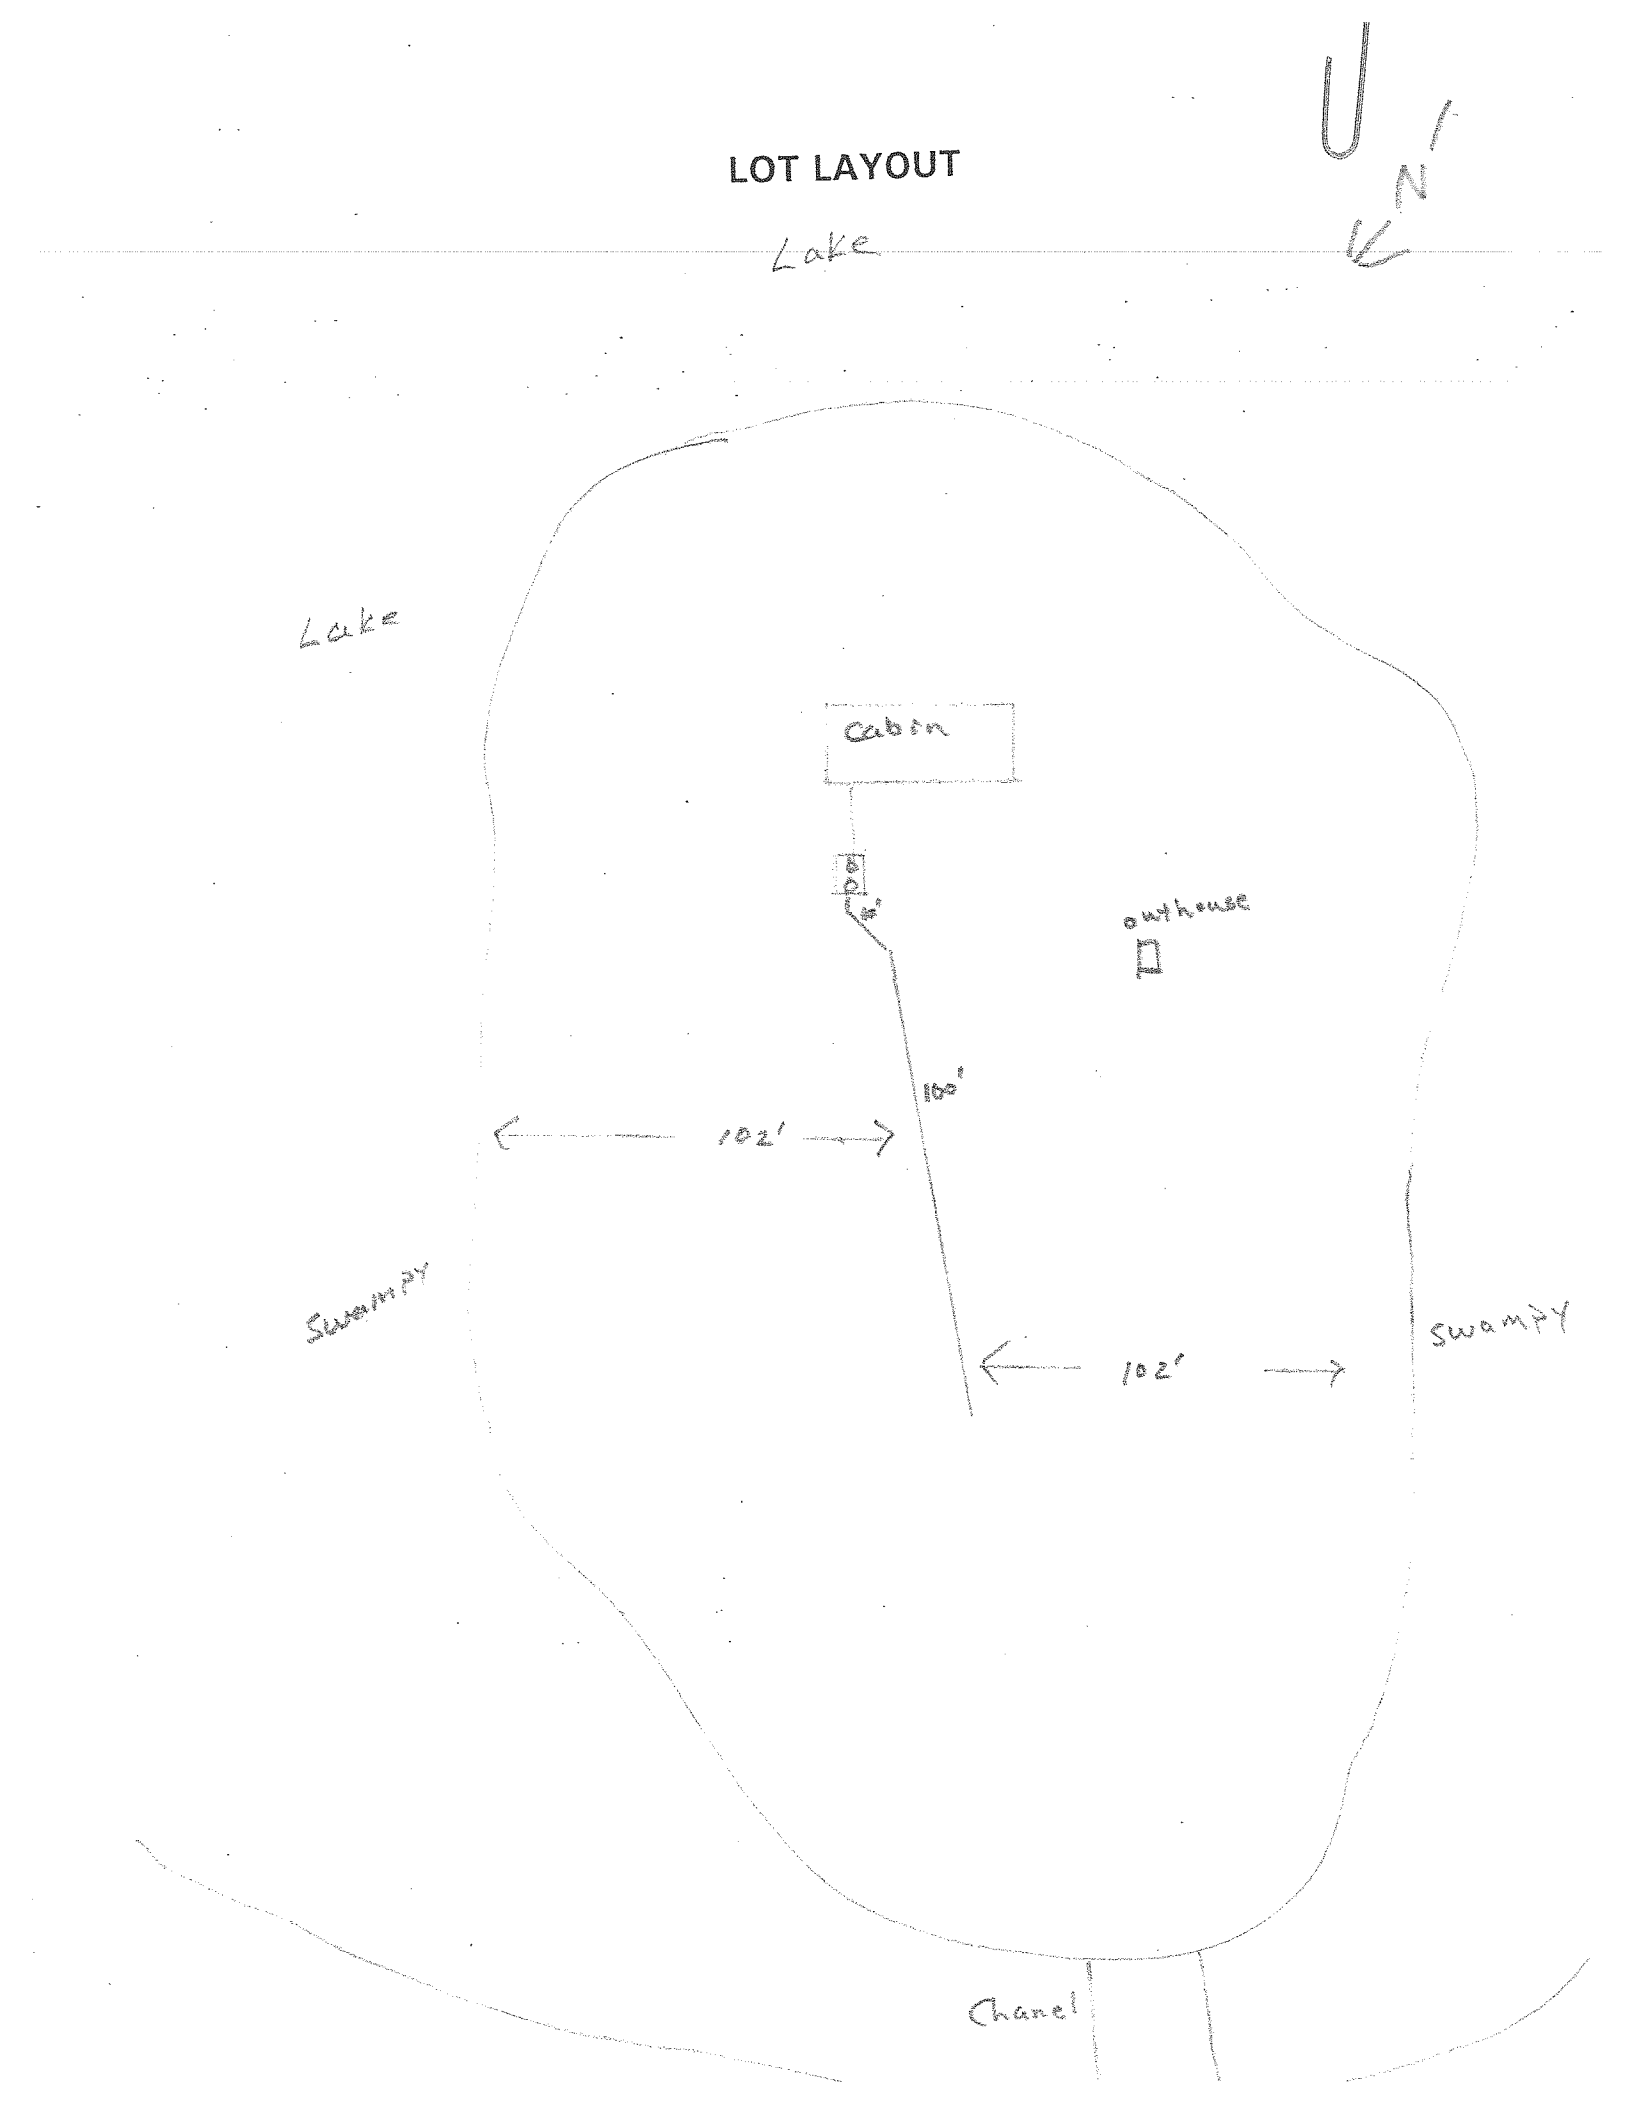
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781 x228

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


N
Lake
Lake
cabin
outhouse
100'
102'
102'
Swampy
Swampy
Channel