LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Appraisers

Issue Date: 11/01/2013 Expiration Date: 11/02/2014

Property Owner: Mel Siefke/Wildlife Recapture c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: D.J. McPhee Construction License No. 142

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing system for warehouse on Westgate properties.

Parcel Description:

Legal: S32 T31 R31

Address or Location: Lots 13 & 25 of Westgate Business Addition

Approved Design Criteria:

Max. Flows: 140 GPD Septic Tank Size: 1000 gallons Drainfield Size: 90 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

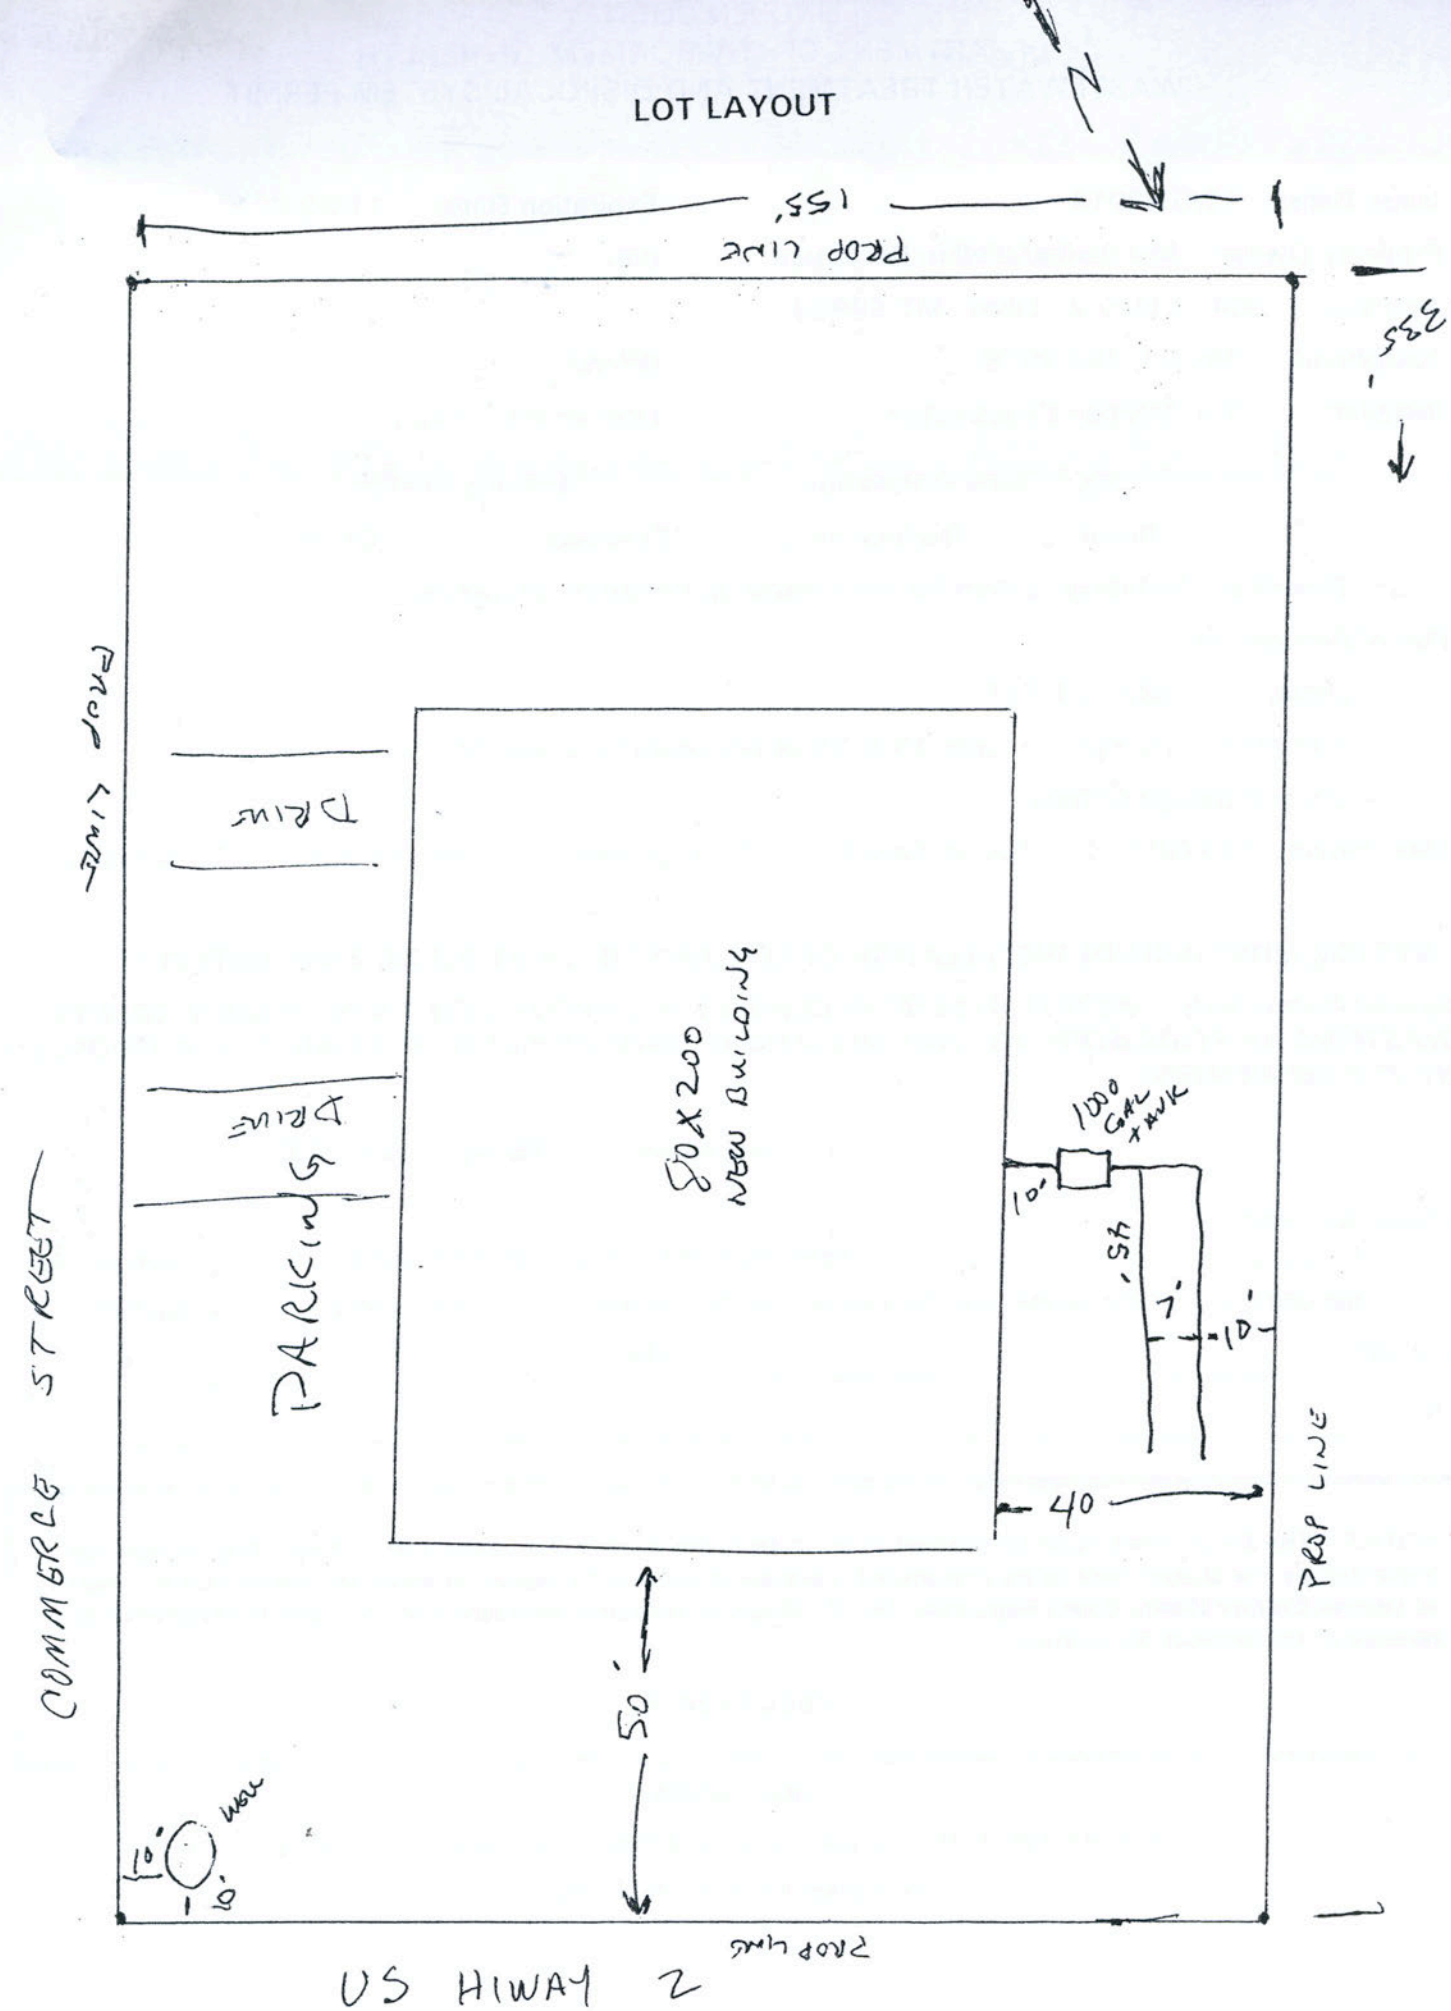
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


PROP LINE
155'
335'
PROP LINE
COMMERCE STREET
DRIVE
PARKING
DRIVE
50 X 200
NEW BUILDING
1000 GAL TANK
10'
SH
7'
10'
40
PROP LINE
50'
10'
10'
NEW
PROP LINE
US HIWAY 2