LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/03/2013 Expiration Date: 09/04/2014

Property Owner: James Smith c/o: Jerry Lipp

Address: [redacted] [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Koocanusa Plumbing & Electric License No. 8

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing wastewater system for lunch room and lavatory addition to hangar #3. Pressure-dosed system to be installed – two 85-foot pressure-dosed laterals in 3-foot wide trenches.

Parcel Description:

Legal: S18 T35 R25 Tract 5A1

Address or Location: Crystal Lakes – Hangar #3

Approved Design Criteria:

Max. Flows: 200 GPD Septic Tank Size: 1000 gallons Drainfield Size: 170 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

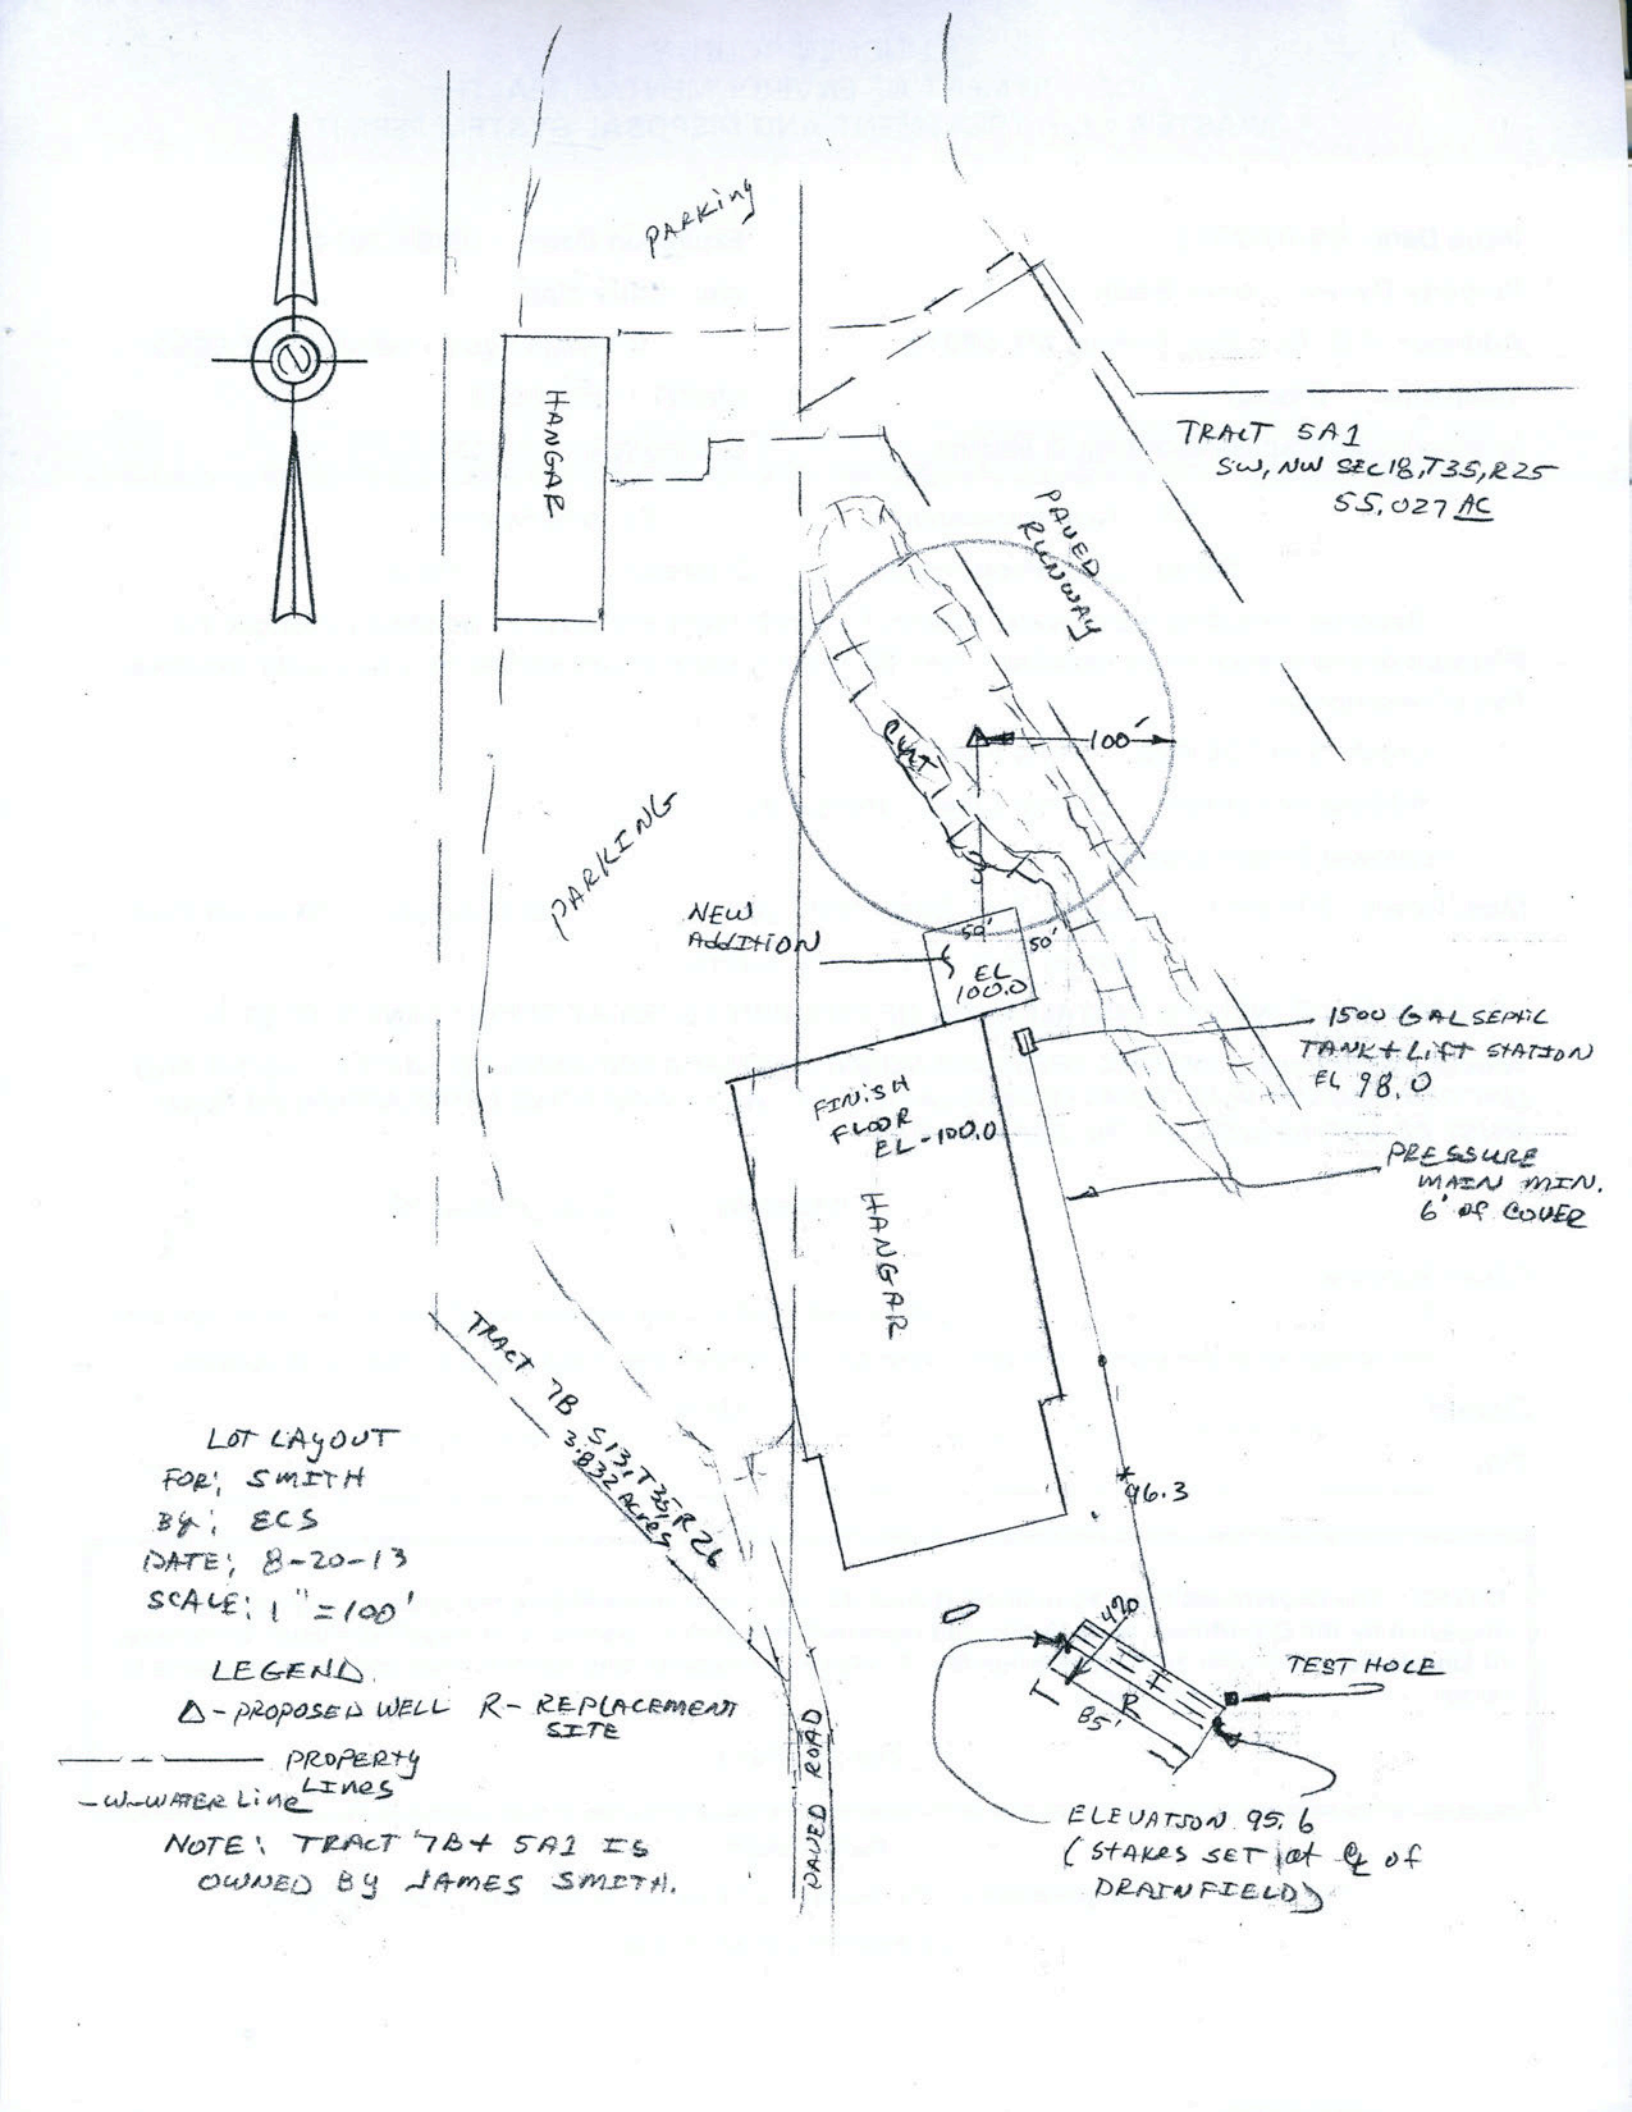
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


PARKING
HANGAR
TRACT 5A1
SW, NW SEC 18, T35, R25
55.027 AC
PAVED RUNWAY
100'
PUT
PARKING
NEW ADDITION
50'
50'
EL 100.0
1500 GAL SEPTIC TANK + LIFT STATION
EL 98.0
FINISH FLOOR EL-100.0
HANGAR
PRESSURE MAIN MIN. 6' OF COVER
TRACT 7B S13 T35 R26
3.832 ACRES
96.3
420
TEST HOLE
R
85'
PAVED ROAD
ELEVATION 95.6
(STAKES SET at ℄ of DRAINFIELD)
LOT LAYOUT
FOR: SMITH
BY: ECS
DATE: 8-20-13
SCALE: 1" = 100'
LEGEND
Δ - PROPOSED WELL R - REPLACEMENT SITE
PROPERTY LINES
W WATER LINE
NOTE: TRACT 7B + 5A1 IS OWNED BY JAMES SMITH.