LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/08/2013 Expiration Date: 08/09/2014

Property Owner: John & Tara Van c/o: Shayne Nelson

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Shayne Nelson License No. 118

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Shallow-capped construction per DEQ approval – trench depth not to exceed 18 inches. Sizing reduction allowed for gravelless chambers per "Drainfield Size" below.

Parcel Description:

Legal: SE1/4 NE1/4 S14 and SW1/4 NW1/4 S13 T27 R28

Address or Location: Lot 37 of Parkside at Fisher River

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SHALLOW-CAPPED SYSTEM ACCORDING TO LAYOUT, DEQ APPROVAL, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

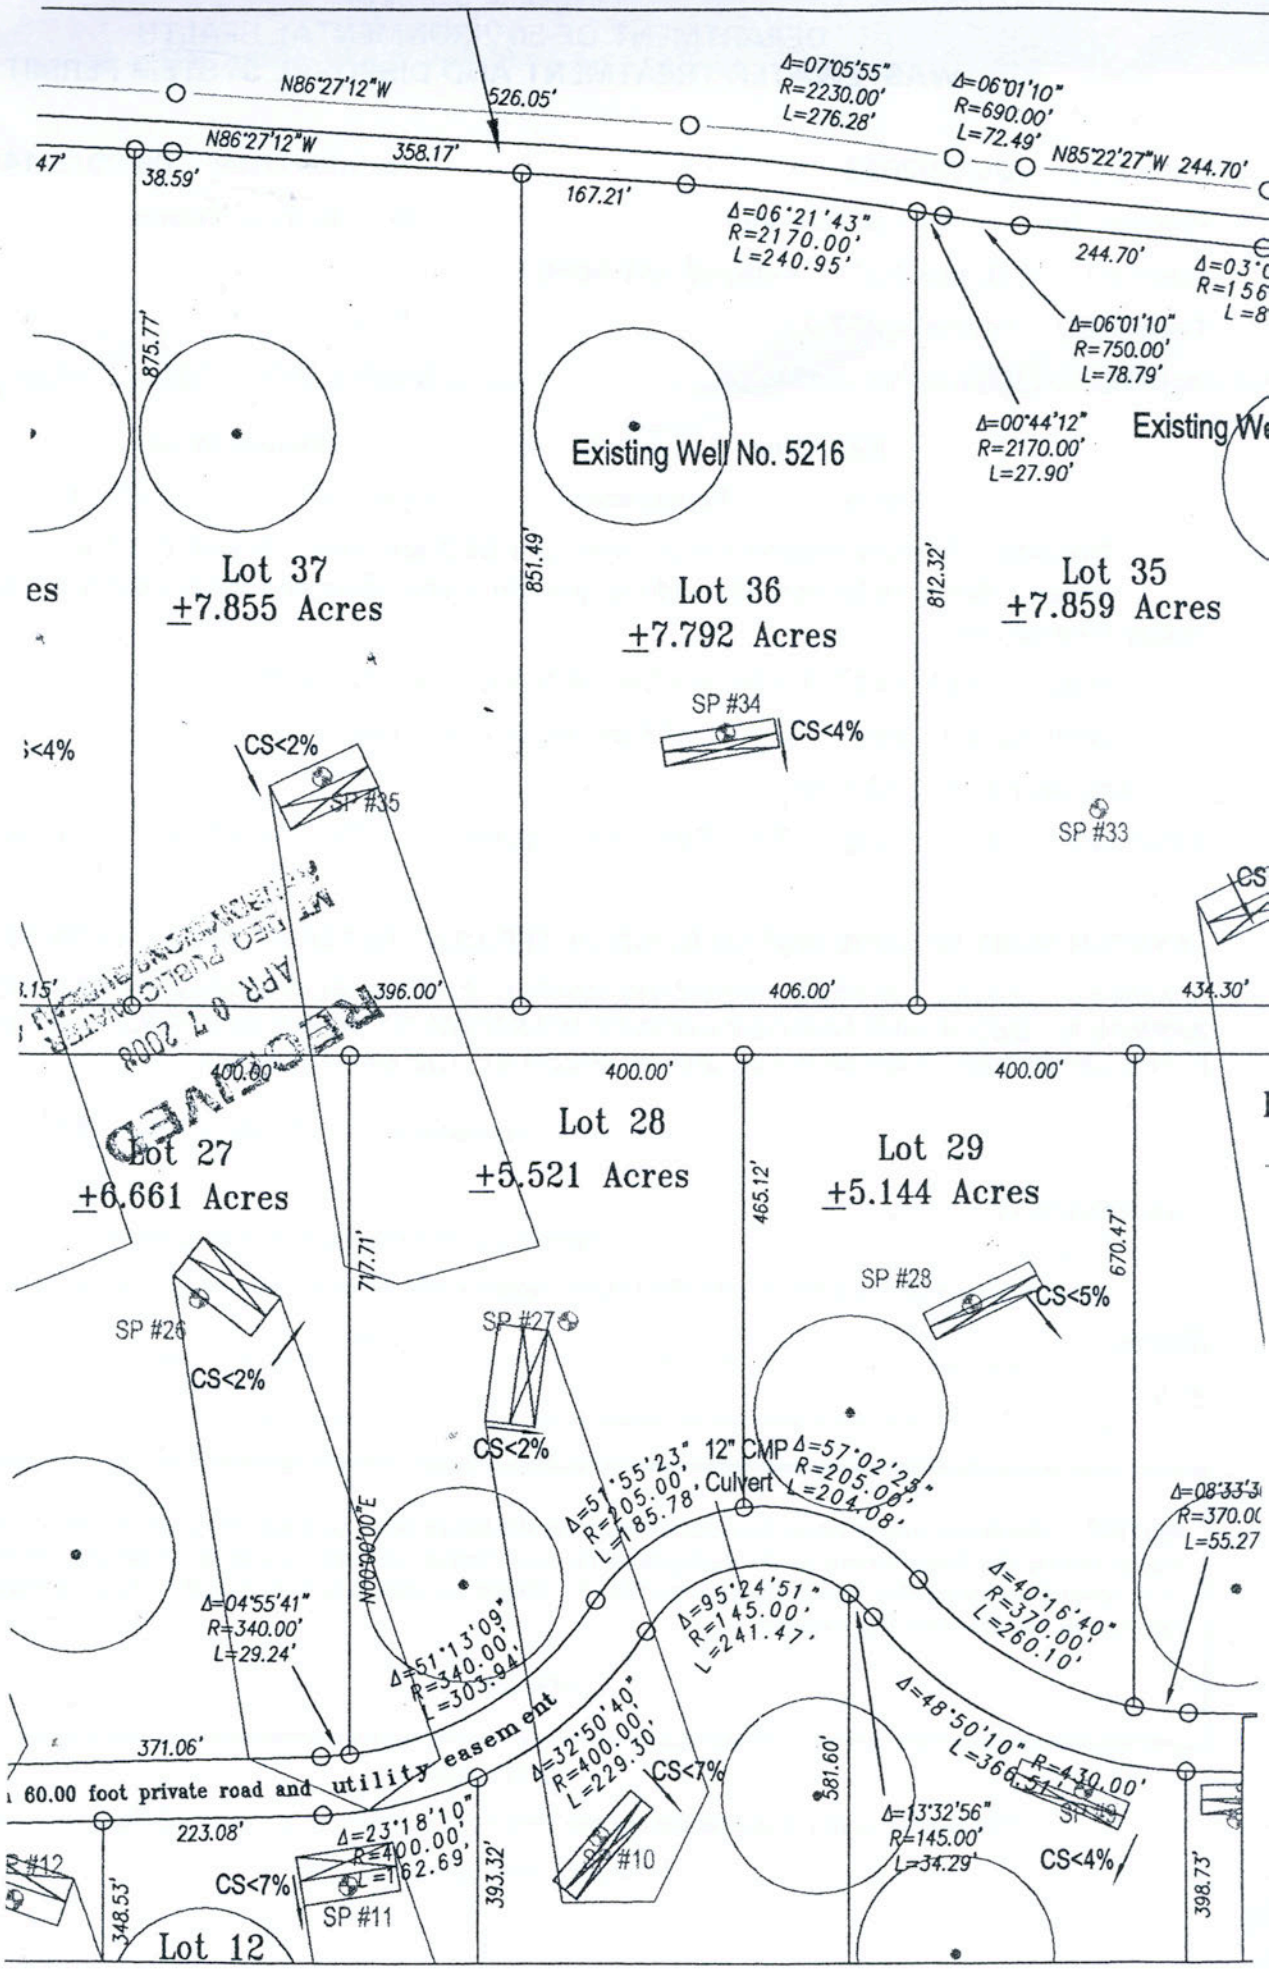
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N86°27'12"W 526.05'
Δ=07°05'55" R=2230.00' L=276.28'
Δ=06°01'10" R=690.00' L=72.49'
N85°22'27"W 244.70'
N86°27'12"W 358.17'
38.59'
167.21'
Δ=06°21'43" R=2170.00' L=240.95'
244.70'
Δ=06°01'10" R=750.00' L=78.79'
Δ=00°44'12" R=2170.00' L=27.90'
875.77'
Existing Well No. 5216
Existing We
Lot 37 ±7.855 Acres
Lot 36 ±7.792 Acres
Lot 35 ±7.859 Acres
851.49'
812.32'
SP #34
CS<4%
CS<2%
SP #35
SP #33
396.00'
406.00'
434.30'
400.00'
400.00'
400.00'
Lot 27 ±6.661 Acres
Lot 28 ±5.521 Acres
Lot 29 ±5.144 Acres
465.12'
717.71'
670.47'
SP #28
CS<5%
SP #26
CS<2%
SP #27
CS<2%
Δ=51°55'23" R=205.00' L=185.78'
12" CMP Culvert
Δ=57°02'28" R=205.00' L=204.08'
N00°39'00"E
Δ=04°55'41" R=340.00' L=29.24'
Δ=51°13'09" R=340.00' L=303.94'
Δ=95°24'51" R=145.00' L=241.47'
Δ=40°16'40" R=370.00' L=260.10'
Δ=08°33'3 R=370.0 L=55.27
Δ=48°50'10" R=430.00' L=366.51'
371.06'
60.00 foot private road and utility easement
Δ=32°50'40" R=400.00' L=229.30'
CS<7%
581.60'
Δ=13°32'56" R=145.00' L=34.29'
CS<4%
223.08'
Δ=23°18'10" R=400.00' L=162.69'
CS<7%
SP #11
SP #10
393.32'
348.53'
Lot 12
398.73'
APR 07 2008
RECEIVED