LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/08/2013

Expiration Date: 05/09/2014

Property Owner: Chrysalis

c/o: Koocanusa Plumbing & Electric

Address: [redacted]

Telephone: (Home)

(Work) [redacted]

Installer: Koocanusa Plumbing & Electric

License No. 8

____ New Installation

__XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Replacing old, failed system with appropriately sized new pressure-dosed system

Parcel Description:

Legal: NW-1/4 S28 T27 R27

Address or Location: 77 Trails End Road

Approved Design Criteria:

Bedrooms: 8

Septic Tank Size: 3000 gallons

Drainfield Size: 720 Square Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

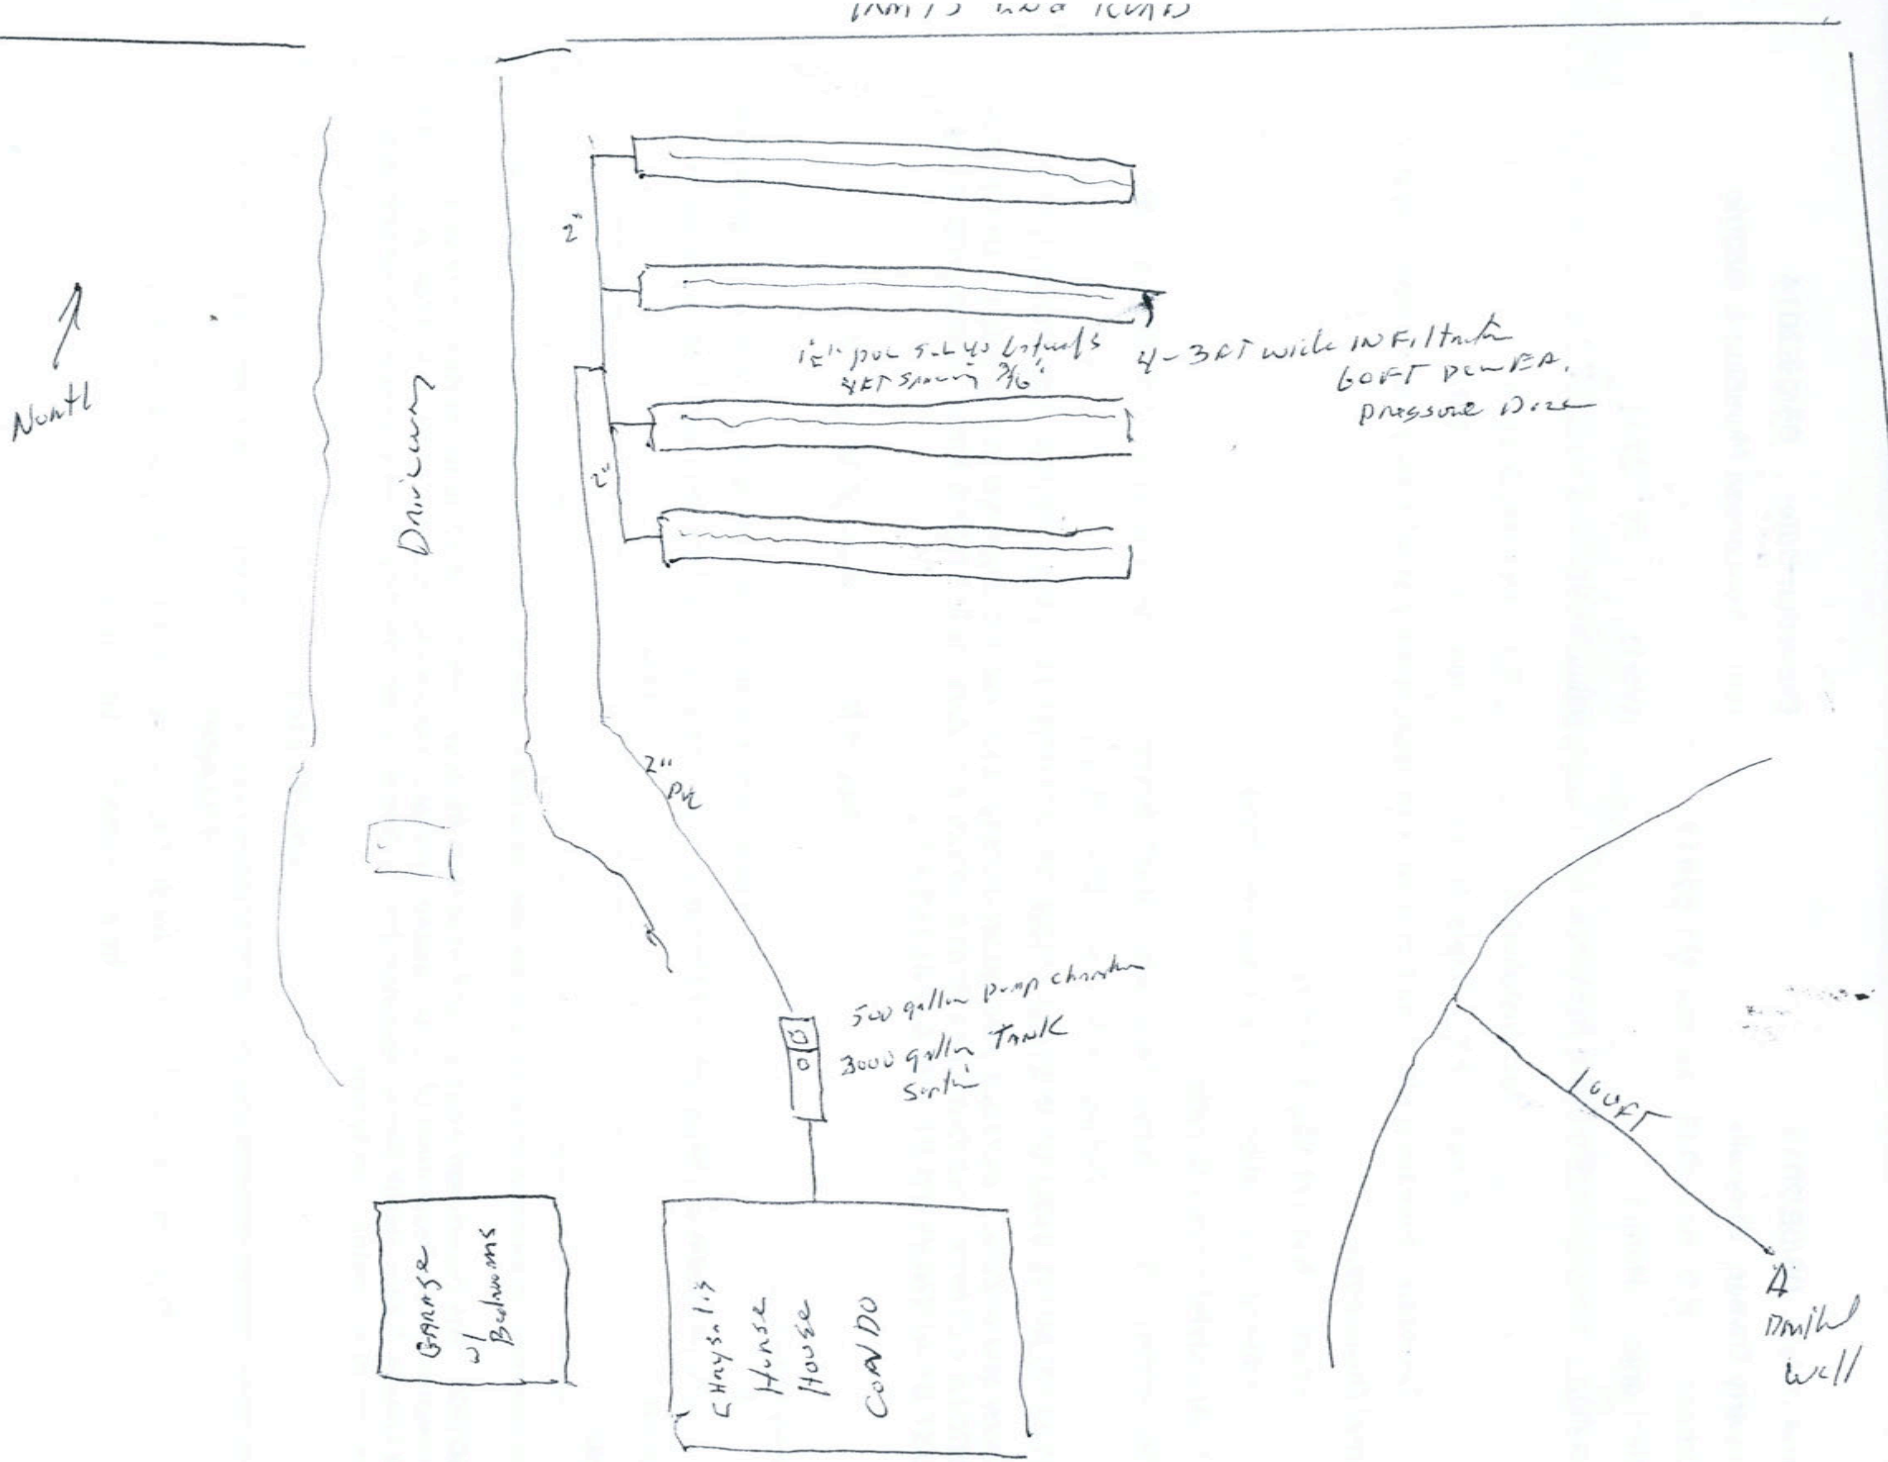
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


North
Driveway
4-3BT wide INFILtrator
60FT POWER.
Pressure Dose
2"
2"
2" PVC
500 gallon pump chamber
3000 gallon Tank
Septic
Garage
w/ Bedrooms
Chrysalis
House
House
CONDO
60FT
4
inch
well
Sophie Lake Road