LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/25/2013 Expiration Date: 06/26/2014

Property Owner: Roy & Janice Corneliuson c/o: Kootenai Sand & Gravel

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Kootenai Sand & Gravel License No. 109

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Replacing inadequate existing facility with elevated sand mound.

Parcel Description:

Legal: S27 T36 R26 (Clara Graves Life Estate)

Address or Location: Lot 6 in Glen Lake Tracts

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 10 x 30 sand mound

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL ELEVATED SAND MOUND SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LINCOLN COUNTY
DEPARTMENT of ENVIRONMENTAL HEALTH
Wastewater Treatment and Disposal System
Permit Application

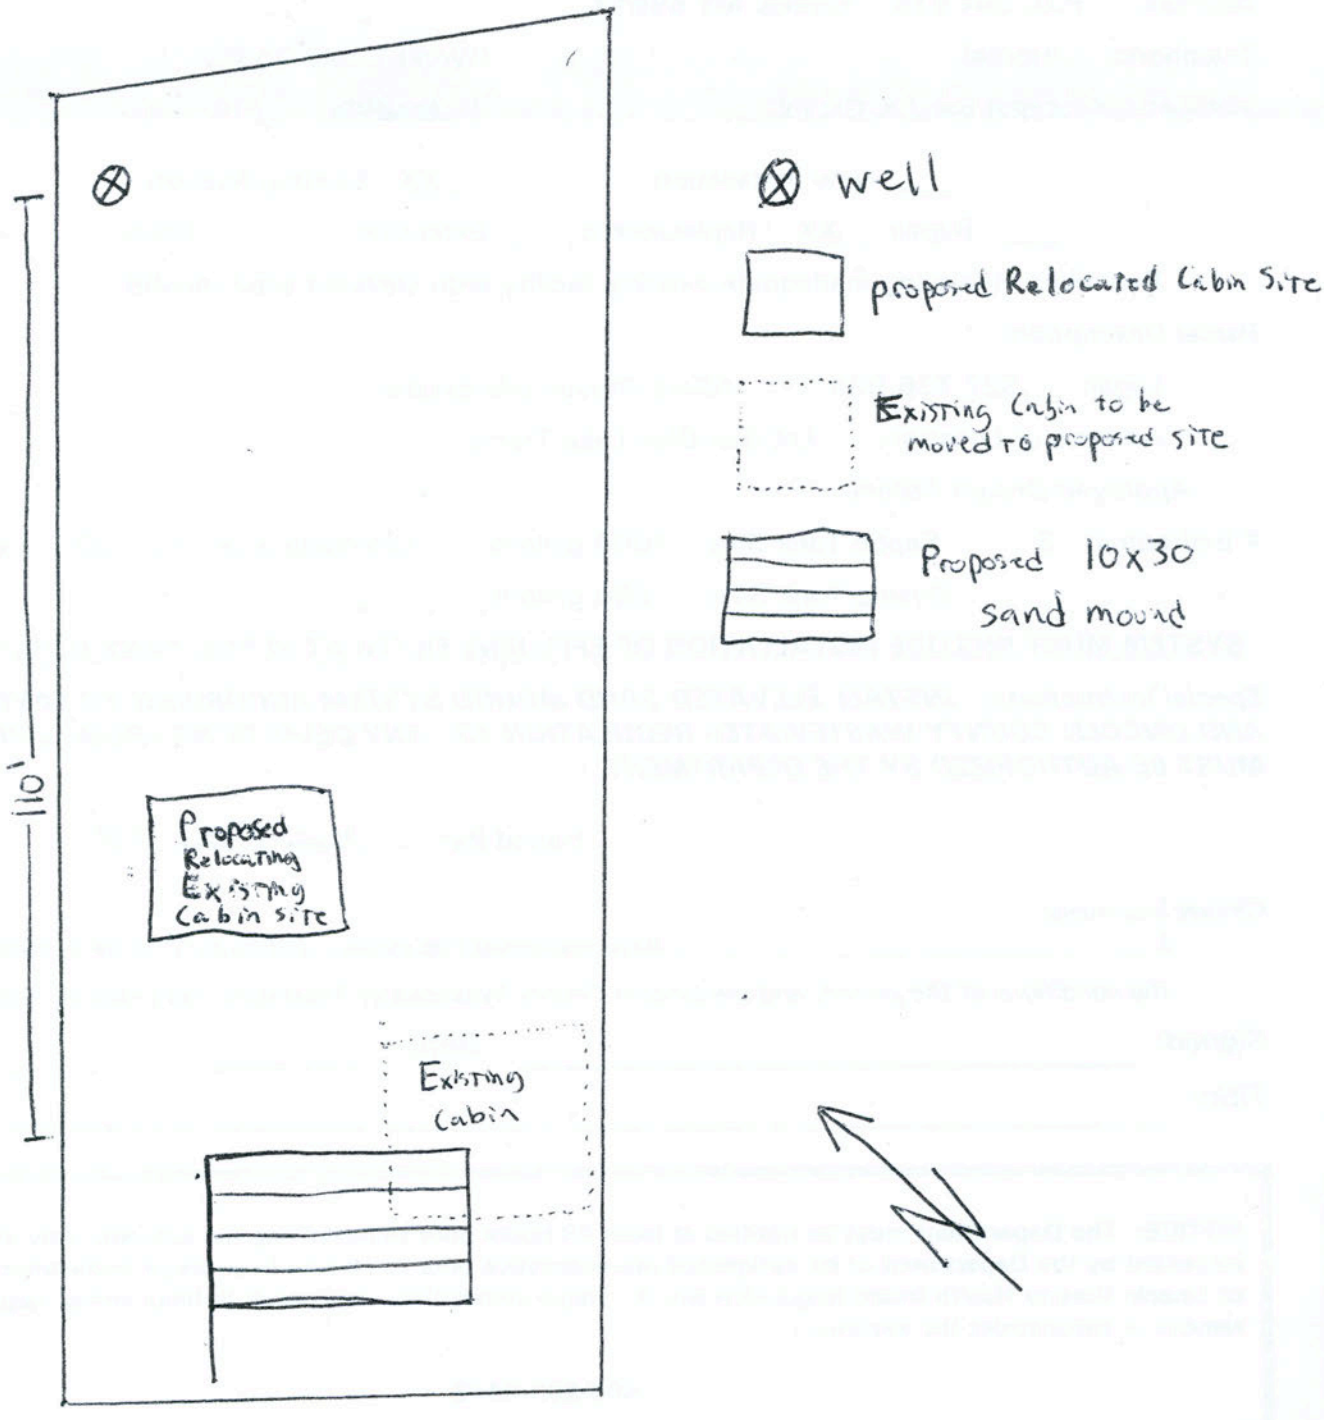

Roy + Janice Corneliuson

Glen Lake Tracts
S27, T36N, R26W lot 6 *7716*