LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/11/2025 Expiration Date: 12/10/2026 Permit#25-14321

Property Owner: Justin Fox

Mailing Address: [redacted]

Installer: Cory Burk License #: 213

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 1 Bedroom House.

Legal: KHAZ, S25, T35 N, R26 W, LOT 3, ACRES 1, PM 6960

Property Address: Lot 3 Khaz Rd. Fortine, MT 59918 Assessment Code: 14321

DEQ COSA: E.Q.# 08-1652 Date: 11/3/08

Approved Design Criteria: Installation of new pressure dosed system for 1 Bedroom House with 2 Laterals @ 58' with reduction for chambers.

# of Bedrooms: 1 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 2 Length of Laterals: 58' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 12/9/26

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

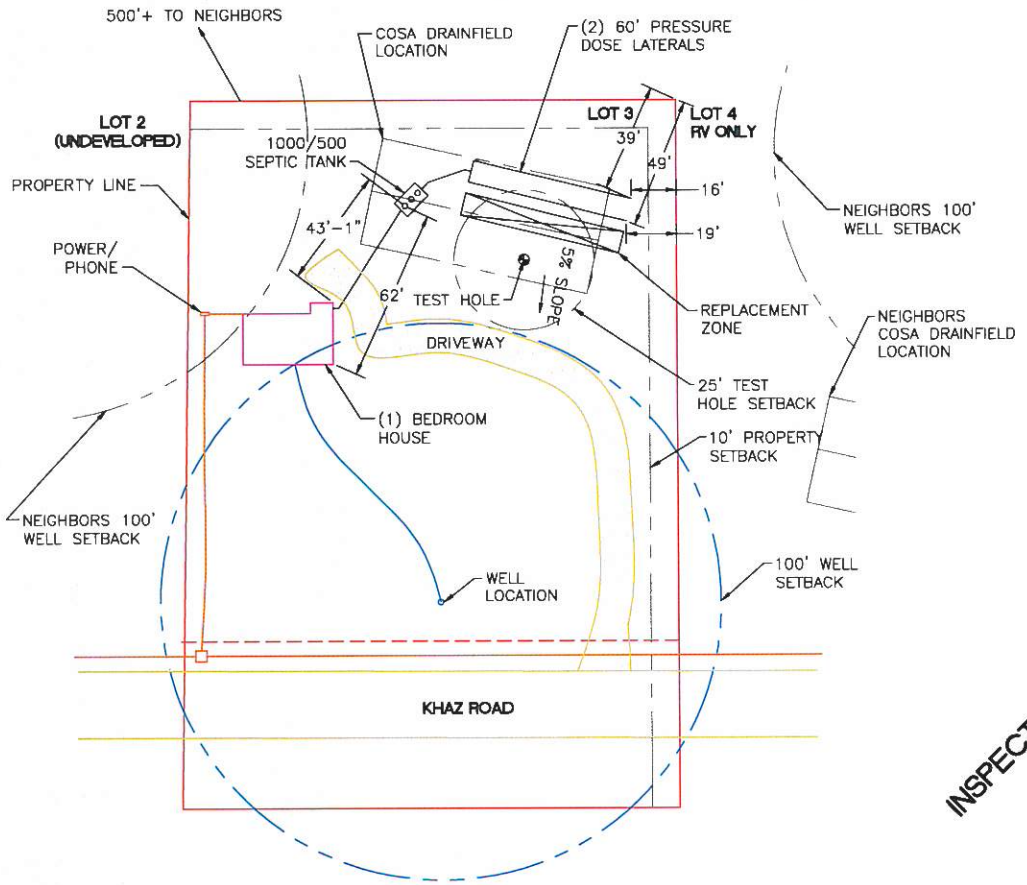

FOX SITE MAP

REV	DESCRIPTION	BY/DATE	APPD/DATE

DRAINFIELD SIZING

(1) BEDROOM= 150 GPD
150 GPD/0.4 APP= 375 SQFT
375 SQ FT/3' CHAMBERS= 125 LF
REDUCTION FOR 0.4 APP= 10%
125' X 0.9= 113 LF
(2) 58' LATERALS

LOT 3

1.0 ACRES
201 KHAZ ROAD, FORTINE, MT 59918
S25, T35N, R26W, KHAZ, PM 6960
ASSESSMENT #0000014321
GEO 56-4717-25-3-08-06-0000
COSA #08-1652, DATED 11-2008

INSPECTED 1-9-26

THIS DRAWING IS PROPERTY OF MDS UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & MDS IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM MDS MANAGEMENT

REV	DATE	COMPANY: MDS	SCALE: 1/16 = NOTED	MONTANA DESIGN SERVICES, INC. FOX KHAZ RD SEPTIC
		CONTRACT: VERBAL	DATE: 11/2025	SITE LAYOUT
		PLOT FILE: PWL-0001	WEIGHT: ---	SCREENVERSION: 11/24/25
				C. BURK 11/24/25
				461-001