LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/03/13 Expiration Date: 04/04/14

Property Owner: Tom Fraley c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Shallow capped, sand-lined trenches required. Using gravelless chambers – sizing reduction allowed per "Drainfield Size" below. System to be used for Shop with small apartment.

Parcel Description:

Legal: Government Lot 7 in S17 T37 R26

Address or Location: 1530 Pluid Road -- Eureka

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 112 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SAND-LINED, SHALLOW CAPPED SYSTEM ACCORDING TO DETAIL SHEET, LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

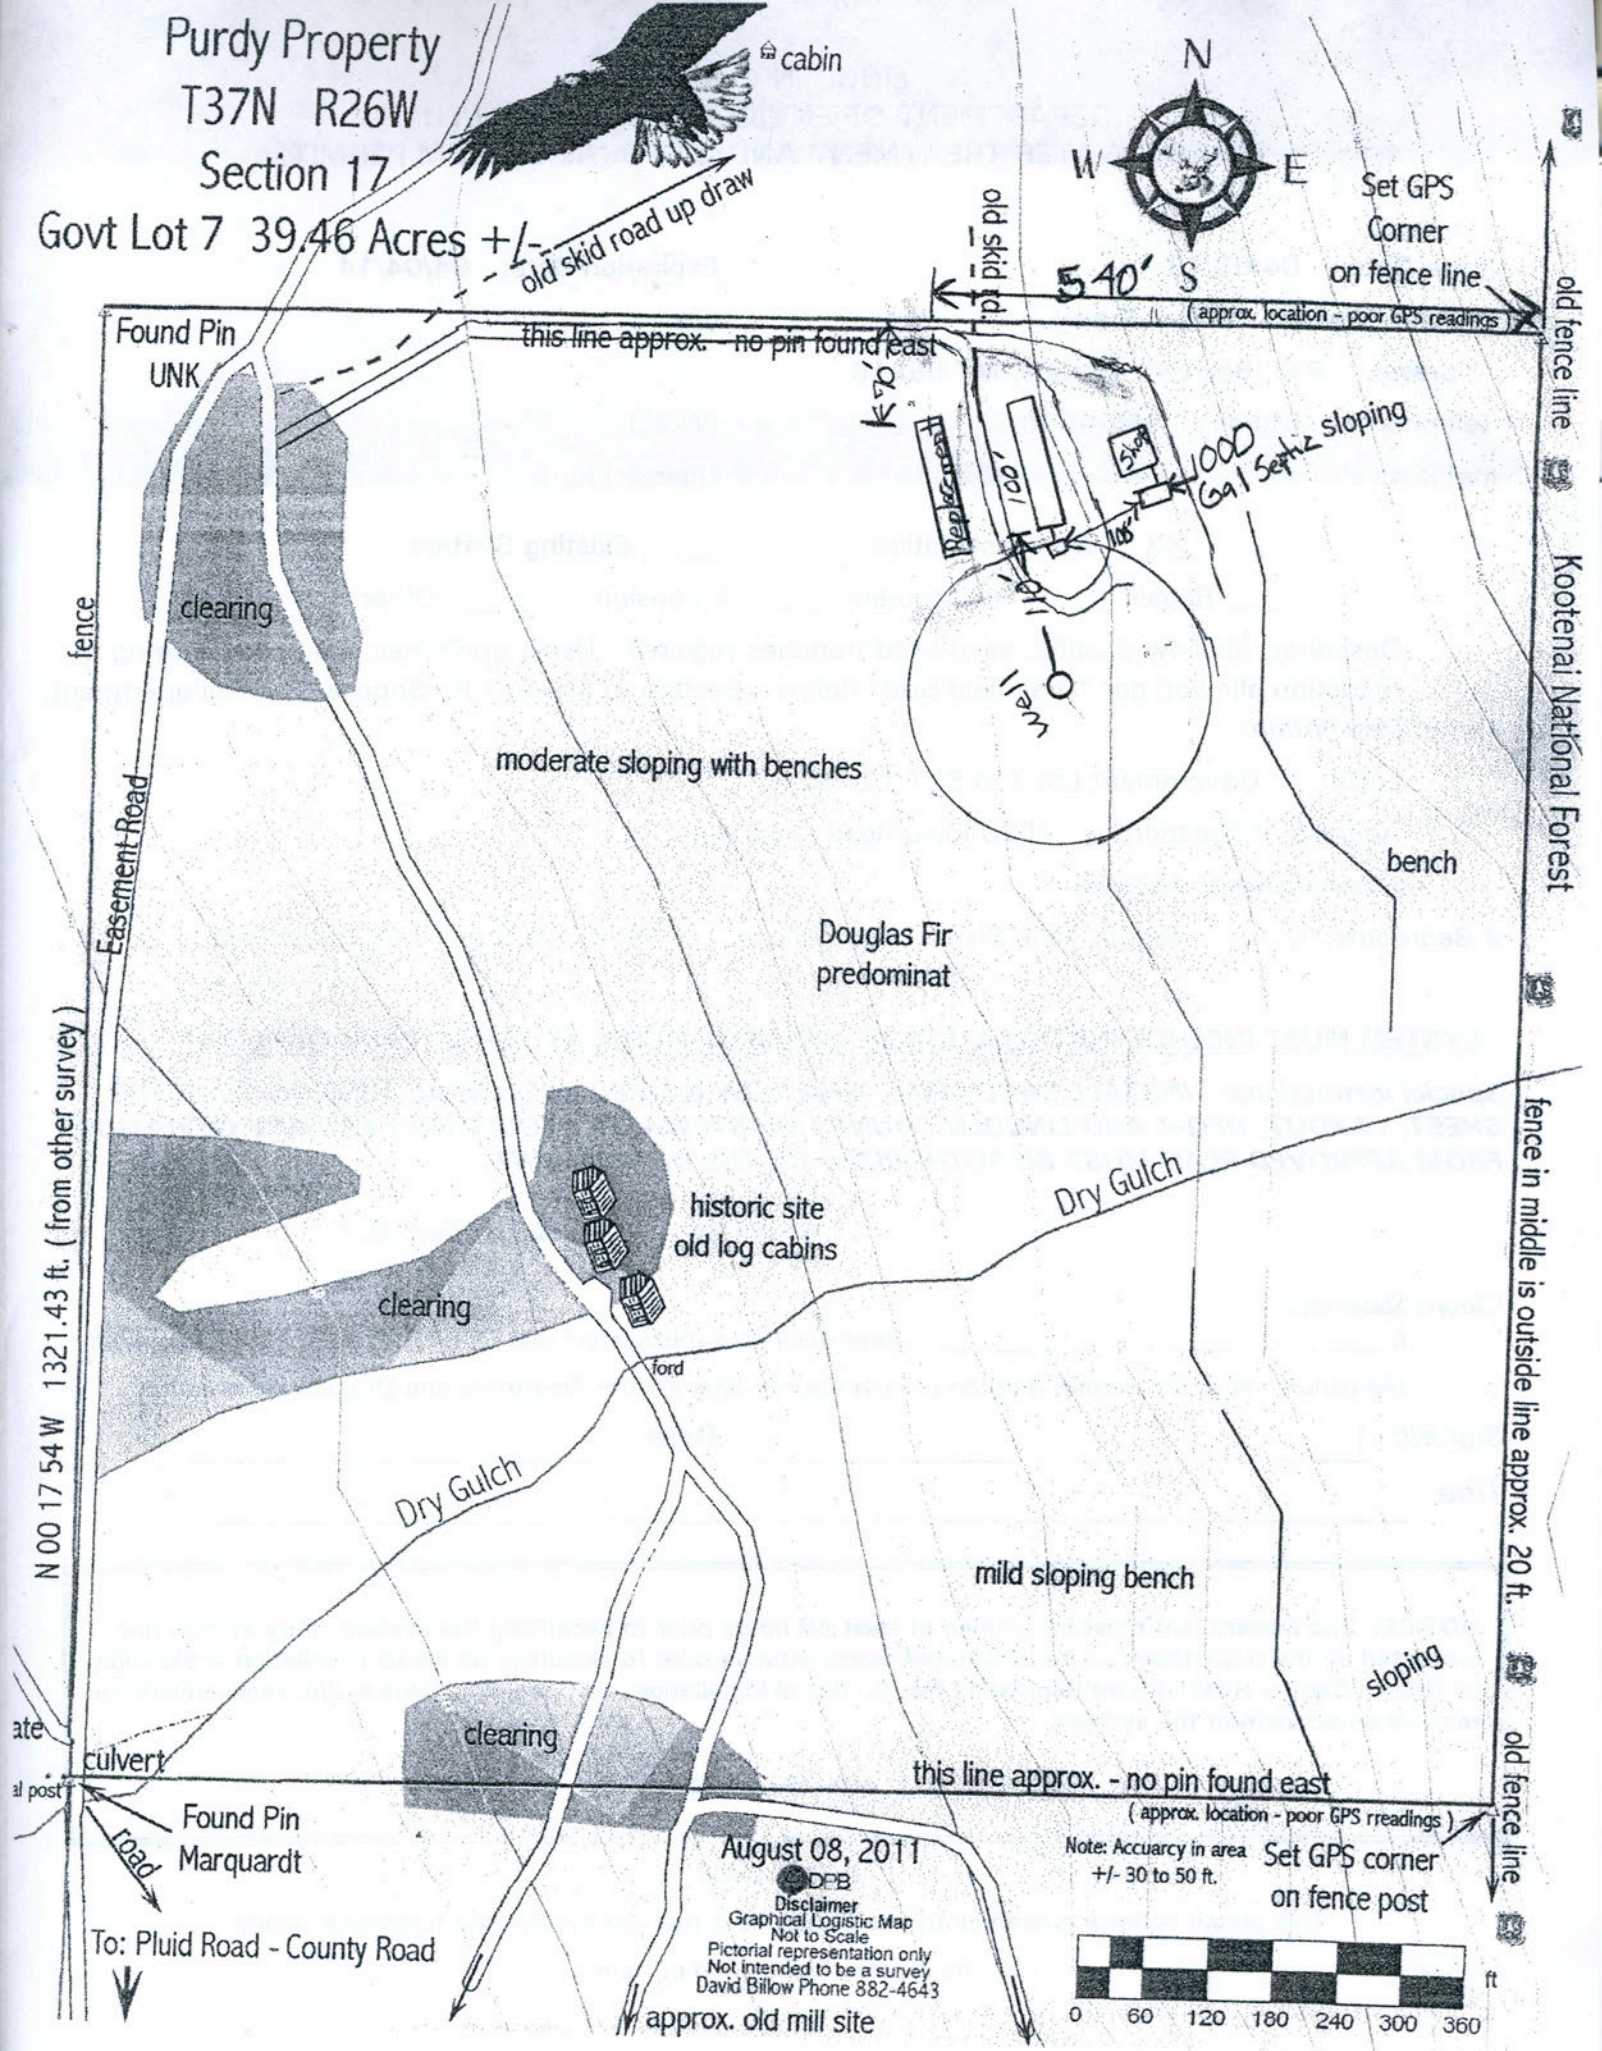
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Purdy Property
T37N R26W
Section 17
Govt Lot 7 39.46 Acres +/-
cabin
old skid road up draw
N
W
E
S
Set GPS
Corner
on fence line
old skid rd.
540'
(approx. location - poor GPS readings)
old fence line
Found Pin
UNK
this line approx. - no pin found east
Replacement
100'
Shop
1000 Gal Septic sloping
110'
well
fence
clearing
moderate sloping with benches
Easement Road
Kootenai National Forest
bench
Douglas Fir
predominat
historic site
old log cabins
clearing
Dry Gulch
ford
N 00 17 54 W 1321.43 ft. (from other survey)
fence in middle is outside line approx. 20 ft.
Dry Gulch
mild sloping bench
sloping
culvert
clearing
this line approx. - no pin found east
(approx. location - poor GPS rreadings)
Found Pin
Marquardt
road
To: Pluid Road - County Road
August 08, 2011
DPB
Disclaimer
Graphical Logistic Map
Not to Scale
Pictorial representation only
Not intended to be a survey
David Billow Phone 882-4643
approx. old mill site
Note: Accuarcy in area
+/- 30 to 50 ft.
Set GPS corner
on fence post
ft
0 60 120 180 240 300 360