LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/13/2025 Expiration Date: 06/12/2026 Permit#25-3164

Property Owner: James and Alexis Marozzo

Mailing Address: 184 Bowkers St., Libby, MT 59923

Installer: Terry Oedewaldt License #: 2

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House and shop with bathroom.

Legal: S26, T30 N, R31 W, ACRES 1.06, TR 2BL IN SENE

Property Address: 184 Bowkers St., Libby, MT 59923 Assessment Code: 3164

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House and shop with bathroom with 3 Laterals @ 70' with reduction for chambers.

# of Bedrooms: 3+Bathroom in Shop Septic Tank Size: 1500 Trench Width: 24"

# of Laterals: 3 Length of Laterals: 70' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 12/23/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

James & Alexis Marozzo Septic System

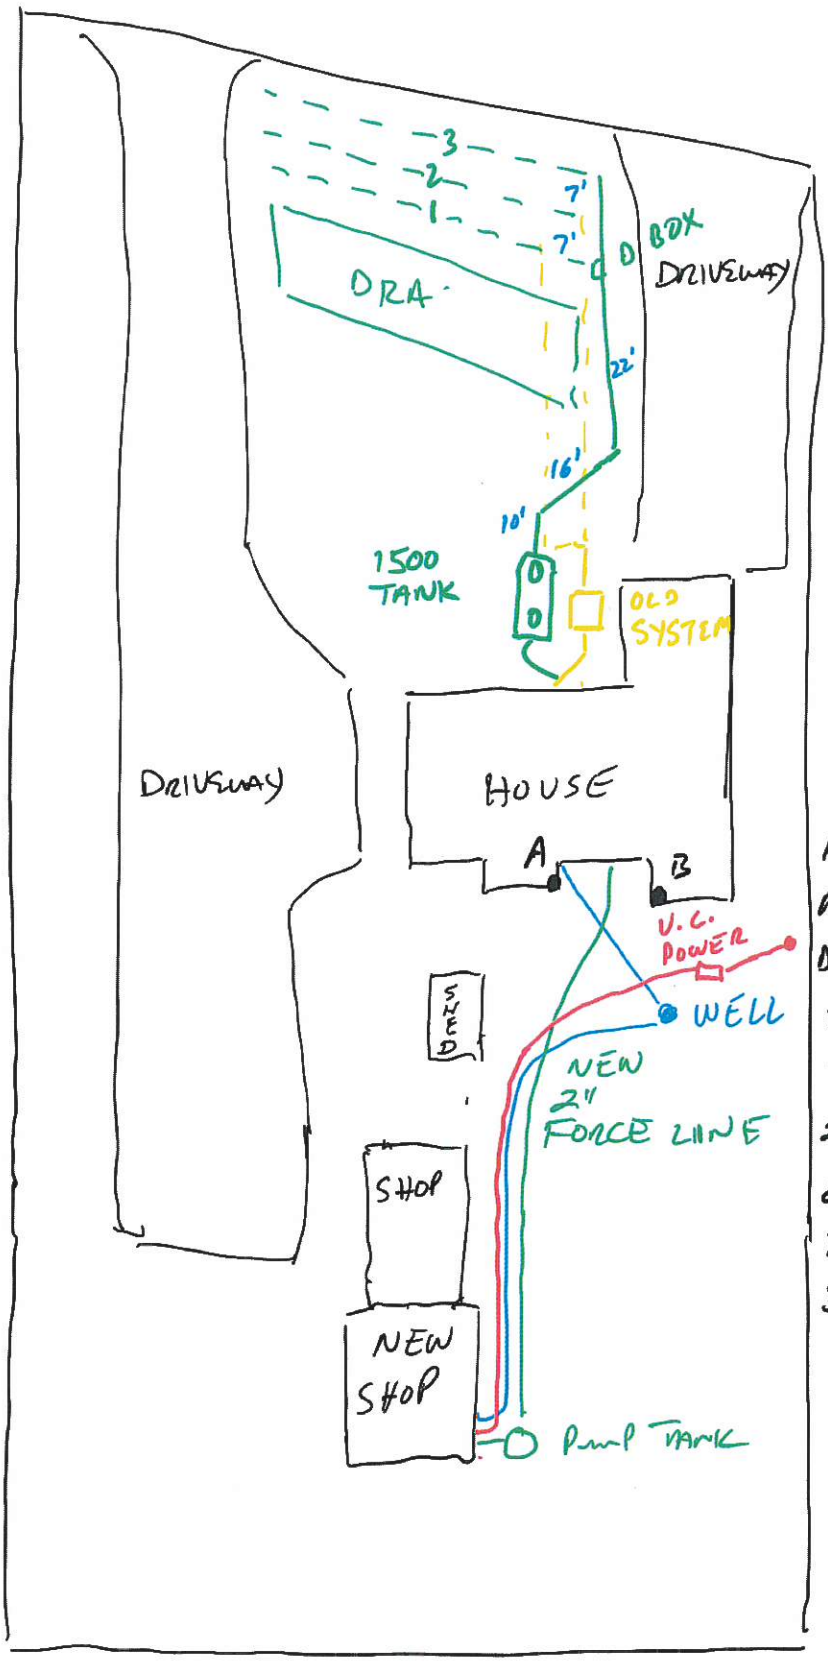

LOCATIONS:

	A	B
INLET	16'	33'6
FILTER	25'	39'2
D-BOX	71'6	83'
1S	71'	82'7
1E	97'	89'
2S	78'5	89'3
2E	102'	95'
3S	85'2	95'11
3E	107'4	101'4