LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/11/2012 Expiration Date: 12/12/2013

Property Owner: Chris Neill c/o: Webb Construction, Inc.

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Tracy Webb License No. 89

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Homestead Ales Wastewater Treatment System, per Engineered Plan by Larsen Engineering, for Chris Neill in Fortine, Montana.

Parcel Description:

Legal: NW-1/4 S12 T35 R26

Address or Location: Tract 1 of CS #2580

Approved Design Criteria For the Homestead Ales Wastewater Treatment System.

Max. Flows: 364 GPD Septic Tank Size: 1000 gallons Drainfield Size: 240 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: ***INSTALL SYSTEM ACCORDING TO DEQ APPROVED LARSEN ENGINEERING PLAN, DIRCULAR DEQ 4, AND LINCOLN COUNTY WASTEWATER REGULATION. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.*** **LARSEN ENGINEERING MUST ALSO SIGN-OFF ON THE CLOSURE STATEMENT.**

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and confirm that it is in compliance with the engineered plan, DEQ approval documents, the conditions of this permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:*

Licensed Installer

Signed: _____ *Date:*

, PE #

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/11/2012 Expiration Date: 12/13/2013

Property Owner: Chris Neill c/o: Webb Construction, Inc.

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Tracy Webb License No. 89

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Wastewater holding tank system for Homestead Ales brewing vats wastewater. ***Use of this system for disposal of residential wastewater is strictly prohibited. Use of this system by any other commercial operation without prior review and approval of a "change of use" proposal by the Department is prohibited. Tank must be leak tested annually & results reported to the Department.***

Parcel Description:

Legal: NW-1/4 S12 T35 R26

Address or Location: Tract 1 of CS #2580

Approved Design Criteria:

Max. Discharge: @39 gallons per week Holding Tank Size: 2000 gallons

Tank pumping to be scheduled whenever ¾ full tank alarm is activated (approximately every 38 days of production).

Special Instructions: INSTALL WASTEWATER HOLDING TANK SYSTEM ACCORDING TO DEQ APPROVED PLAN PREPARED BY LARSEN ENGINEERING, LOT LAYOUT, CIRCULAR DEQ-4 CHAPTER 24 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT

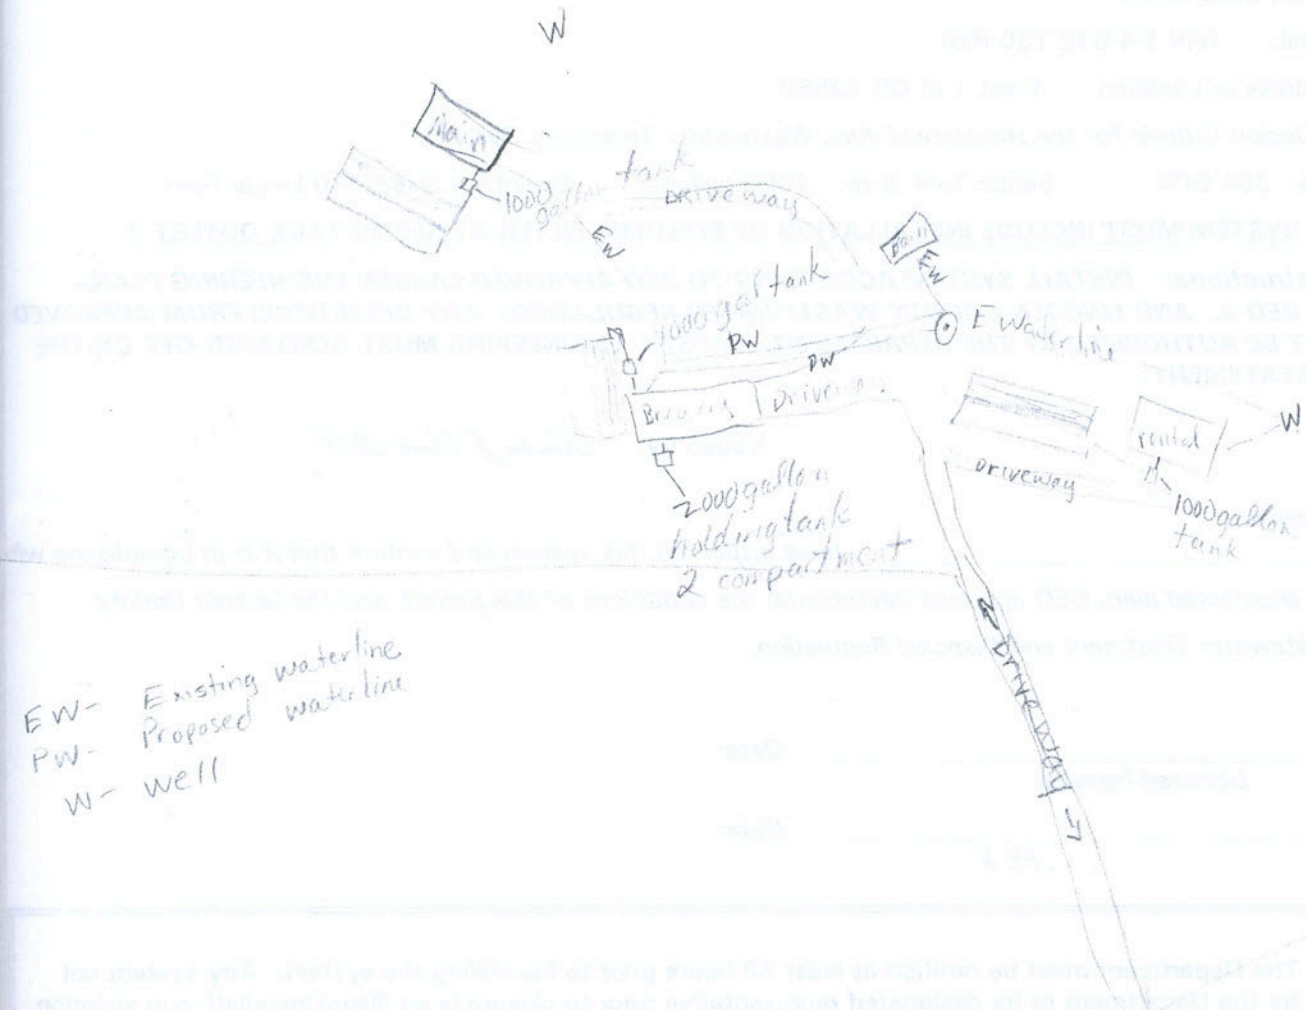
W
Main
1000 gallon tank
Driveway
EW
Barn
EW
1000 gal tank
PW
PW
E Waterline
Barn
Driveway
rental
W
driveway
1000 gallon tank
2000 gallon holding tank 2 compartment
Driveway
EW- Existing waterline
PW- Proposed waterline
W- well

LOT LAYOUT

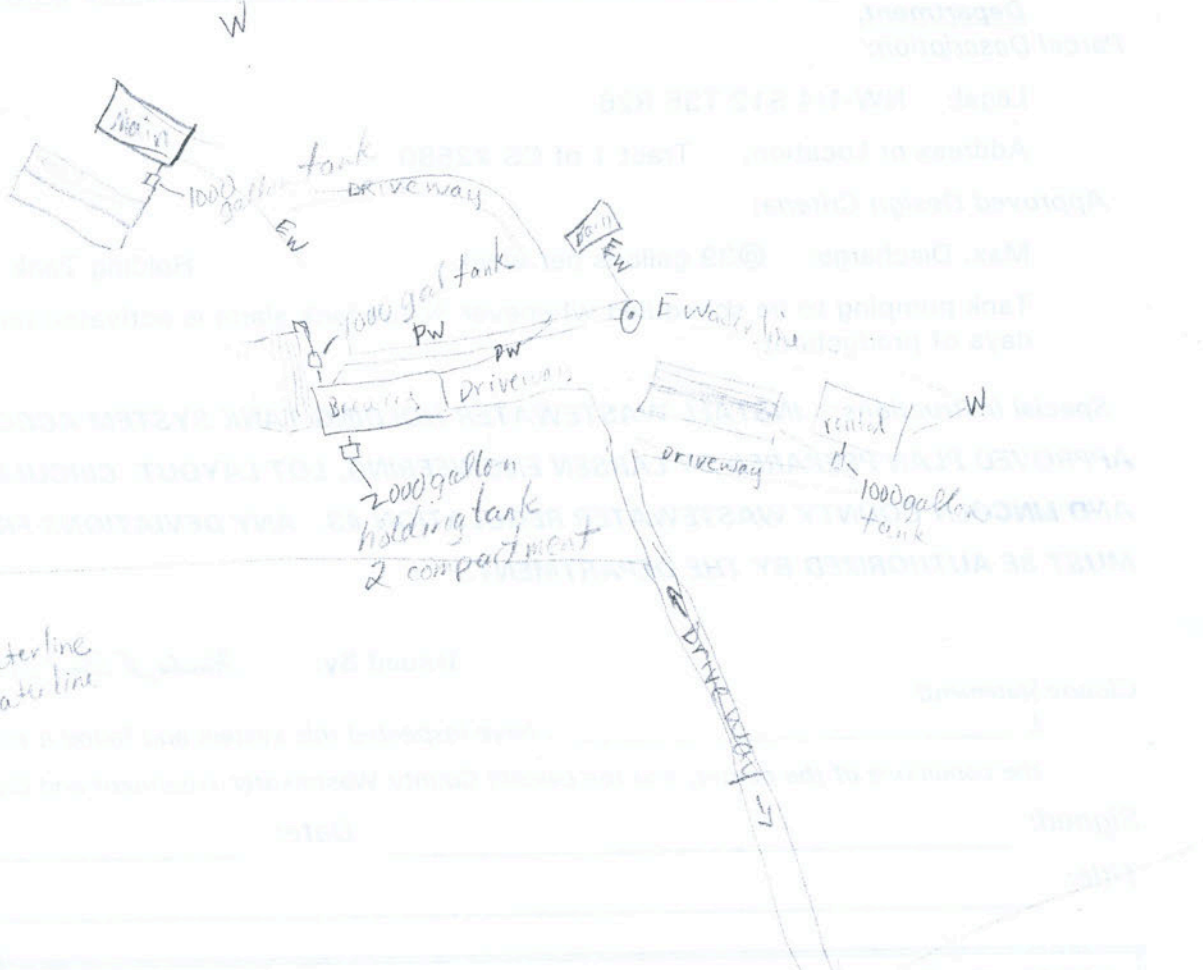

EW- Existing waterline
PW- Proposed waterline
W- well