LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/05/2011 Expiration Date: 01/06/2012

Property Owner: Maria Ekholt c/o: Koocanusa Plumbing & Electric

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Koocanusa Plumbing & Electric License No. 8

____ New Installation __XX__ Existing System

_____ Repair _____ Replacement __XX__ Extension _____ Other

Describe: **Adding 100 linear feet of drainfield to existing system for the currently renter occupied mobile home. This extension will provide compliance with requirements (b) and (c) of the attached August 31, 2010, letter from the Lincoln County Planning Department regarding Maria Ekholt's density change request for this property.**

Parcel Description:

Legal: S2 & S35 T36 R26 Lot 2 of Mud Creek Estates

Address or Location: 2775 Therriault Creek Road

Approved Design Criteria:

Bedrooms: 3 Existing Septic Tank Size: 1000 gallons Total Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

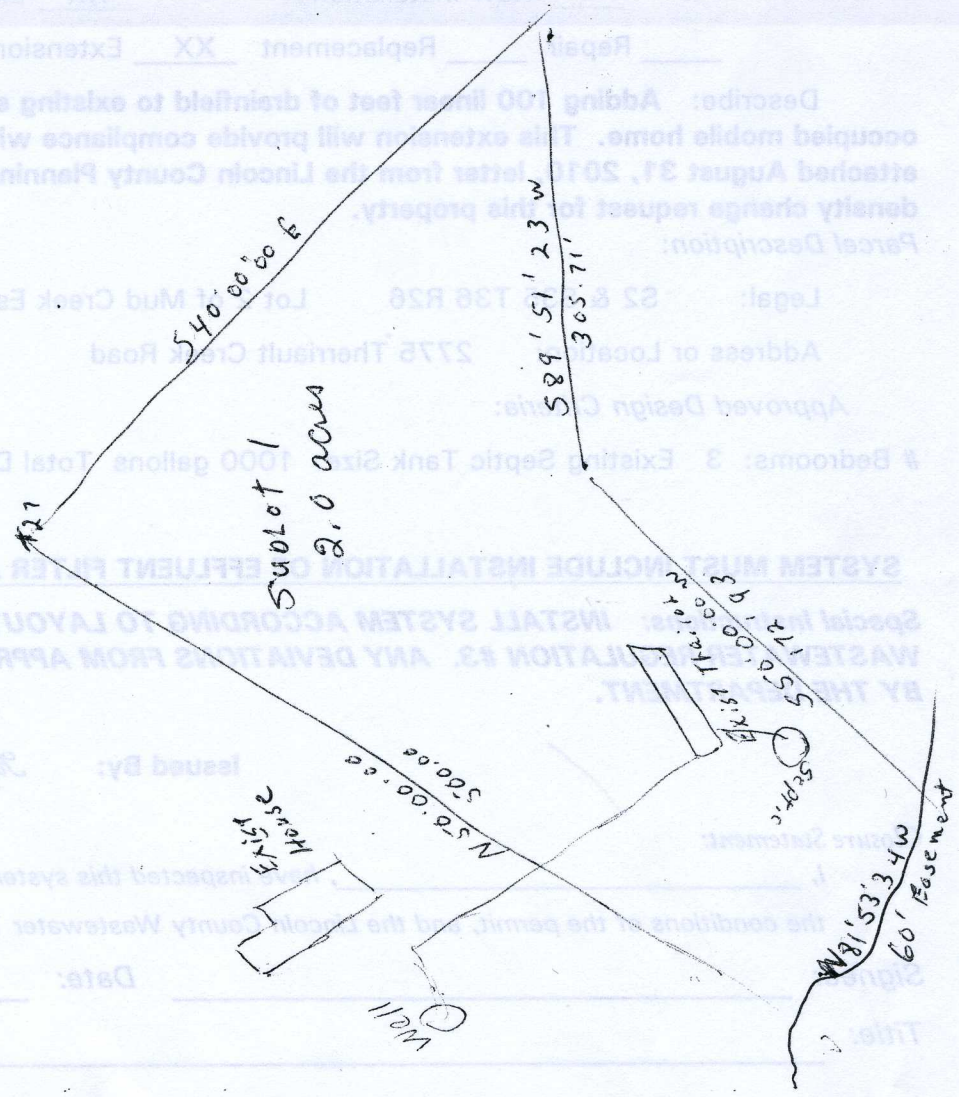
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


S40°00'00"E
427
Sublot 1
2.0 acres
S89°51'23"W
305.71'
Existing Trailer
S5°51'12"E
Septic
N36°00'00"E
300.00'
Existing House
Well
N81°53'34"W
60' Ease ment