LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/28/2012 Expiration Date: 06/29/2013

Property Owner: Dorothy Hall c/o: Randy Hall

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Charley Follensbee License No. 96

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing pressure-dosed drainfield to minimize drainfield footprint

Parcel Description:

Legal: NW-1/4 SE-1/4 NW-1/4 S23 T36 R27

Address or Location: Lot 1 in Rodgers Subdivision

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 336 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

OWNERS: ALFRED W. RODGERS AND PHYLLIS J. RODGERS, TRUSTEES OF THE ALFRED AND PHYLLIS RODGERS LOVING TRUST

EQ # 09-1066


LOT LAYOUT
RODGERS SUBDIVISION

NW1/4 SE1/4 NW1/4, SEC. 23, T36N, R27W, P.M., M.,
LINCOLN COUNTY, MONTANA

Barbara Kingery 12/2/08

LEGEND

- FOUND 5/8" REBAR W/CAP STAMPED #13102LS (UNLESS OTHERWISE NOTED)
- FOUND 5/8" REBAR W/CAP STAMPED #13102LS
- SET 5/8" X 24" REBAR W/PLASTIC CAP STAMPED #13102LS
- COMPUTED POINT
- P.O.B. POINT OF BEGINNING
- (M) MEASURED DISTANCE
- (R) RECORDED DISTANCE
- EXISTING WOOD FENCE
- EXISTING WIRE FENCE
- PERCOLATION TEST
- TEST HOLE
- PROPOSED DRAINFIELD
- REPLACEMENT DRAINFIELD
- WELL SITE W/100' ISOLATION
- MIXING ZONE
- RETENTION SWALE (2' WIDE BY 1' DEEP-TO BE BUILT DOWN GRADIENT OF BUILDINGS)

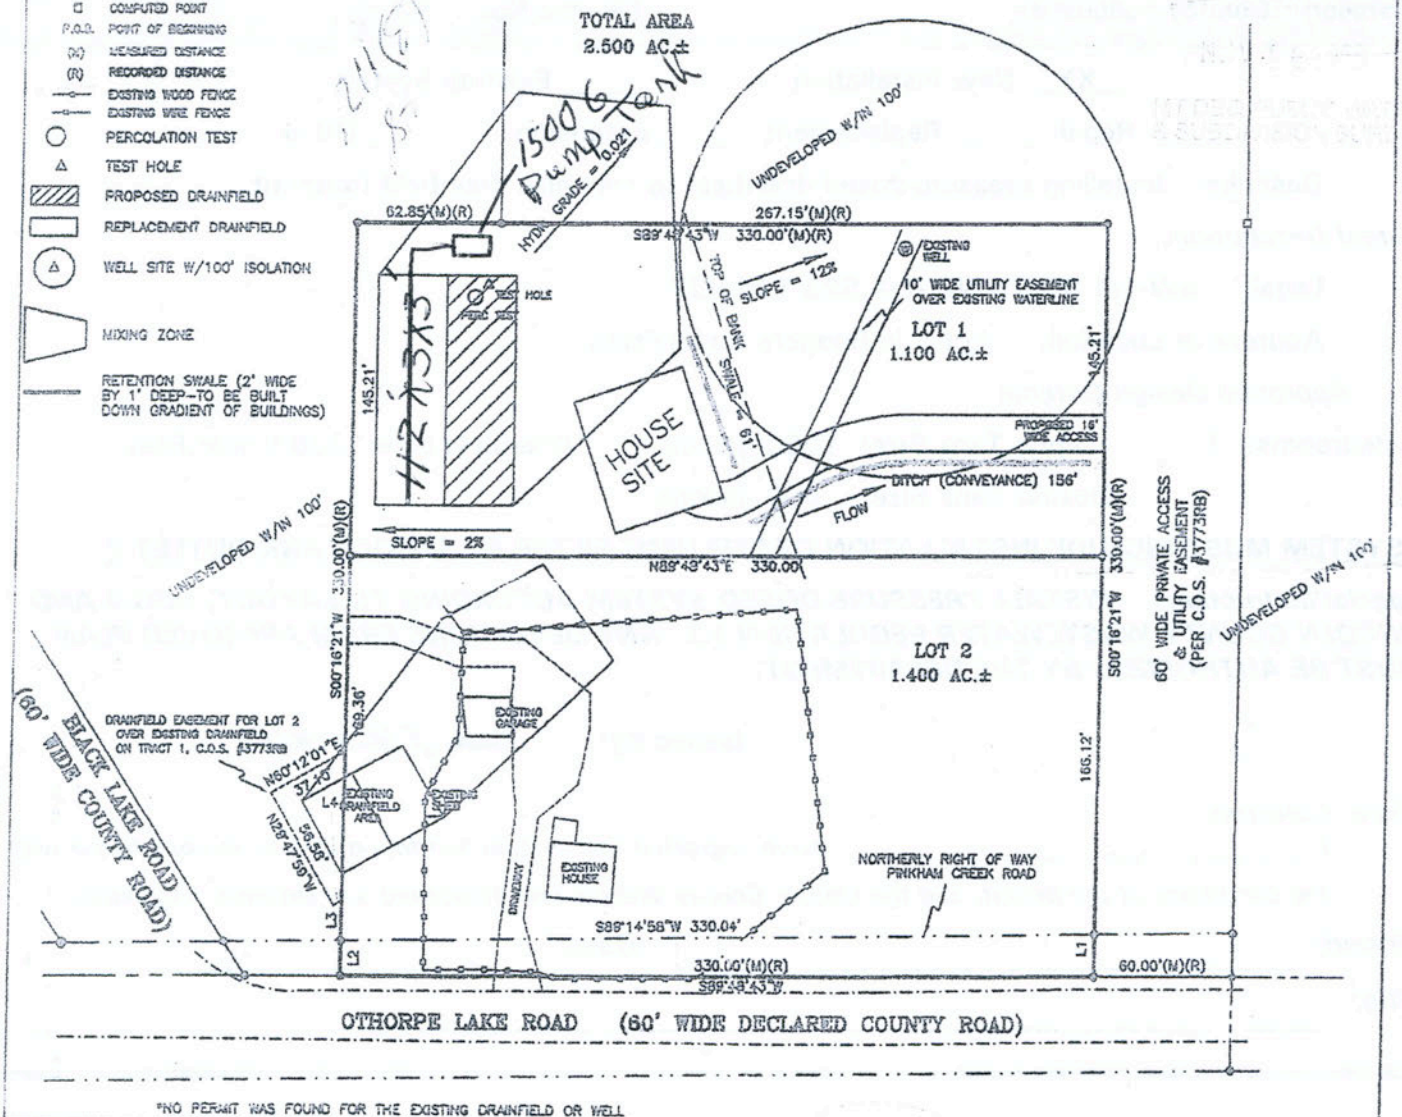

*NO PERMIT WAS FOUND FOR THE EXISTING DRAINFIELD OR WELL

LINE	BEARING	DISTANCE
L1	N00°16'21"E	18.68'
L2	N00°16'21"E	15.44'
L3	N00°16'21"E	17.54'
L4	S60°06'26"W	4.34'

LOT 2 EXEMPT FROM SANITATION REVIEW PURSUANT TO 76-4-125(2)(a)(ii), M.C.A. "...THE REMAINDER IS 1 ACRE OR LARGER AND HAS AN INDIVIDUAL SEWAGE SYSTEM SERVING A DISCHARGE SOURCE THAT WAS IN EXISTENCE PRIOR TO APRIL 29, 1993, AND, IF REQUIRED WHEN INSTALLED, THE SYSTEM WAS APPORVED PURSUANT TO LOCAL REGULATIONS OR THIS CHAPTER."

SAM CORDI
REGISTERED LAND SURVEYOR
974 COLORADO AVE.
P.O. BOX 323
WHITEFISH, MT 59937
PHONE: (406)-862-6377

40' 0 40' 80'

BY: THOMAS SIBSON
DATE: SEPT. 24, 2008