LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/01/2010 Expiration Date: 10/02/2011

Property Owner: Tom & Rosie Harrell c/o: Gideon Yutzy

Address: [redacted]

Telephone: (Home) 559-5995 (Work) 291-0630

Installer: Gideon Yutzy License No. 113

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Using gravelless chambers– size reduction allowed per "Drainfield Size" below. Adding second 1000-gallon septic tank with effluent filter to existing 1000 gallon tank.

Parcel Description:

Legal: NE-1/4 NW-1/4 S14 T37 R28

Address or Location: Parcel A of COS #1462 6442 West Kootenai Road

Approved Design Criteria:

Bedrooms: 5 Septic Tank Size: 2000 gallons Drainfield Size: 352 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

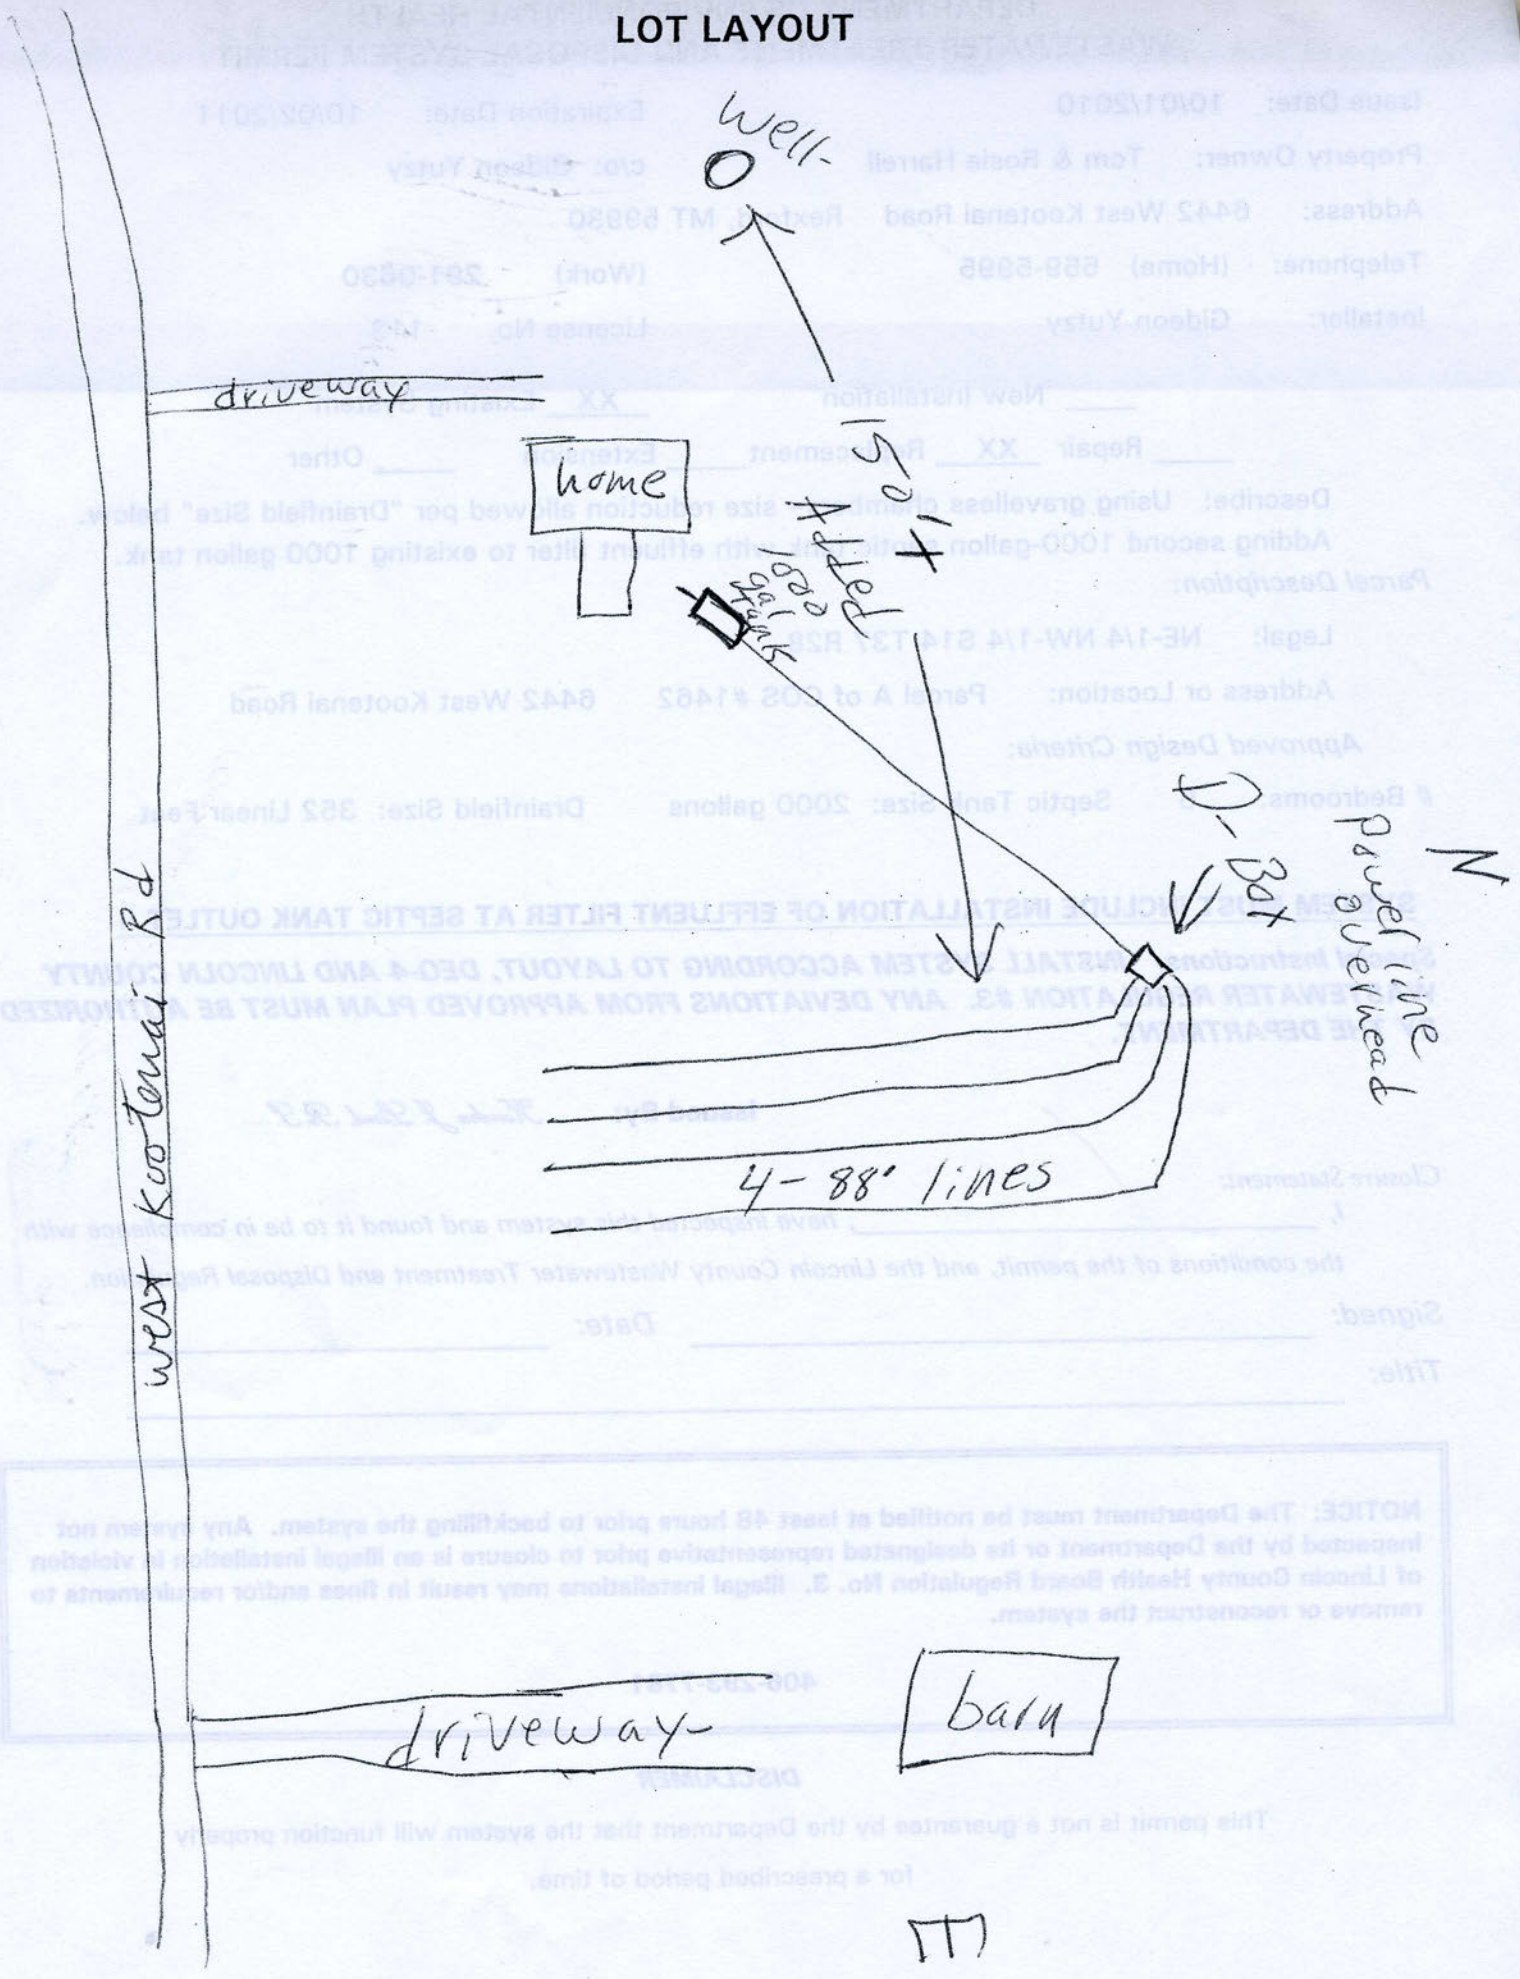
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


well
driveway
home
150' Added
1000 gal tank
D-Box
power line overhead
N
4-88' lines
west Kootenai Rd
driveway
barn