Licensed Installer
Sign + Return

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/08/03 Expiration Date: 07/09/04

Property Owner: Jim Henrie c/o: Koocanusa Plumbing & Electric

Address: [redacted]

Telephone: (Home) (Work)

Installer: Koocanusa Plumbing & Electric License No. 8

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe:

Parcel Description:

Legal: SE-1/4 NW-1/4 NE-1/4 SW-1/4 S22 T36 R26

Address or Location: Block 3A of Amended Subdivision Plat of Blocks 3 & 4, Glen Lake Park

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 300 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Closure Statement:

I, Michael Nelson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 11 Sept 2003

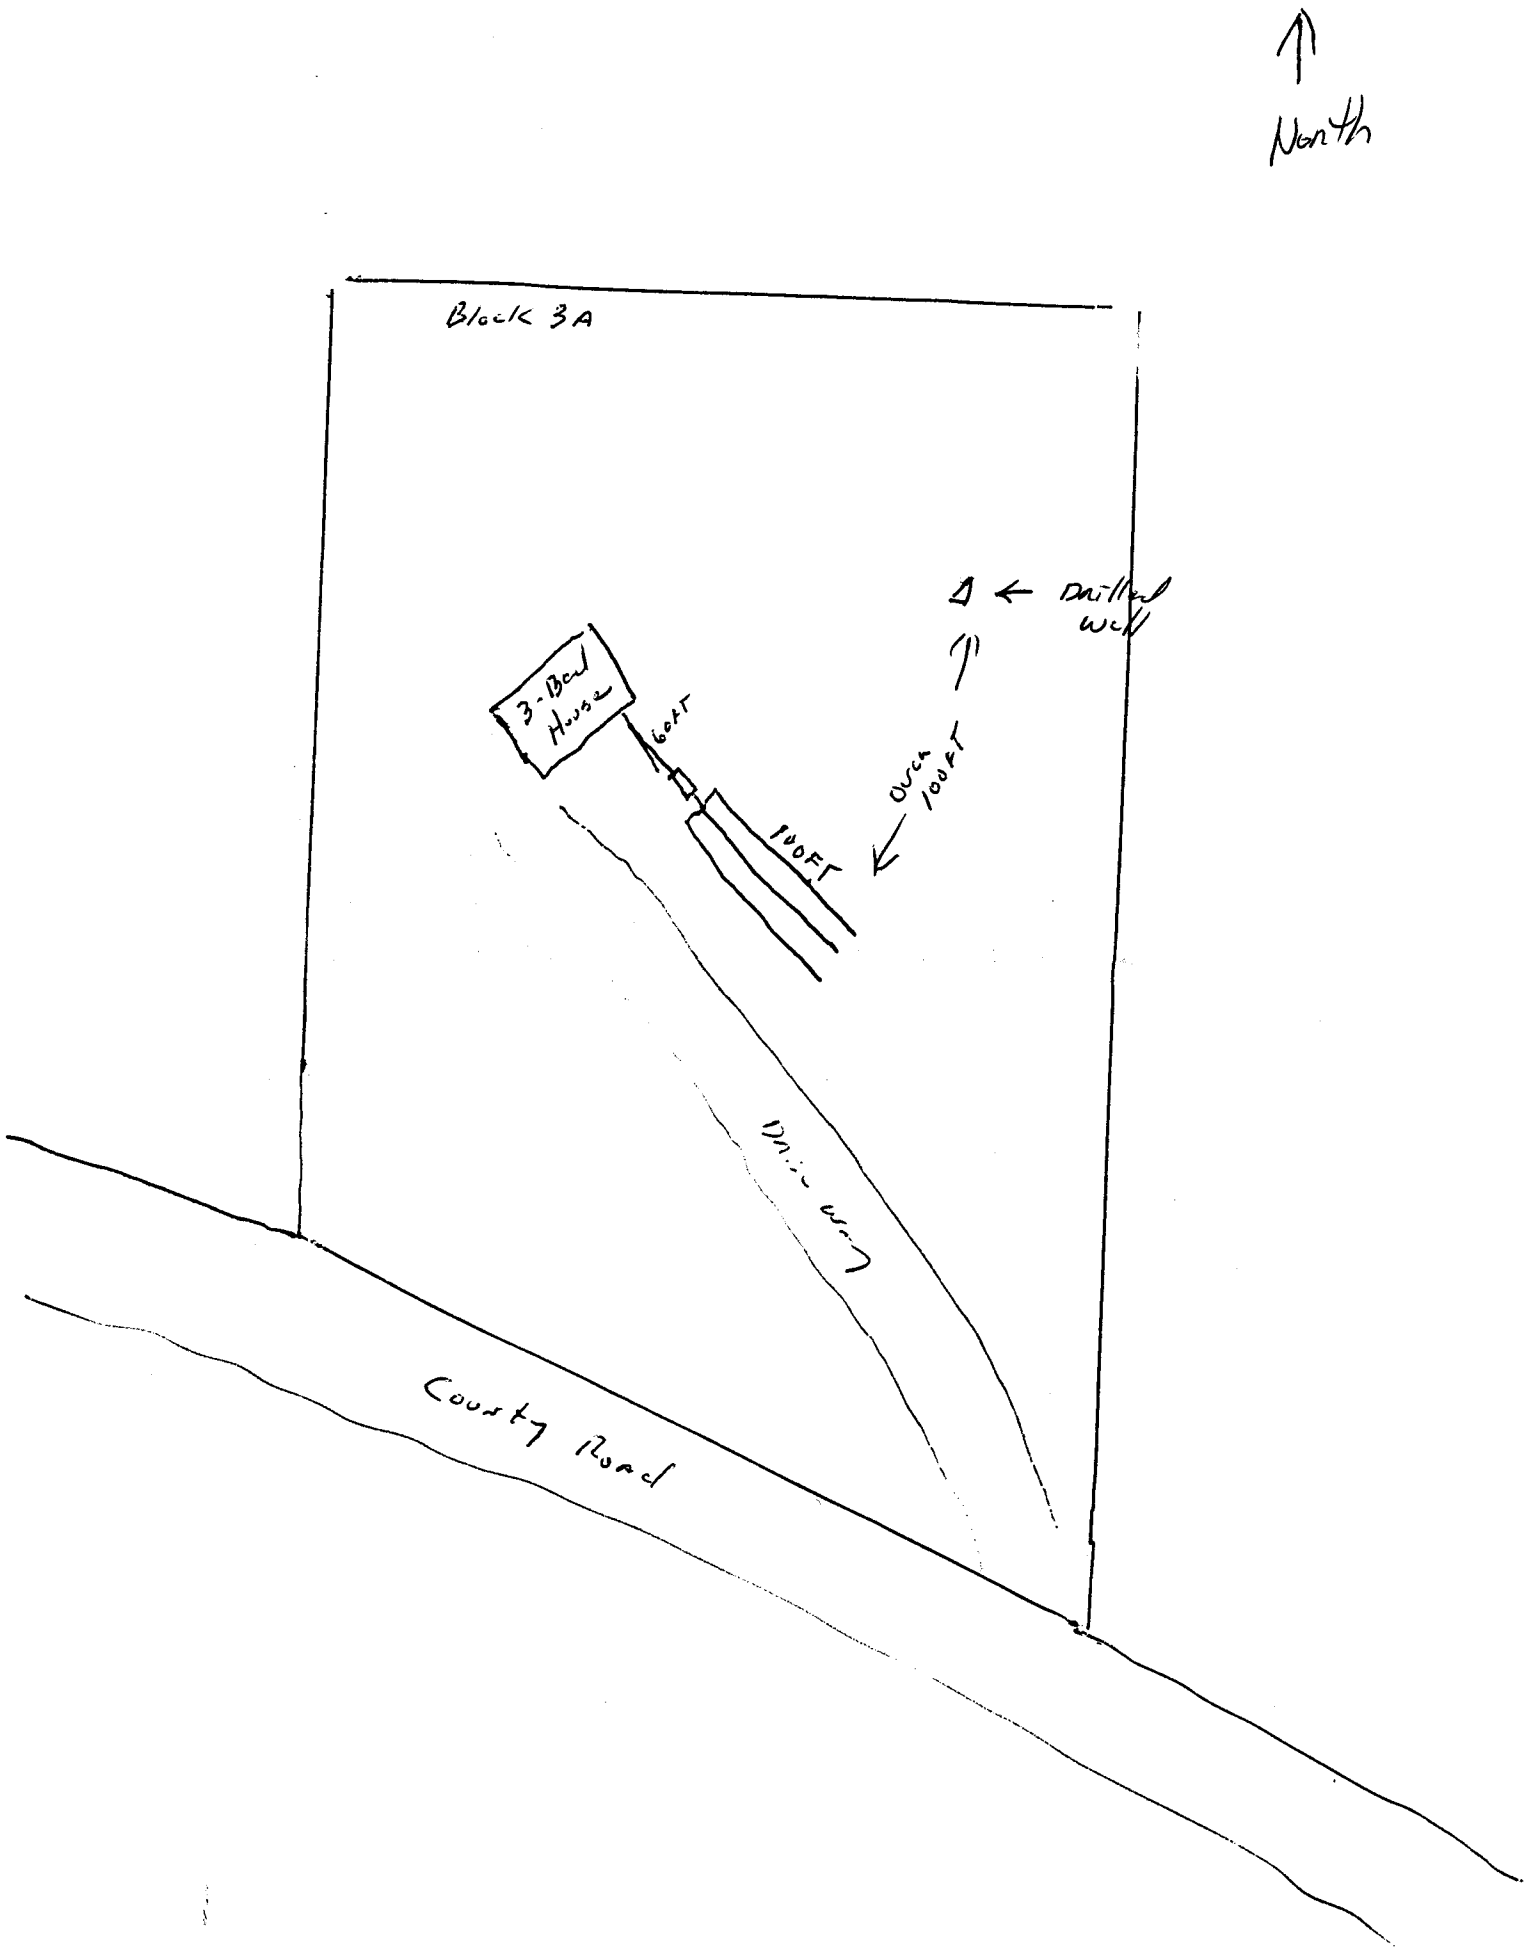
Title: Septic tank install #8

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


North
Block 3A
Drilled well
3-Bed House
60FT
100FT
OVER 100FT
Drive way
County Road