LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/28/2025 Expiration Date: 03/27/2026 Permit# 25-55464

Property Owner: JoAnne Jackson

Mailing Address: [redacted]

Installer: Cory Persson License #: 197

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☒ Extension

Describe: Installation of new pressure dosed system. First half completed 7/23/24.

Legal: S21, T37 N, R27 W, COS 3801, PARCEL D, ACRES 2.15

Property Address: 995 Summer Ln., Eureka, MT 59917 Assessment Code: 55464

DEQ COSA: EQ#13-1741 Date: 03/25/2013

Approved Design Criteria: Installation of new pressure dosed system for 6 Bedroom and 2 Bedroom with 6 Laterals @ 50' with reduction for chambers. First half completed 7/23/24.

# of Bedrooms: 6 +2 Septic Tank Size: 2000/500 & 2000/1000 Trench Width: 36"

# of Laterals: 6 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the Lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(if applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 8/15/25

This permit is not finalized until the system is inspected and the closure statement is signed.


This permit is not a guarantee that the system will function properly for a prescribed period of time.

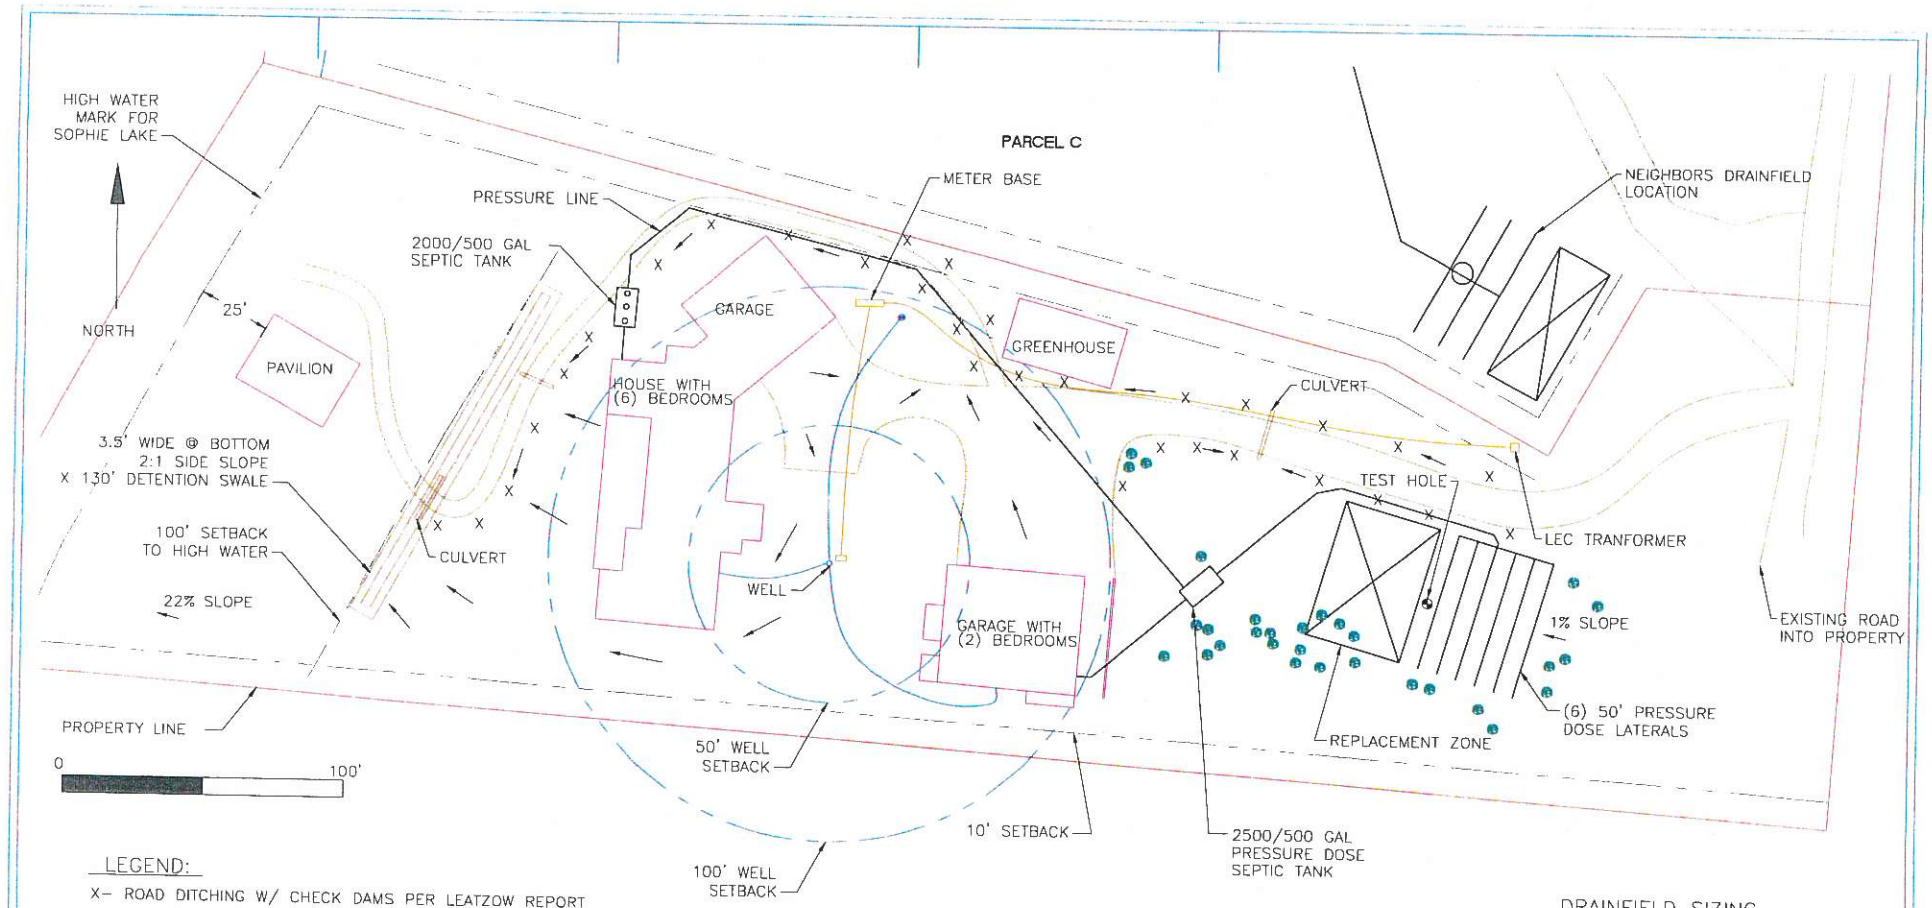

LEGEND:

X– ROAD DITCHING W/ CHECK DAMS PER LEATZOW REPORT

GRASS LINED DETENTION SWALE

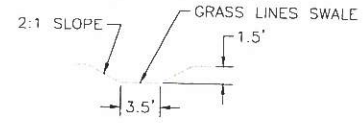

JACKSON SITE LAYOUT

PARCEL D

2.15 ACRES
995 SUMMER LANE, EUREKA, MT 59917
S21, T37N, R27W, COS 3801
ASSESSMENT #0000055464
GEO 56-4928-21-1-01-02-0000

DRAINFIELD SIZING

(8) BEDROOM= 675 GPD
675 GPD/0.6 APP= 1125 SQFT
1125 SQ FT/3' CHAMBERS= 375 LF
REDUCTION FOR 0.6 APP= 20%
375' X 0.80= 300 LF
(6) 50' LATERALS

THIS DRAWING IS PROPERTY OF BUBBA UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & BUBBA IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM BUBBA

REV	DATE	COMPANY	SCALE		BUBBA EXCAVATING JACKSON SITE MAP
		D/H	1/16 = NOTED		SITE LAYOUT
		CONTRACT: VERBAL	DATE: 2/2024	DWG TOLERANCES:	SCHEMATIC 2/5/24
		PLOT FILE: PML-0001	WEIGHT	FINISH	BUBBA 2/28/24
					JACKSON-01 1