LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/24/2011 Expiration Date: 02/25/2012

Property Owner: Michael & Carrie Kallal c/o: Robert Cuffe

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Robert Cuffe License No. 141

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Pressure-dosed system in 3-foot wide trenches required per DEQ approval.

Parcel Description:

Legal: S1/2 S7 T36 R27

Address or Location: Lot 20 of Tobacco Bay Estates 245 HooDoo Loop, Rexford

Approved Design Criteria:

Bedrooms: 4 Septic Tank Size: 1500 gallons Drainfield Size: 300 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

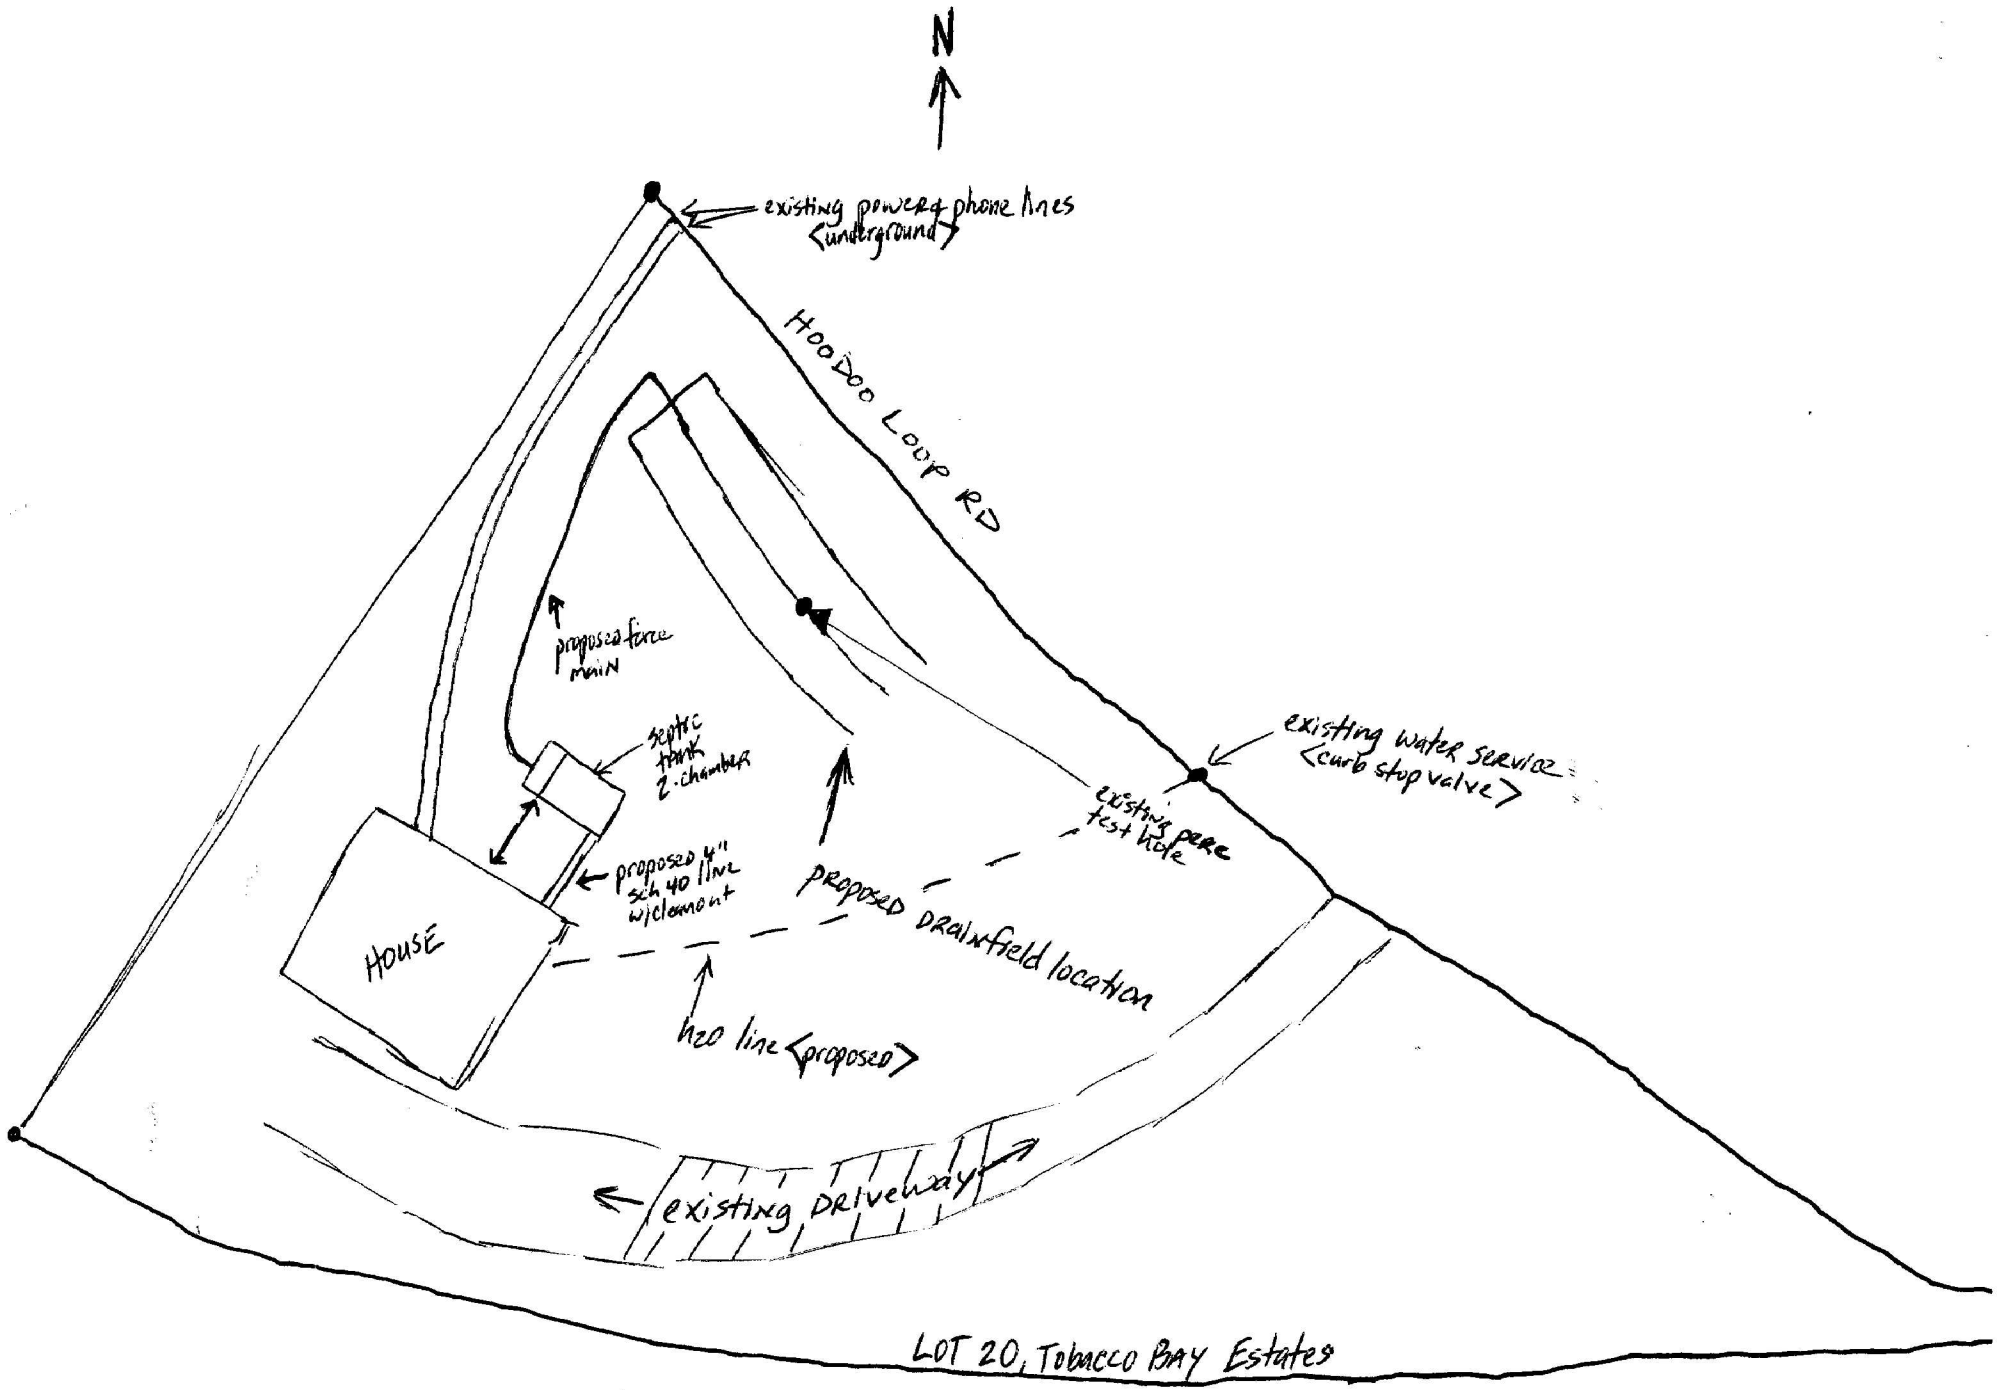
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
existing power & phone lines (underground)
HooDoo Loop RD
proposed force main
septic tank 2-chamber
existing water service (curb stop valve)
existing perc test hole
proposed 4" line sch 40 w/cleanout
proposed drainfield location
HOUSE
h2o line (proposed)
existing driveway
LOT 20, Tobacco Bay Estates

NOT TO SCALE