LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/06/2010 Expiration Date: 10/07/2011

Property Owner: Bonni Murry c/o:

Address: c/o Sarah Brown [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Owner License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe:

Parcel Description:

Legal: S17 T34 R25 Parcel A of Murry Family Transfer

Address or Location: 310 Rattlebone Road – Trego, MT

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 380 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality/ PCD


Local Reviewer — Date 9/13/10

Accepted under contract


DEQ Representative — Date 9/17/10

Name:Murry Family Transfer
County: Lincoln
Location:SW 1/4 sec.17-T34N-R25W
E.Q.# 11-1197

Legend
- perc test
- test hole
- proposed drainfield site
- proposed replacement area
- proposed well site w/ 100' isolation
- mixing zone

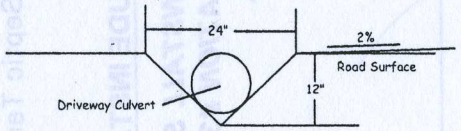

Roadside Swale Detail
to be installed along both sides of roadway
culverts to be installed as needed
ditch sides @ 1 to 1 slope
One lineal foot of swale contains 7.48 gallons of additional runoff

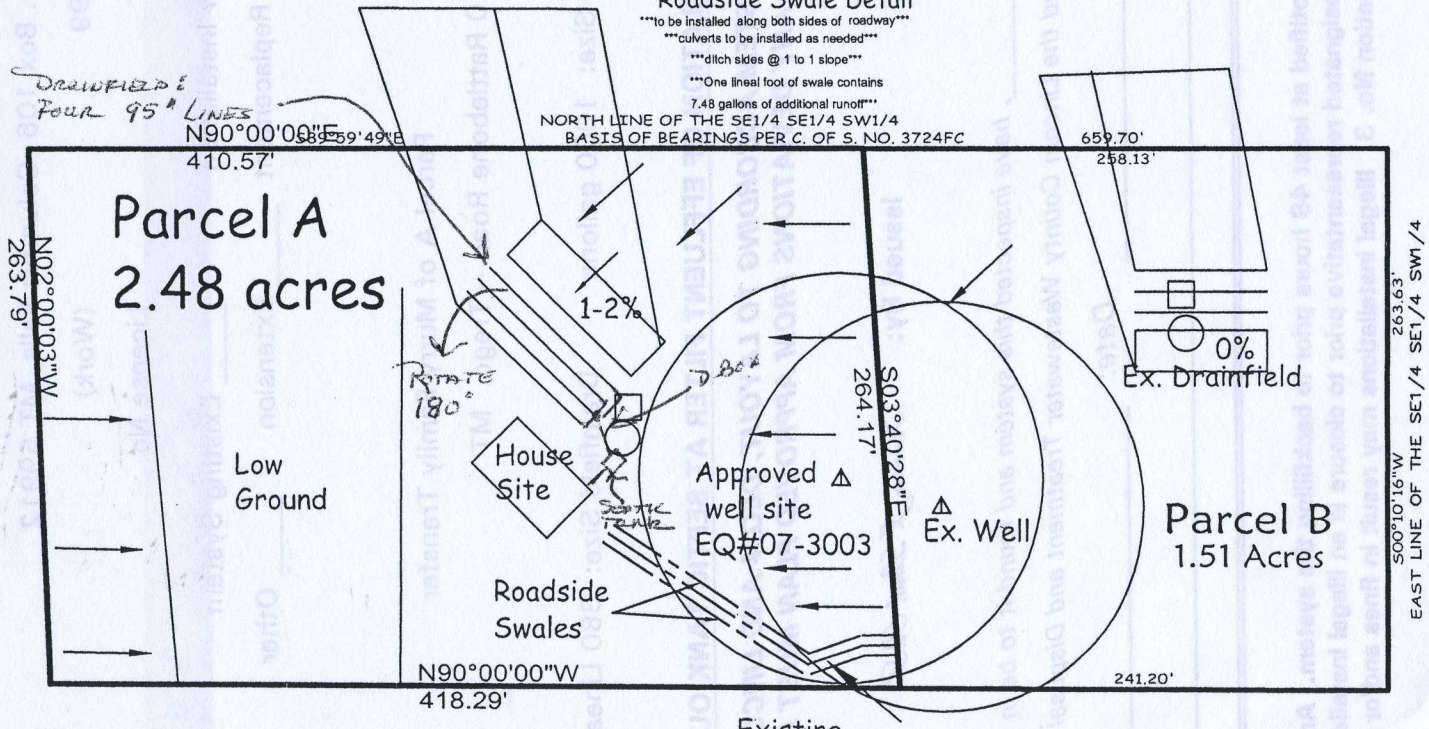

Existing Traveled Way/ Driveway w/ roadside swales to be installed

RECEIVED
SEP 14 2010
MT DEQ PUBLIC WATER & SUBDIVISION BUREAU

Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795

N

1"=100'