# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/31/04 Expiration Date: 09/01/05

Property Owner: David Powers c/o:

Address: 278 Dawn Drive Columbia Falls, MT 59912-8910

Telephone: (Home) 892-0456 (Work)

Installer: Mountain Contracting License No. 3

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe:

*Parcel Description*:

Legal: NW-1/4 S26 T36 R28

Address or Location: Lot 1 in Thirsty Point Mountain View Subdivision

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1500 gallons Drainfield Size: 300 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Kendra J. Lind, R.S.

Closure Statement:

I, Robin Blumberg, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Robin Blumberg *Date:* 2/10/26


*Title:* Reviewed From GPR + Pumping Data

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**


**406-293-7781**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

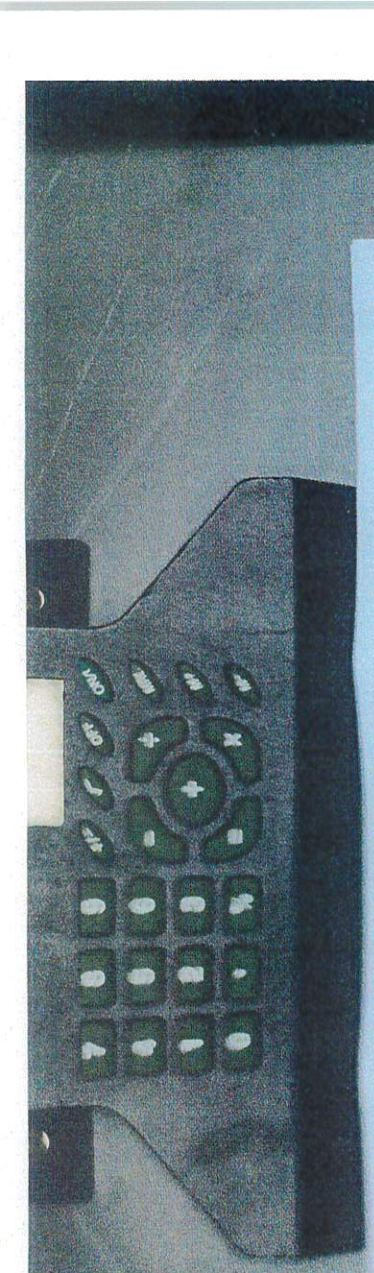

1735 Parkhaven Ct. Rd
Rockford IL.

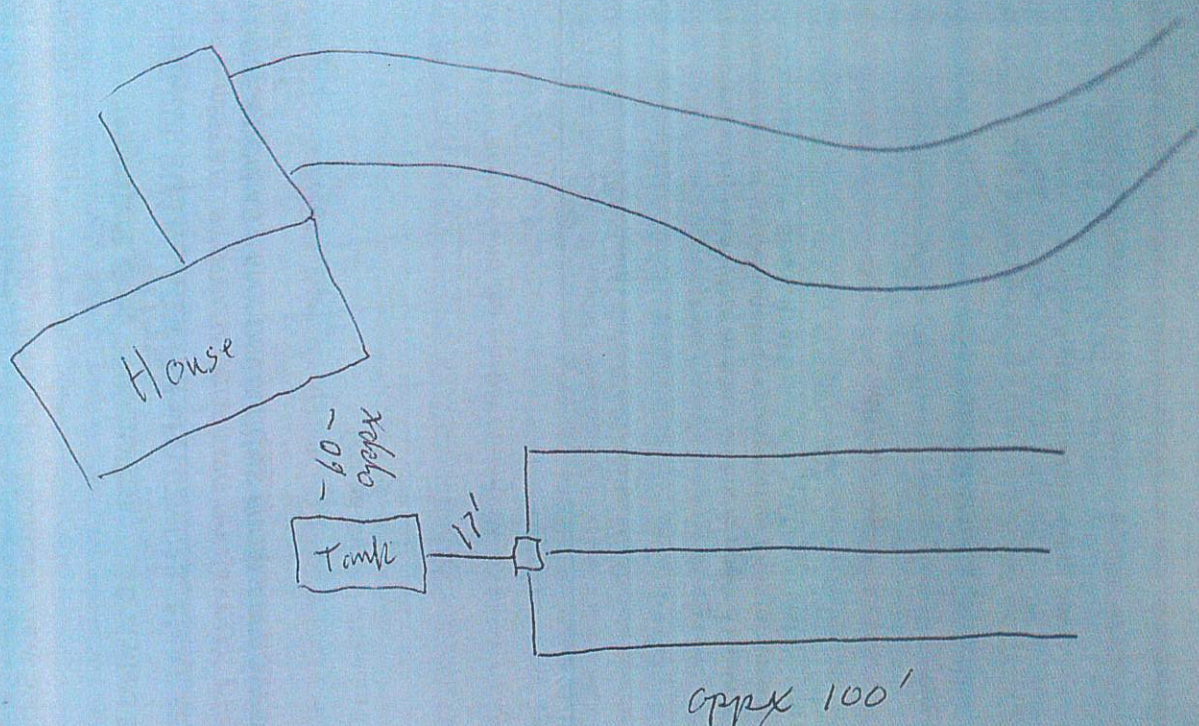


This is information from the GPR Scan, 2/6/26
These measurements are appx.
I have completed this to the best of my ability and best practices.

Matt Pitt Rocky Mountain Radon