LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/17/2025 Expiration Date: 03/16/2026 Permit# 25-8753

Property Owner: Courtney Seward

Mailing Address: [redacted]

Installer: Homeowner License #:

Approved Work: (Check One) ☐ New Installation ☐ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of replacement gravity system for 3 Bedroom House.

Legal: LUNDBERG, S02, T29 N, R31 W, LOT 2, ACRES 5, PM 5759

Property Address: 39265 US Hwy. 2 Libby, MT 59923 Assessment Code: 8753

DEQ COSA: EQ#97-1593 Date: 10/02/96

Approved Design Criteria: Installation of replacement gravity system for 3 Bedroom House with 2 Laterals @ 98'. Maximum trench width 24" Minimum distance between trenches 5' Trench Depth 24"-36".

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 98' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the Lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(if applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

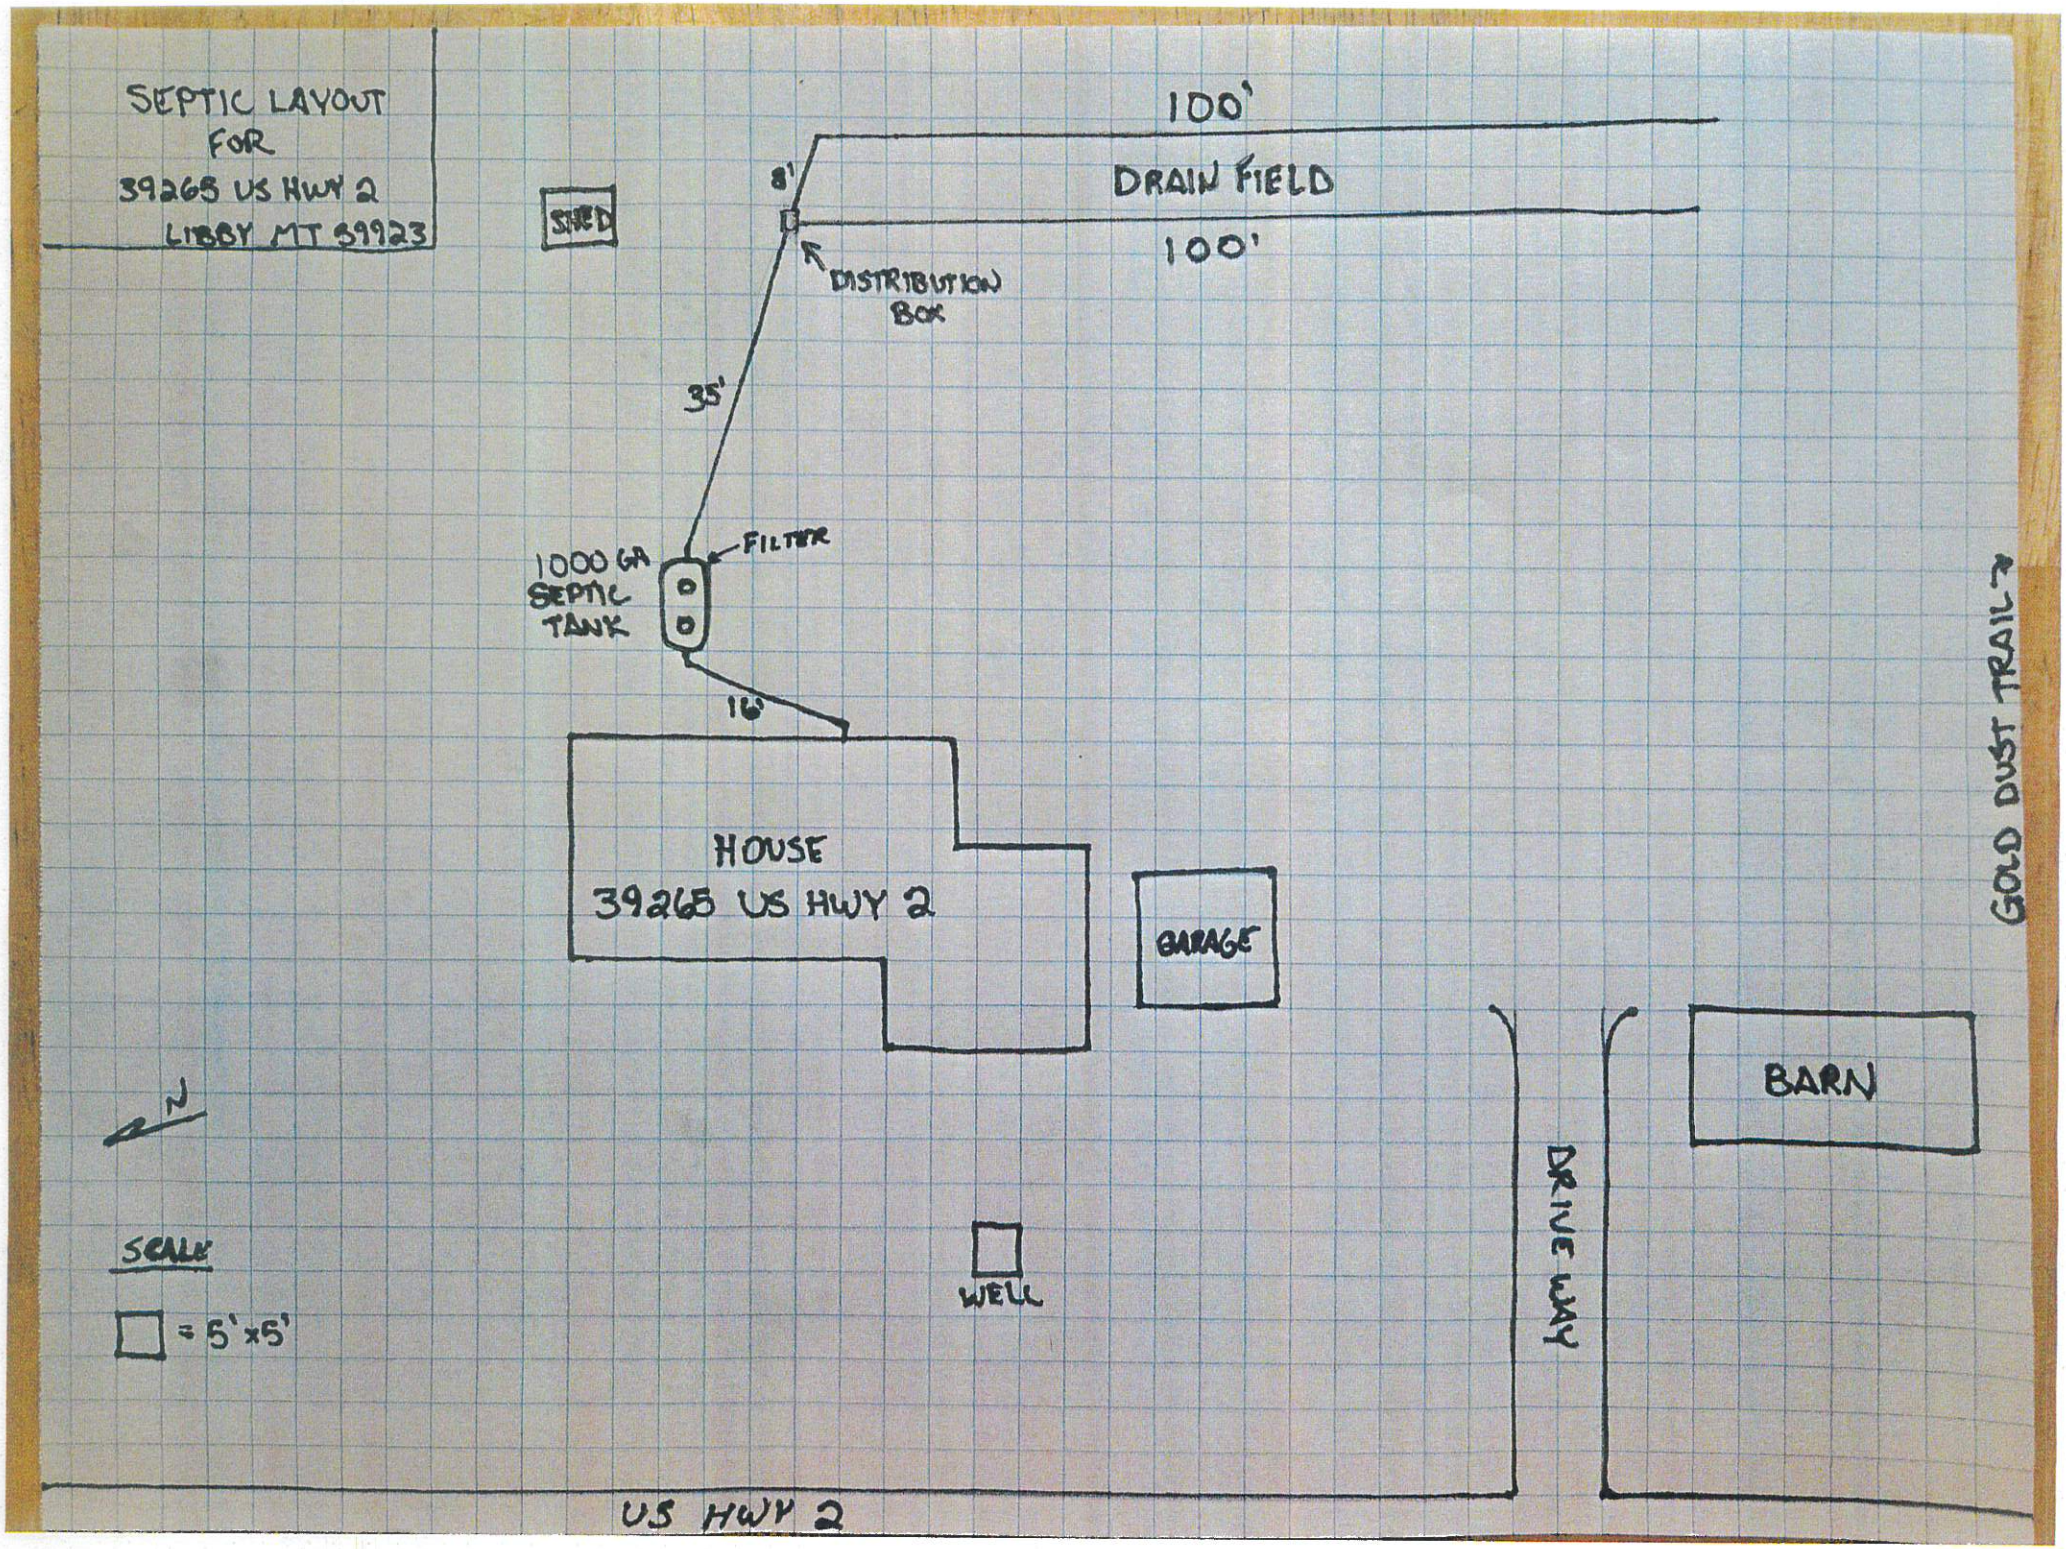
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg Date: 3/24/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


SEPTIC LAYOUT
FOR
39265 US HWY 2
LIBBY MT 59923
SHED
100'
8'
DRAIN FIELD
100'
DISTRIBUTION BOX
35'
1000 GA SEPTIC TANK
FILTER
16'
HOUSE
39265 US HWY 2
GARAGE
BARN
GOLD DUST TRAIL
DRIVE WAY
WELL
N
SCALE
= 5'x5'
US HWY 2