LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/10/2026 Expiration Date: 02/09/2027 Permit#26-18420

Property Owner: John Whetstone

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: SWEDE BLUFF ESTATES, S25, T30 N, R31 W, LOT 4, ACRES 7.078, PM 5822

Property Address: 130 Swede Gulch Dr. Libby, MT 59923 Assessment Code: 18420

DEQ COSA: E.Q.#27-95-L3-49 Swede Bluff Estates Date: 01/10/95

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with 3 Laterals @ 95'.

# of Bedrooms: 3 Septic Tank Size: 1000 Trench Width: 24"

# of Laterals: 3 Length of Laterals: 95' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

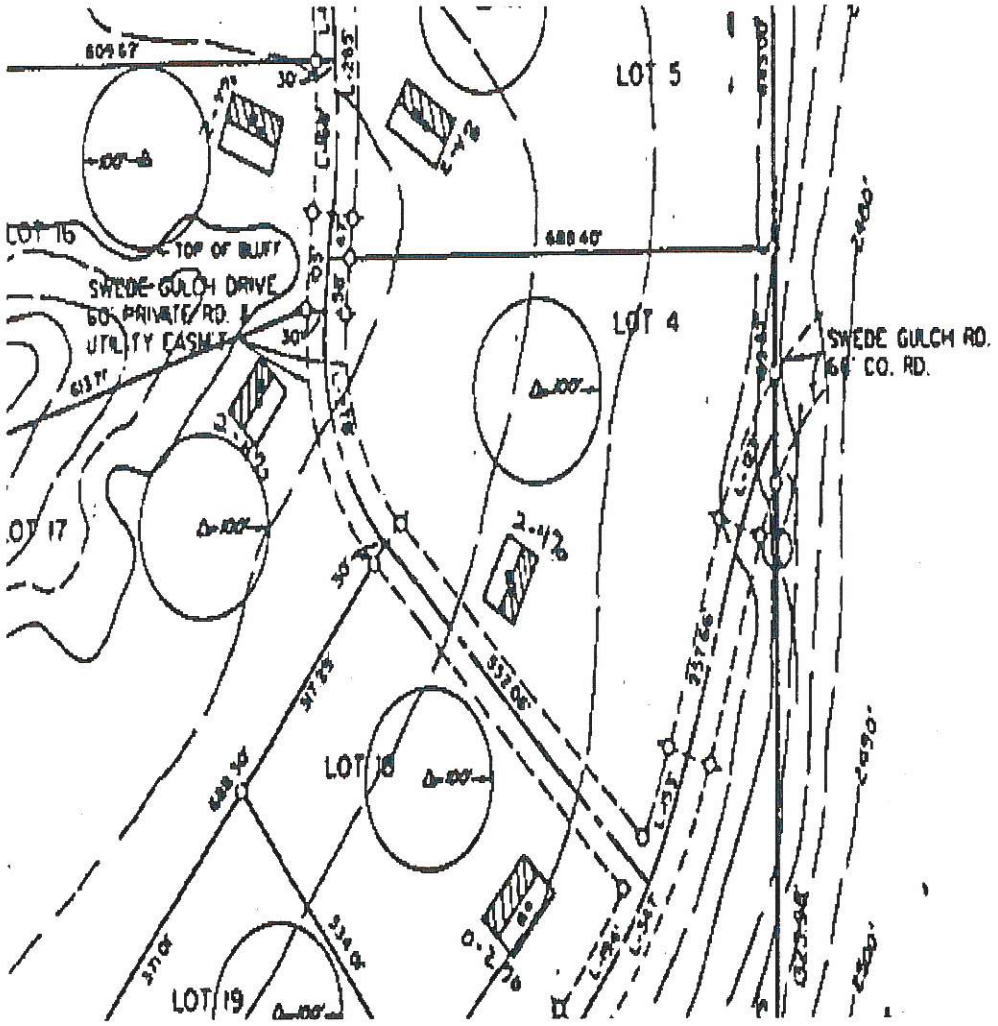
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


LOT 5
LOT 4
LOT 16
LOT 17
LOT 18
LOT 19
SWEDE GULCH DRIVE
60' PRIVATE RD. &
UTILITY EASMT.
TOP OF BLUFF
SWEDE GULCH RD.
60' CO. RD.