LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/06/2011 Expiration Date: 04/07/2012

Property Owner: Dan Williams c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Bill Merritt License No. 76

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing system for greenhouse complex office. Using gravelless chambers – 25% sizing reduction allowed per "Drainfield Size" below.

Parcel Description:

Legal: NW-1/4 S12 T31 R34 Parcel 1A of COS 3704

Address or Location: 51 Valley of the Moon Road

Approved Design Criteria:

Max. Flows: 225 GPD Septic Tank Size: 1000 gallons Drainfield Size: 112 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____


Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

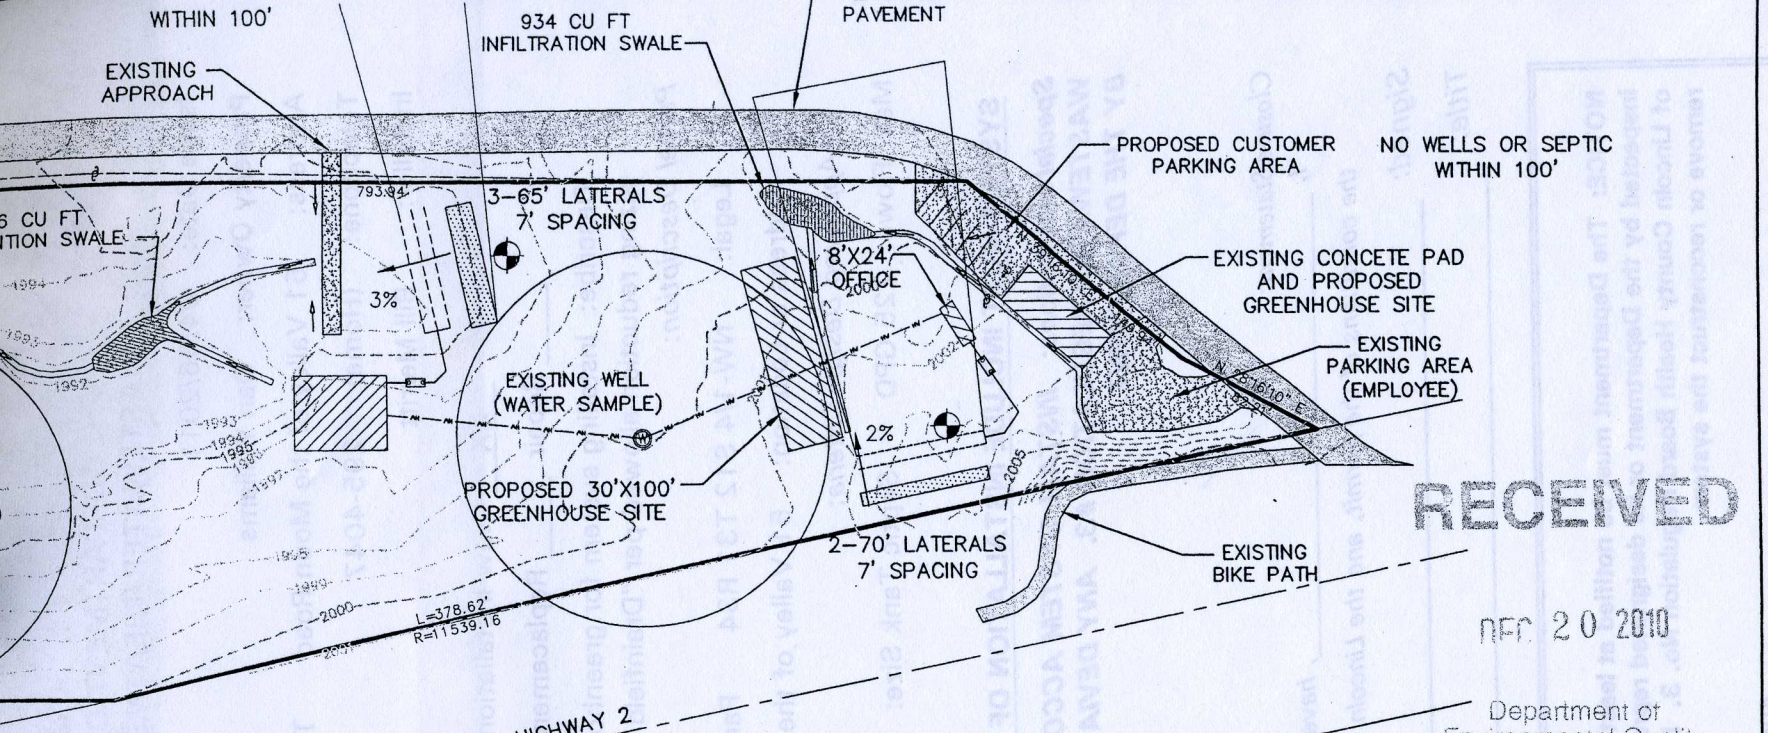


RECEIVED

DEC 20 2010

Department of
Environmental Quality
Kalispell Regional Office

EQ 11-1430
APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
Reviewer 12-21-10
Date

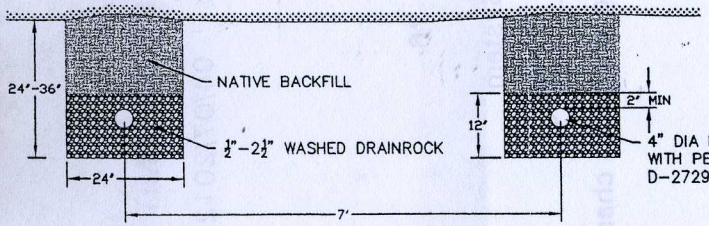

SUBSURFACE DRAINFIELD TRENCH

NO SCALE

LEGEND

- P- BUILDING SITE
- P- WELL
- P- SEPTIC TANK
- P- DRAINFIELD AND REPLACEMENT SITE
- P- MIXING ZONE
- P- LOT BOUNDARY
- E- ASPHALT PAVEMENT
- P- DRIVEWAY/PARKING LIMITS
- SOILS PROFILE LOCATION
- GROUNDWATER FLOW DIRECTION
- P- STORM RETENTION SWALE
- E- OVERHEAD POWER LINE

SEAL

SUBCONSULTANT

PARCEL 1A COS 3704
LOT LAYOUT
SECTION 12, T 31N., R 34W., P.M.MT.

DRAWING SET DATE
ISSUES\REVISIONS 1 = ISSUE △= REVISION

No.	Date	Purpose	By	Check
△	12/20/2010	JBM		

PROJECT NUMBER
SHEET TITLE
FILE No.
BOOK | PAGE
DRAWN BY: B. McCULLY

SHEET No. OF 1