**LINCOLN COUNTY**
**DEPARTMENT OF ENVIRONMENTAL HEALTH**
**WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT**

Issue Date: 09/02/2010 Expiration Date: 09/03/2011

Property Owner: Marty & Roberta Becker c/o: Linda Garrison

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Linda Garrison License No. 114

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Sand-llined trenches (bottoms and sidewalls) are required. Using gravelless chambers – sizing reduction allowed per "Drainfield Sizing" below.

*Parcel Description*:

Legal: S31 T36 R31

Address or Location: Lot 29 in Block 2 of Yaak Meadows

*Approved Design Criteria*:

# Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 112 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SAND-LINED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** *Kendra J. Lind, R.S.*

*Closure Statement:*

*I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* _____ *Date:* _____

*Title:* _____

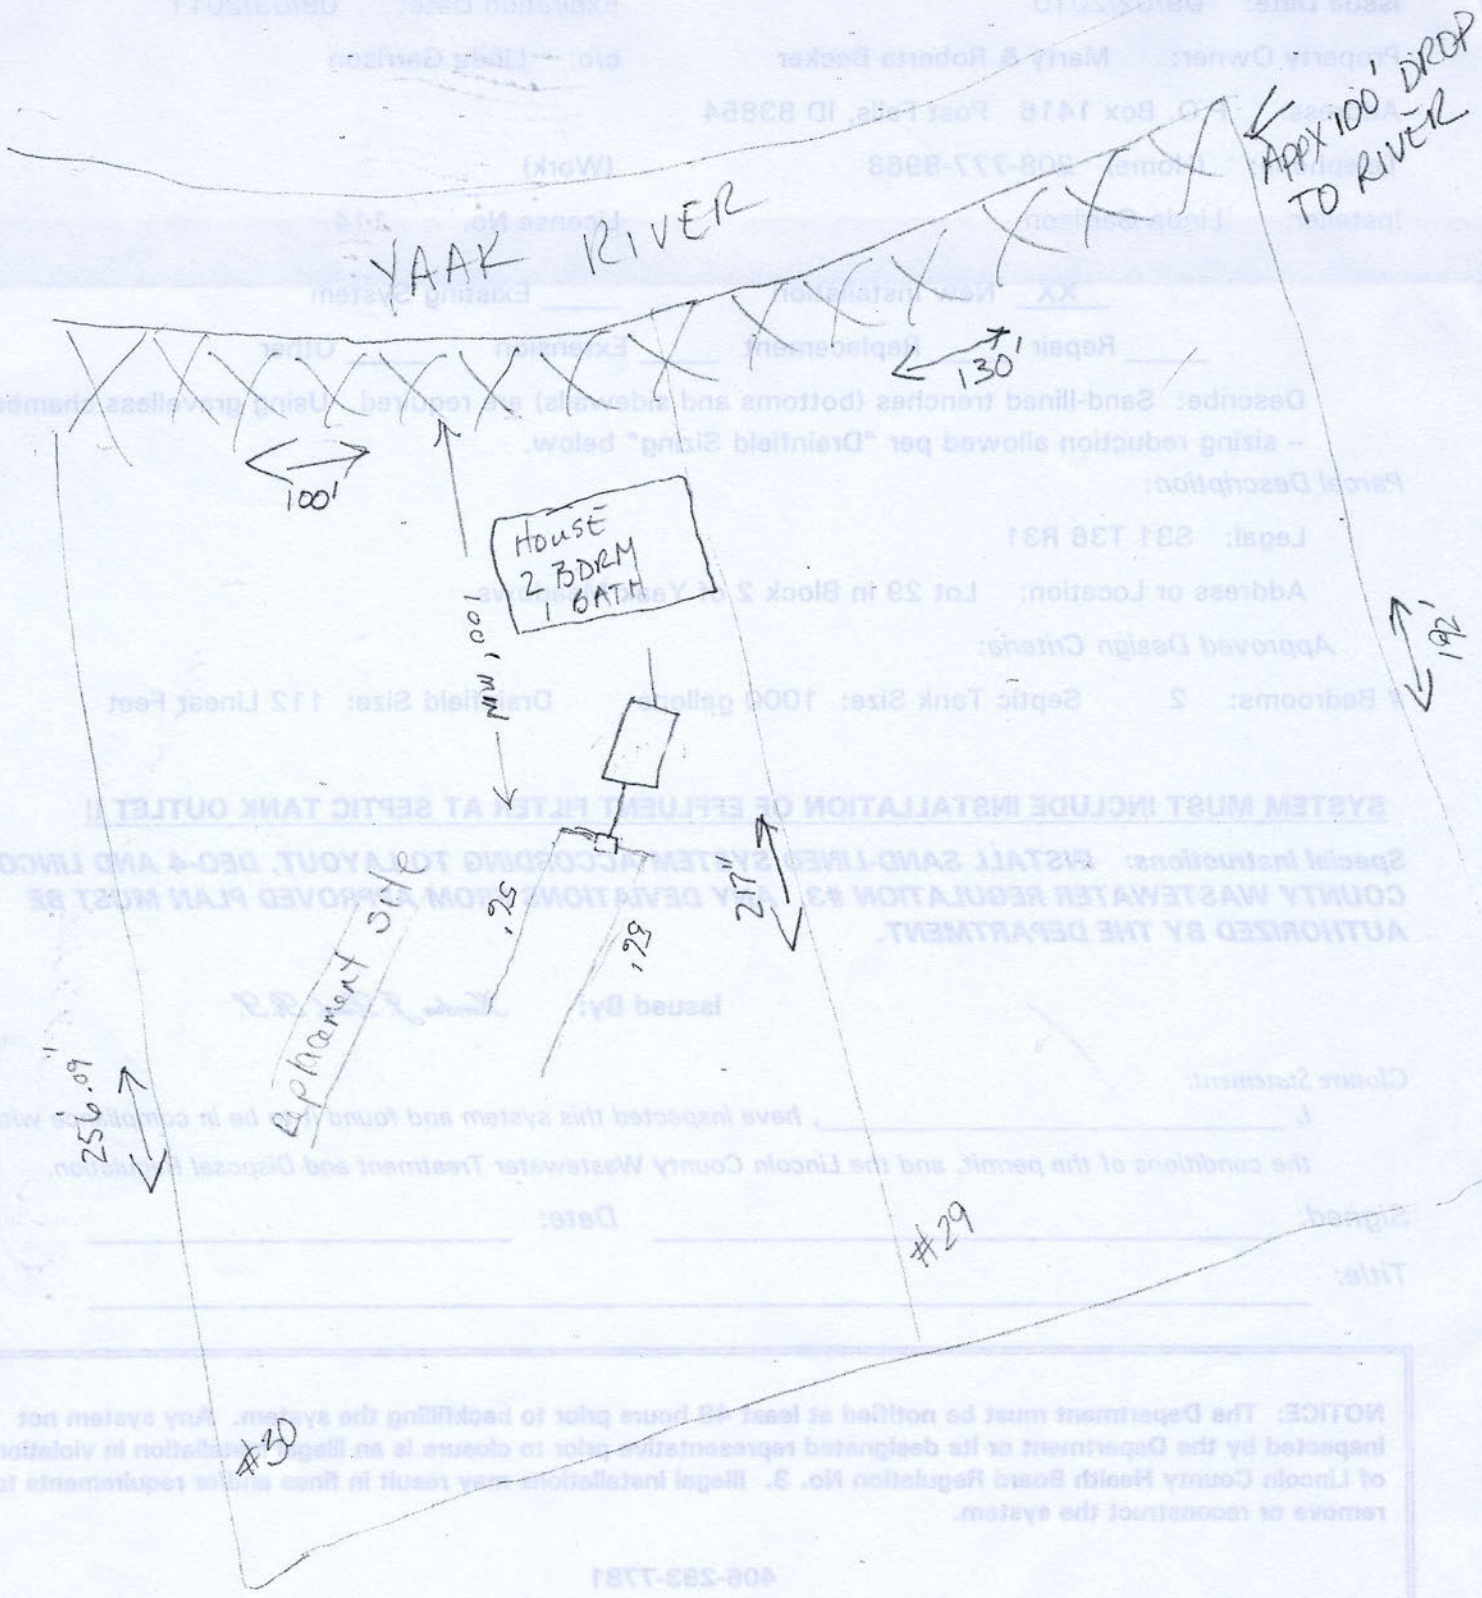
**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-293-7781**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

# LOT LAYOUT


YAAK RIVER
APPX 100' DROP TO RIVER
130'
100'
HOUSE
2 BDRM
1 BATH
100' NW
197'
217'
,25
,29
Replacement Site
256.09'
#29
#30