LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/01/2010 Expiration Date: 10/02/2011

Property Owner: Clark Family Trust c/o: Bill Swope – Columbia Falls, MT

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: License No.

____ New Installation XX Existing System

____ Repair XX Replacement ____ Extension ____ Other

Describe: Permit to replace cabin's old existing system of unknown size and construction.

Parcel Description:

Legal: S30 T27 R27 Lot 13 of Crystal Lake Shore Lots – Plat 499

Address or Location: 588 Lakeshore Drive

Approved Design Criteria:

Bedrooms: 1 Septic Tank Size: 1000 gallons Drainfield Size: 2-Ring Drywell System

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

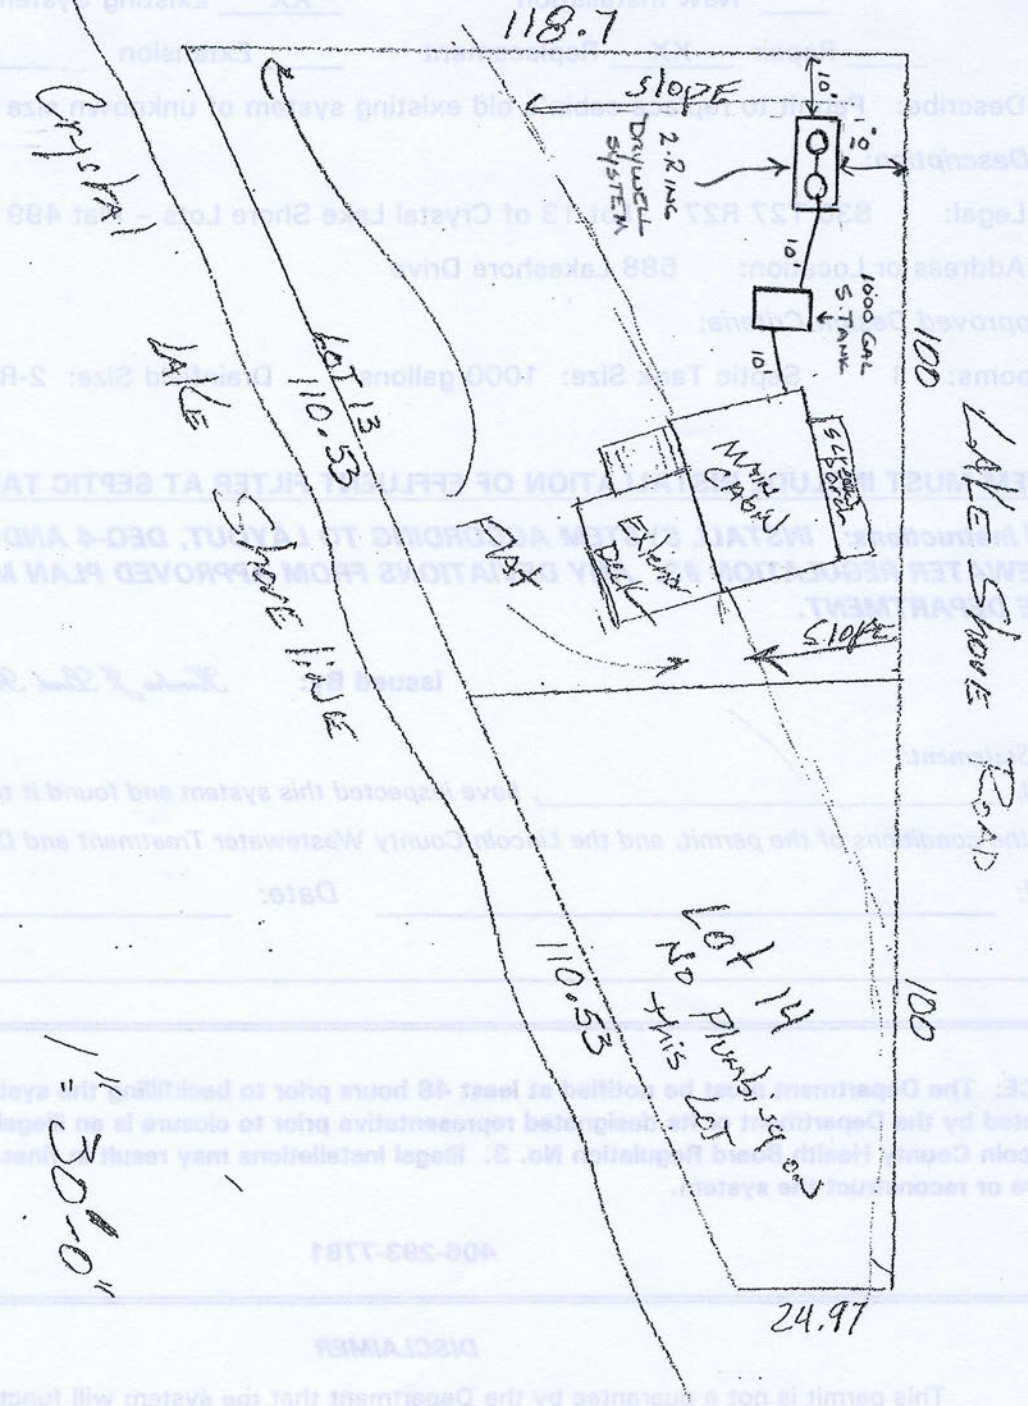
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


118.7
SLOPE
10'
10'
2.2 INC
Drywell
SYSTEM
10'
1000 GAL
S.TANK
10'
100
LAKE SHORE ROAD
SLABBOARD
MAIN CABIN
EXTENDED DECK
SLOPE
FLAT
LOT 13
110.53
LAKE
SHORE LINE
Crystal
110.53
LOT 14
NO PLUMBING
THIS LOT
100
24.97
1" = 30'-0"