LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/04/2010 Expiration Date: 03/05/2011

Property Owner: Gene & Lorraine Decker c/o:

Address: [redacted]

Telephone: [redacted] (Work)

Installer: DC Orr License No. 17

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers for installation -- sizing reduction allowed per "Drainfield Size" shown below. Drainfield configuration of six 36-foot long by 2-foot wide trenches off a center manifold.

Parcel Description:

Legal: S25 T30 R31

Address or Location: 138 Avondale Road – Trailer Space #5

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 216 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

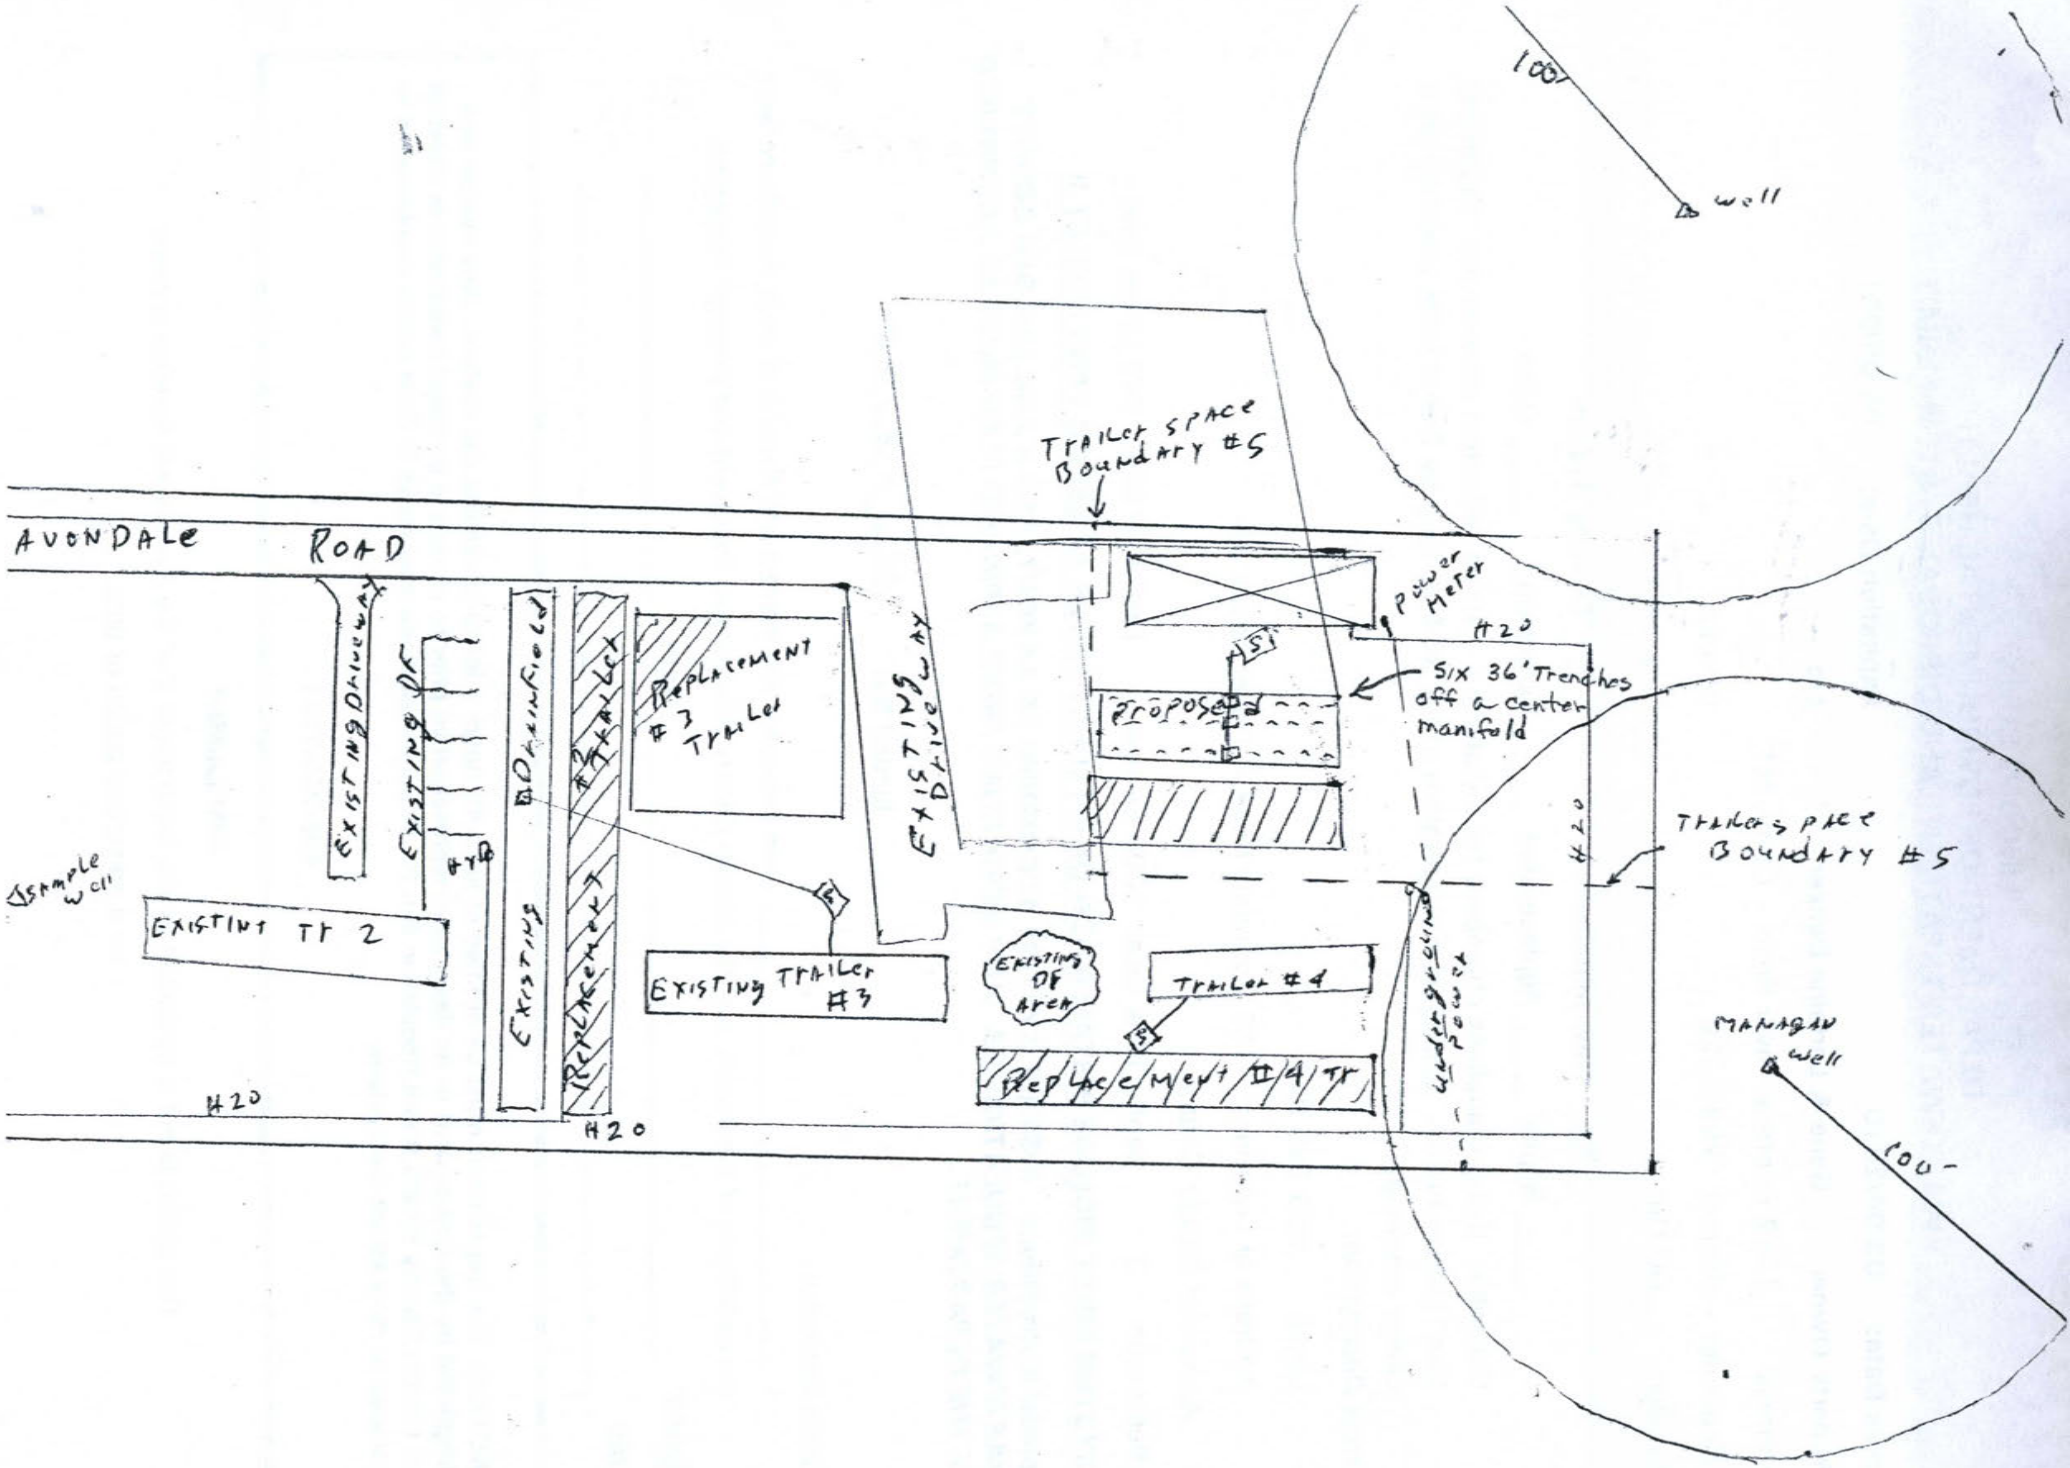
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


100'
well
TRAILER SPACE BOUNDARY #5
AVONDALE ROAD
EXISTING DRIVEWAY
POWER METER
#20
SI
PROPOSED
SIX 36' Trenches off a center manifold
EXISTING DRIVEWAY
EXISTING DRIVEWAY
REPLACEMENT DRIVEWAY
REPLACEMENT TRAILER #3
TRAILER SPACE BOUNDARY #5
SAMPLE WELL
EXISTING TR 2
EXISTING TRAILER #3
EXISTING OF AREA
TRAILER #4
REPLACEMENT #4 TR
#20
#20
#20
MANAGER WELL
100'