LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/08/2010 Expiration Date: 06/09/2011

Property Owner: Jason & Kerri Fahland c/o: Linda Garrison

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Linda Garrison License No. 114

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Re-issue of 7/13/09 Baisden & Baisden Holdings Permit. Using gravelless chambers – 2% sizing reduction allowed per "Drainfield Size" below.

Parcel Description:

Legal: S2 T35 R32 SE-1/4 S17 T33 R34 Parcel B of Court Split—Lot 1 of Flamingo Sub.

Address or Location: 28933 Yaak River Road

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 152 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT LAYOUT

JASON & KERRI FAHLAND

S2T35R32

PARCEL B OF COURT ORDER DIVISION

OF LOT 1 – FLAMINGO SUBDIVISION

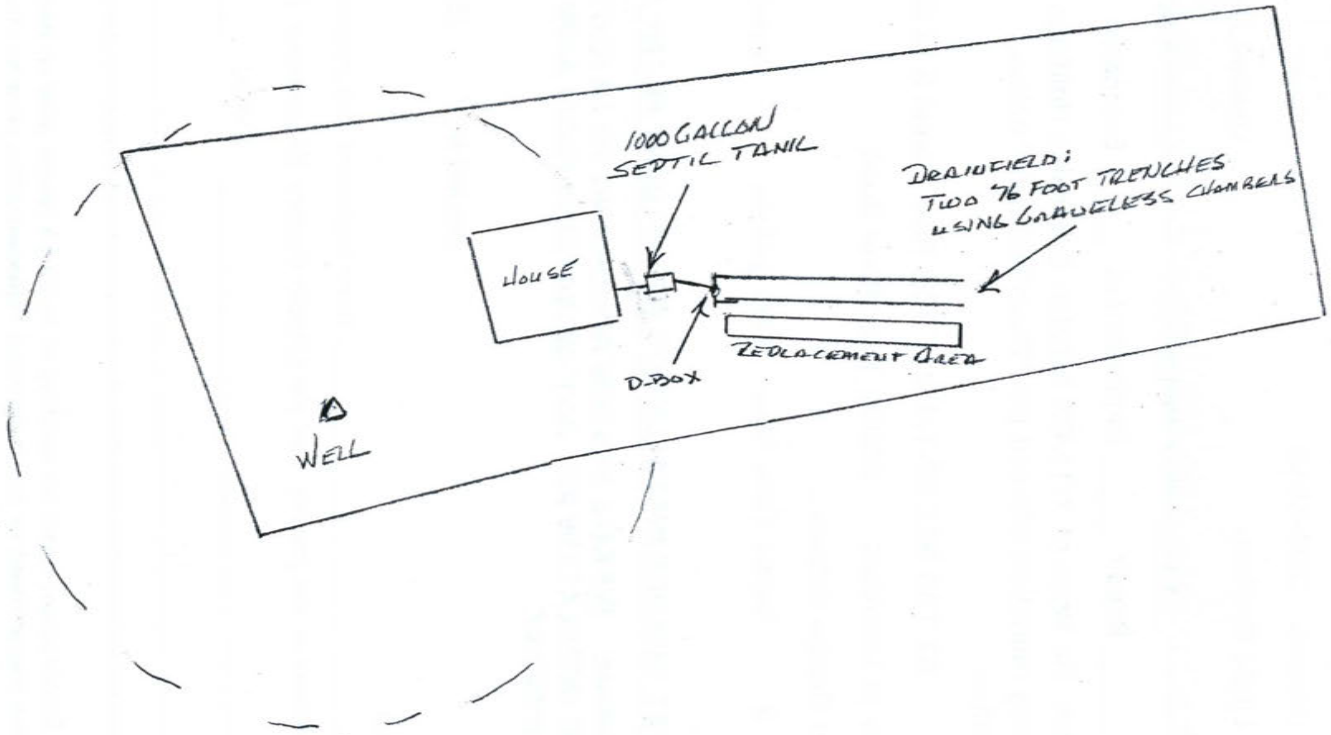

SCALE: 1" = 60'