LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/10/2010 Expiration Date: 09/11/2011

Property Owner: Daryl Frank c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating, Inc. License No. 135

___ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Upgrading system – installing new with pressure dosing.

Parcel Description:

Legal: SE-1/4 NW-1/4 S27 T36 R26

Address or Location: T300 Glen Lake Drive

Approved Design Criteria:

Bedrooms: 5 Septic Tank Size: 1500 gallons Drainfield Size: 384 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____


Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

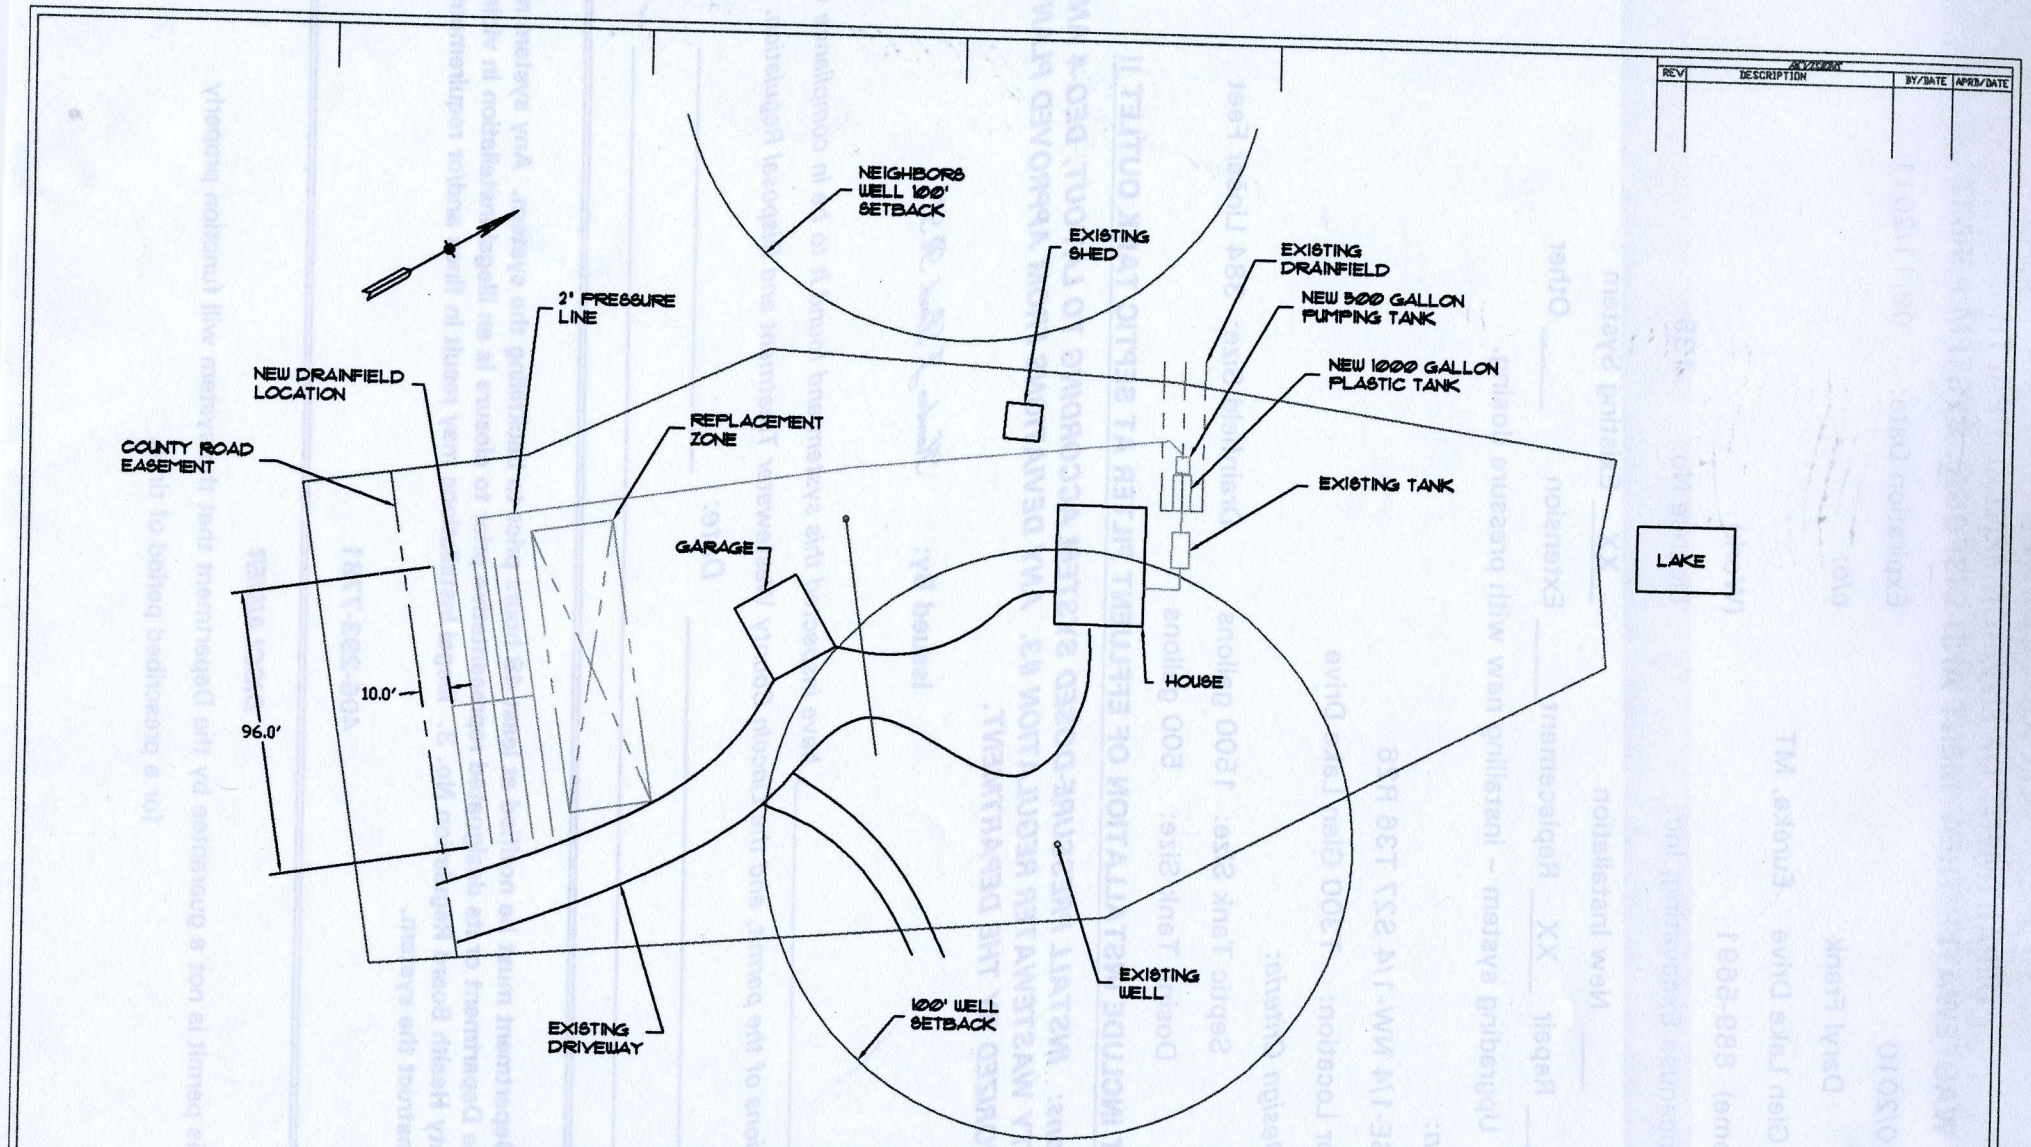

FRANK SEPTIC SYSTEM LAYOUT

REV	DESCRIPTION	BY/DATE	APRB/DATE

REV	DATE	COMPANY	SCALE:
		KEI	1/16 & NOTED
		CONTRACT	DATE
		VERBAL	4-05-10
		PLOT FILE	WEIGHT
		PML-8001	

KOOCANUSA EXCAVATING
FRANK PROJECT
SEPTIC LAYOUT
DATE: 5/29/10
DRAWN: L. Frank
DATE: 5/20/10
JOB NO: 04010-001
SHEET: 1