LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/28/2010 Expiration Date: 05/29/2011

Property Owner: Mike & Rita Gillan c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Tally Hoe License No. 1

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers – sizing reduction allowed per "Drainfield Size" below.

Parcel Description:

Legal: S 17 T30 R29

Address or Location: 293 RFD #228

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

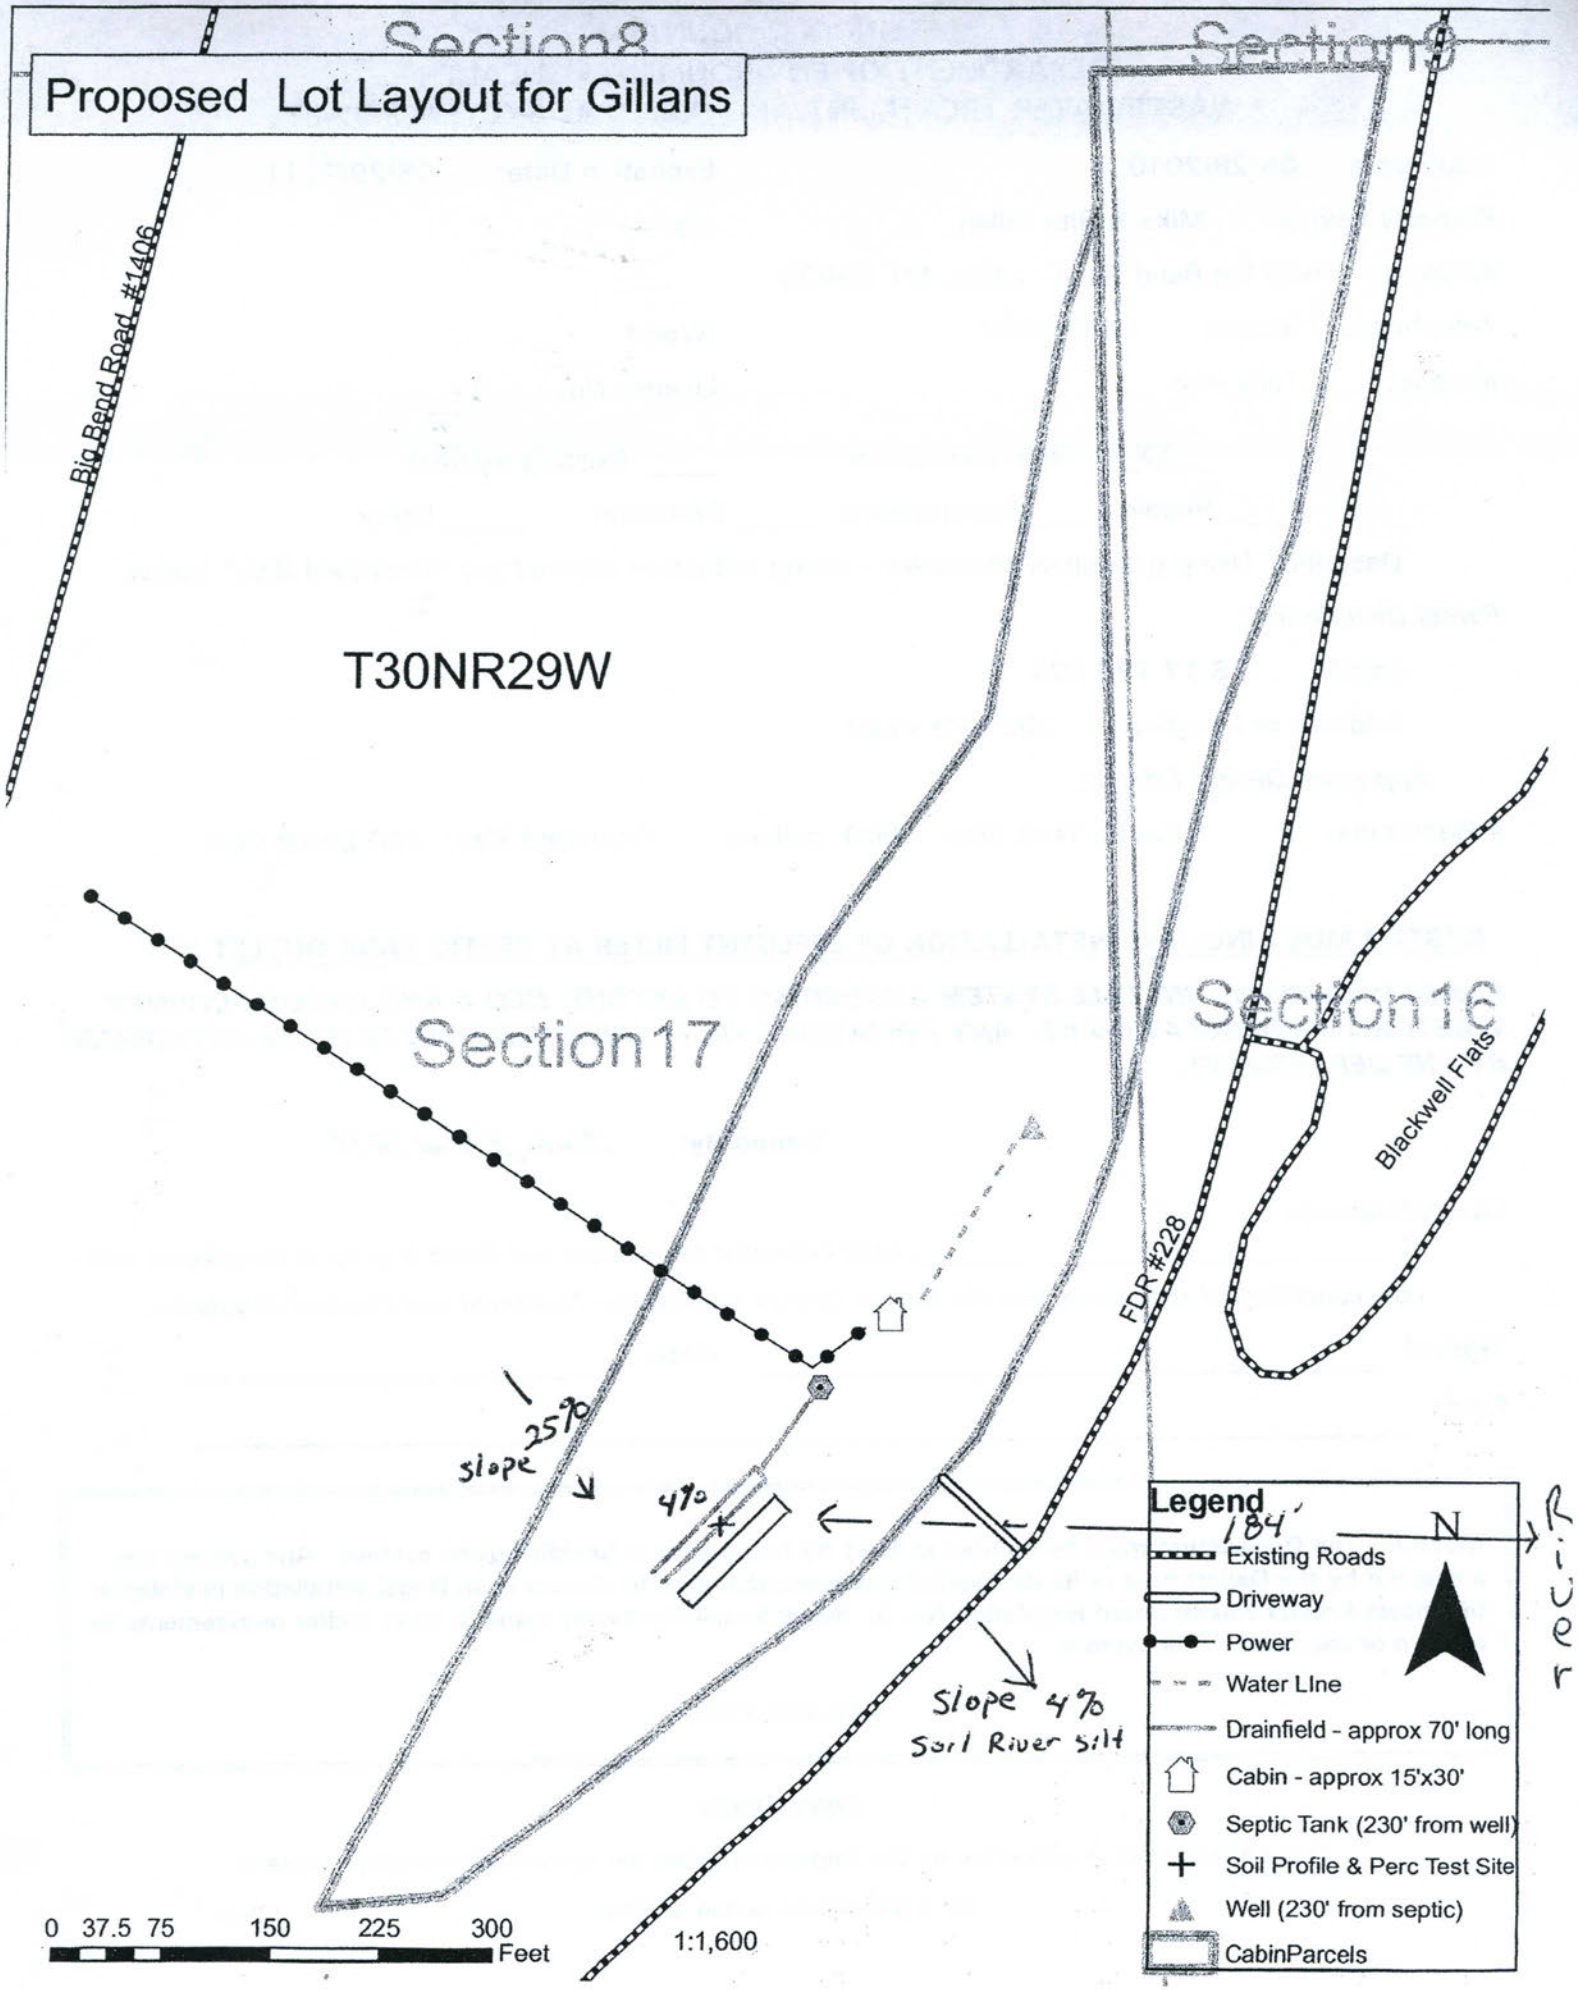
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Proposed Lot Layout for Gillans
Section8
Section9
Big Bend Road #1406
T30NR29W
Section17
Section16
Blackwell Flats
FDR #228
slope 25%
4%
184'
N
River
Slope 4%
Soil River Silt
Legend
Existing Roads
Driveway
Power
Water LIne
Drainfield - approx 70' long
Cabin - approx 15'x30'
Septic Tank (230' from well)
Soil Profile & Perc Test Site
Well (230' from septic)
CabinParcels
0 37.5 75 150 225 300
Feet
1:1,600