LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/08/2010 Expiration Date: 06/09/2011

Property Owner: Ron Hart c/o: A-1 Outback Construction

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Charley Follensbee License No. 96

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: System installation for one (1) Cabana with an incorporated connection for hookup of a ***single*** RV unit. The cabana will be constructed to include a minimum of a bathroom, kitchenette, laundry and living/dining area. Wastewater flows to the system are not to exceed 350 gallons per day (4-bedroom residential equivalency). Holding tank(s) of the RV unit to be connected must be emptied at an approved dump station prior to connection to the wastewater system.

Parcel Description:

Legal: NW-1/4 S14 T37 R27

Address or Location: Lot 11 East of Airpark Village

Approved Design Criteria:

Max. Flows: 350 GPD Septic Tank Size: 1500 gallons Drainfield Size: 300 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

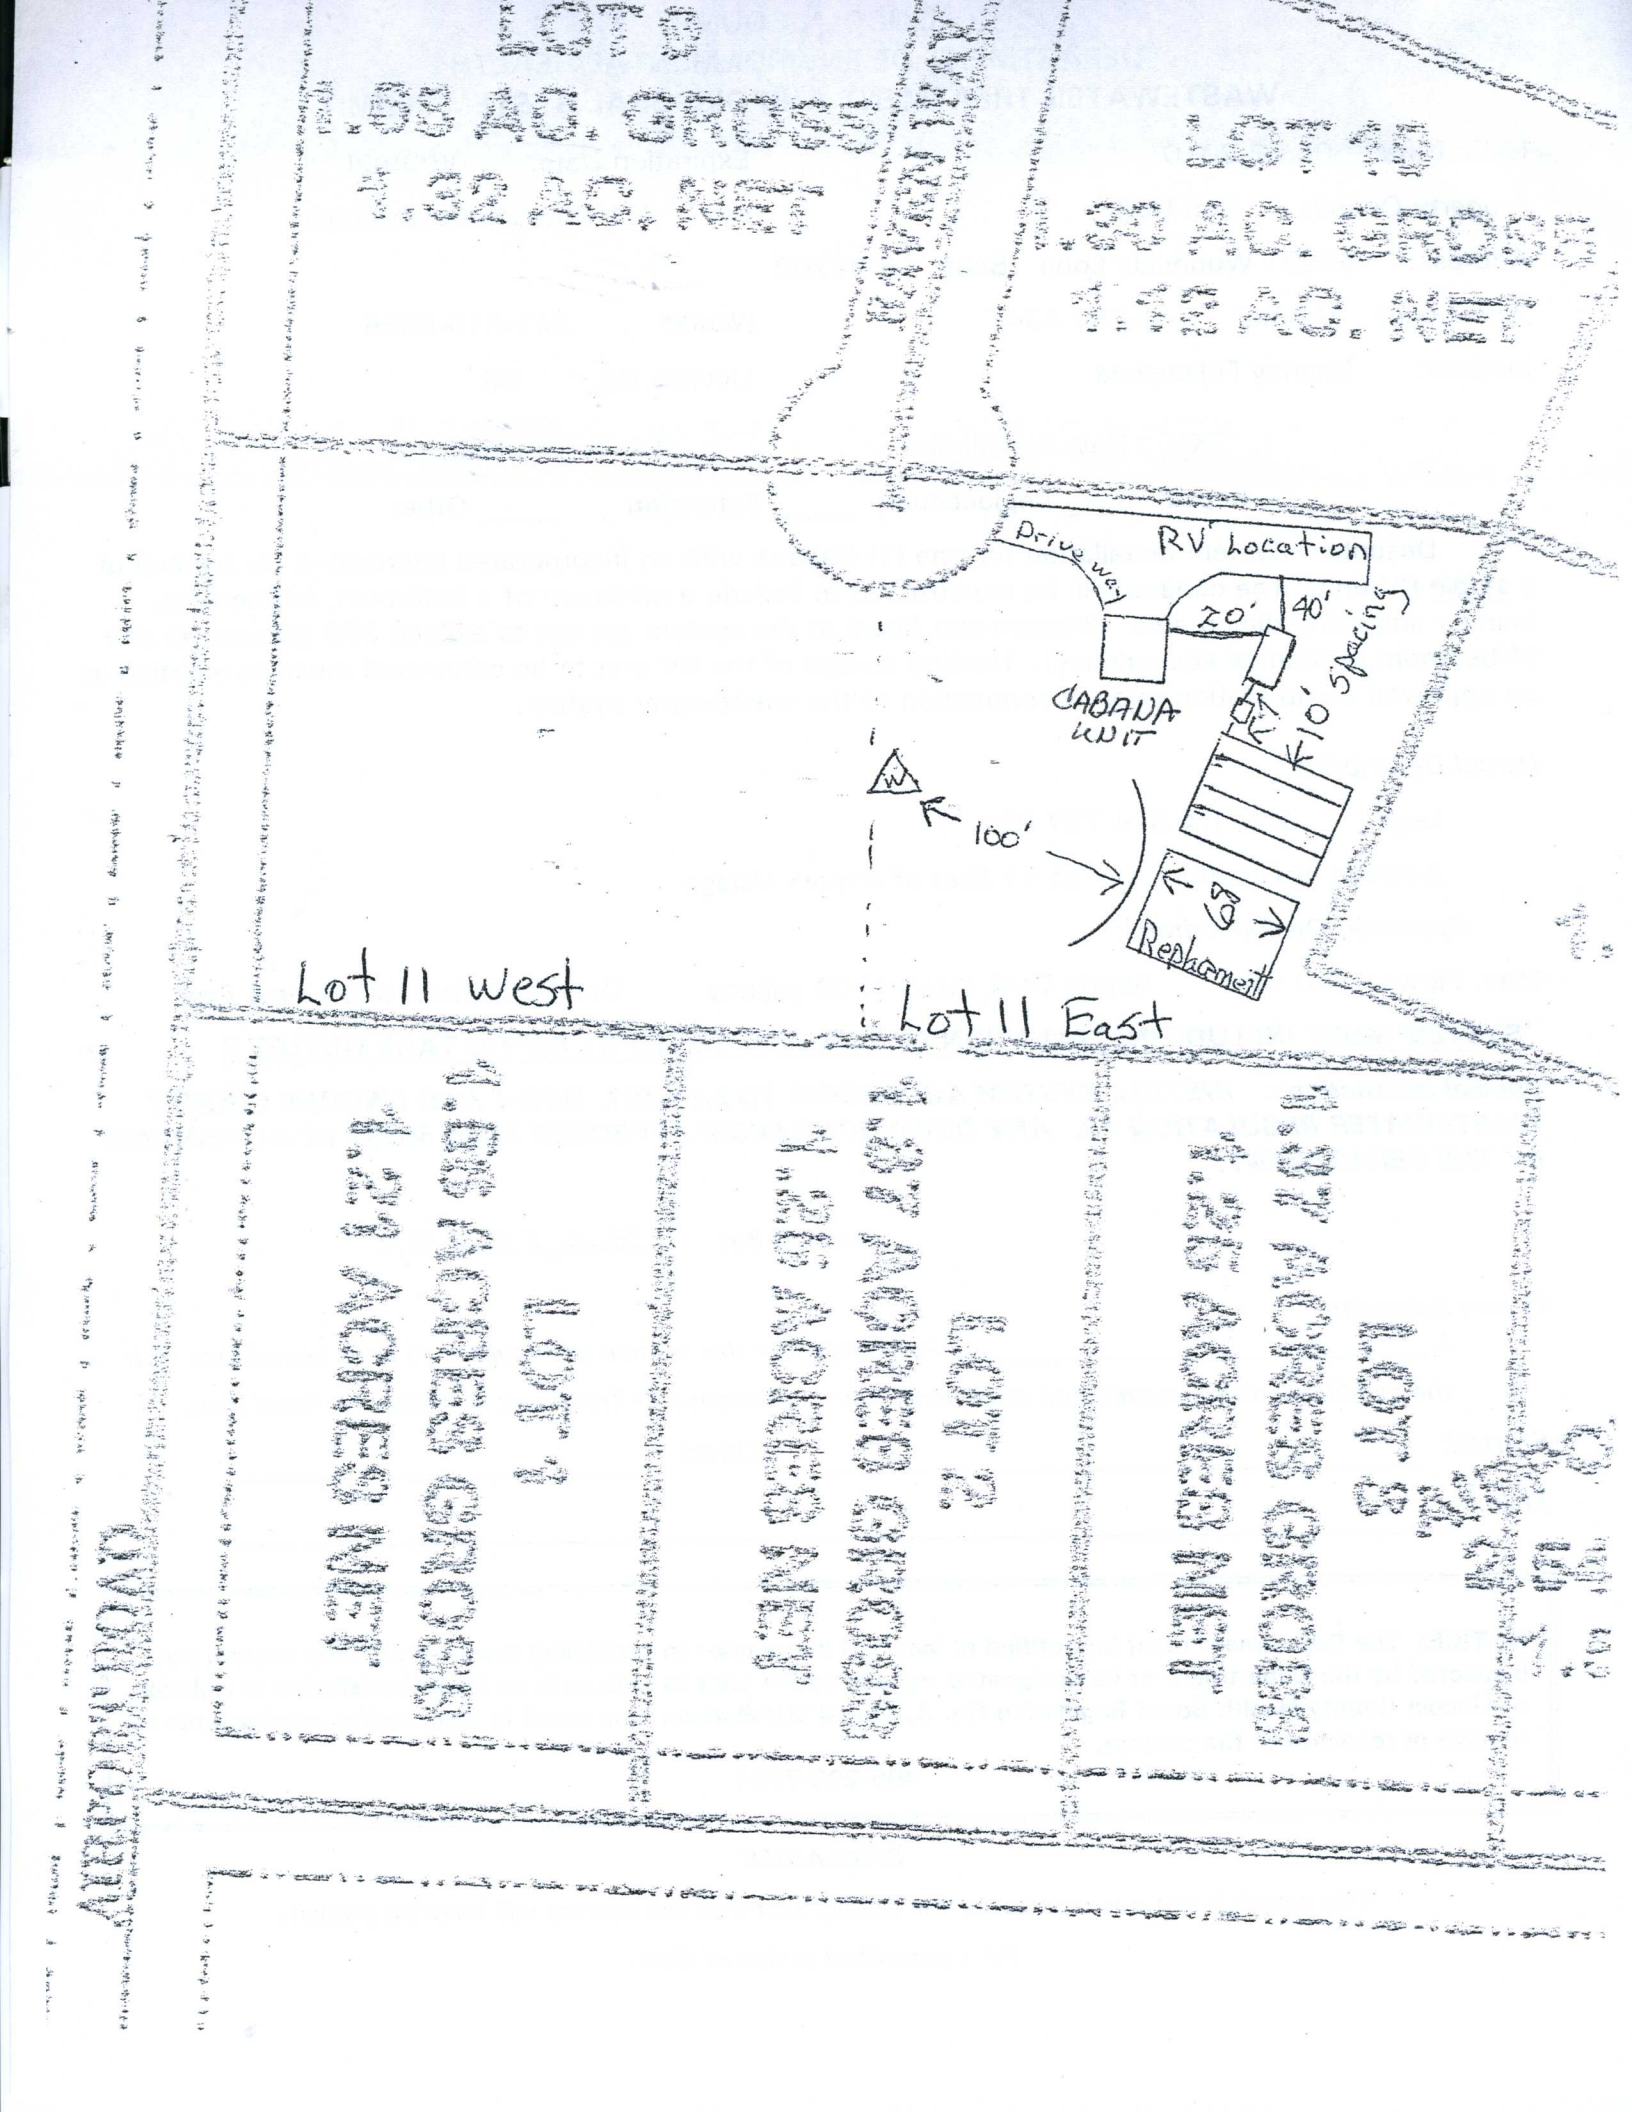
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT 9
1.89 AC. GROSS
1.32 AC. NET
LOT 10
1.92 AC. GROSS
1.12 AC. NET
Drive way
RV location
20'
40'
10' spacing
CABANA with
100'
60'
Replacement
Lot 11 west
Lot 11 East
ARROYO DRIVE
LOT 7
1.89 AC. GROSS
1.32 AC. NET
LOT 8
1.92 AC. GROSS
1.12 AC. NET
LOT 6
1.89 AC. GROSS
1.32 AC. NET
LOT 5
1.92 AC. GROSS
1.12 AC. NET