LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/20/2026 Expiration Date: 03/19/2027 Permit# 26-52528

Property Owner: Donald Hill

Mailing Address: [redacted]

Installer: Kyle McNew License #: 199

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Legal: WHITETAIL TERRACE, S05, T29 N, R33 W, LOT 1C, ACRES 20, PM 6608

Property Address: 718 Big Timber Ln., Troy, MT 59935 Assessment Code: 52528

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 2 Laterals @ 70' with reduction for chambers. **This permit is not a Floodplain Determination.**

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Depth: 24"-36"

# of Laterals: 2 Length of Laterals: 70' Trench Width: 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

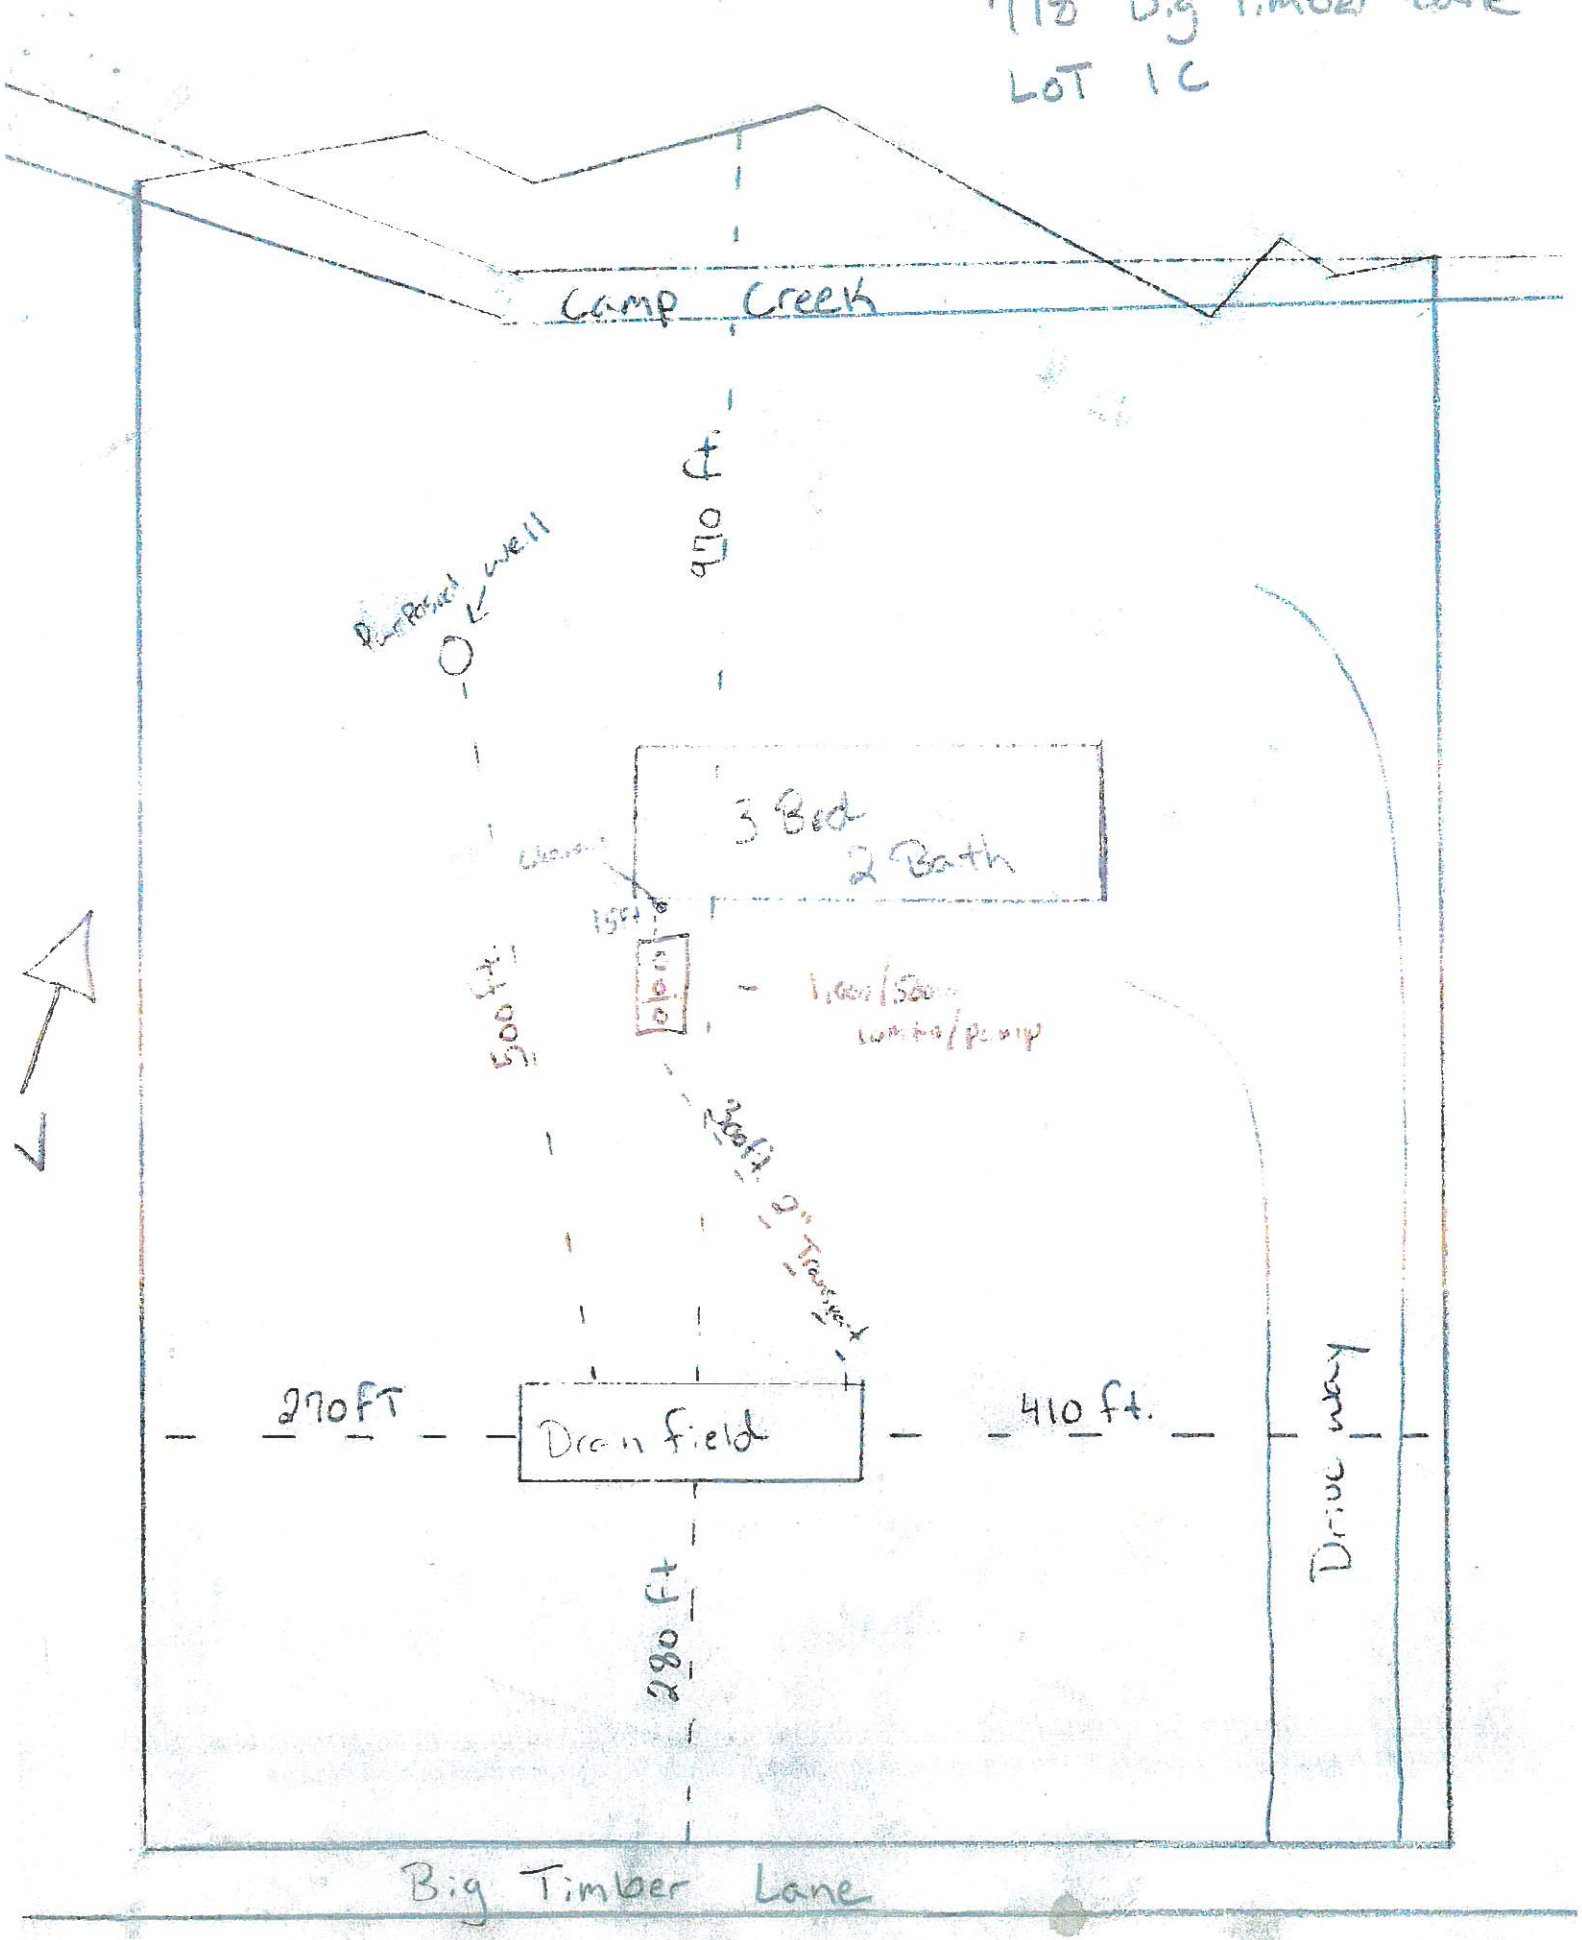
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

LOT 1C


Camp Creek
470 ft
Property Road
well
3 Bed
2 Bath
Cleanout
15ft
10ft
1,000 gal
Tank/Septic
Pump
Trench
270FT
Drain field
410 ft.
Drive way
280 ft
Big Timber Lane