LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/07/2010 Expiration Date: 04/08/2011

Property Owner: Jeff & Donna Hoan c/o: James M. Sowell (Buyer)

Address: [redacted]

Telephone: [redacted] (Work)

Installer: ~~Gideon Yutzy~~ Kootenai Sand & Gravel License No. 109

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing system for second residence on property. Using gravelless chambers. Four 96-foot trenches with 24 2' x 4' chambers per trench required for 3-bedroom residence.

Parcel Description:

Legal: NW-1/4 NE-1/4 S15 T37 R28 Parcel A of Amended Lot 1 of Renkema Subdivision

Address or Location: 7580 West Kootenai Road

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 384 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 6/4/10

Title: Pres

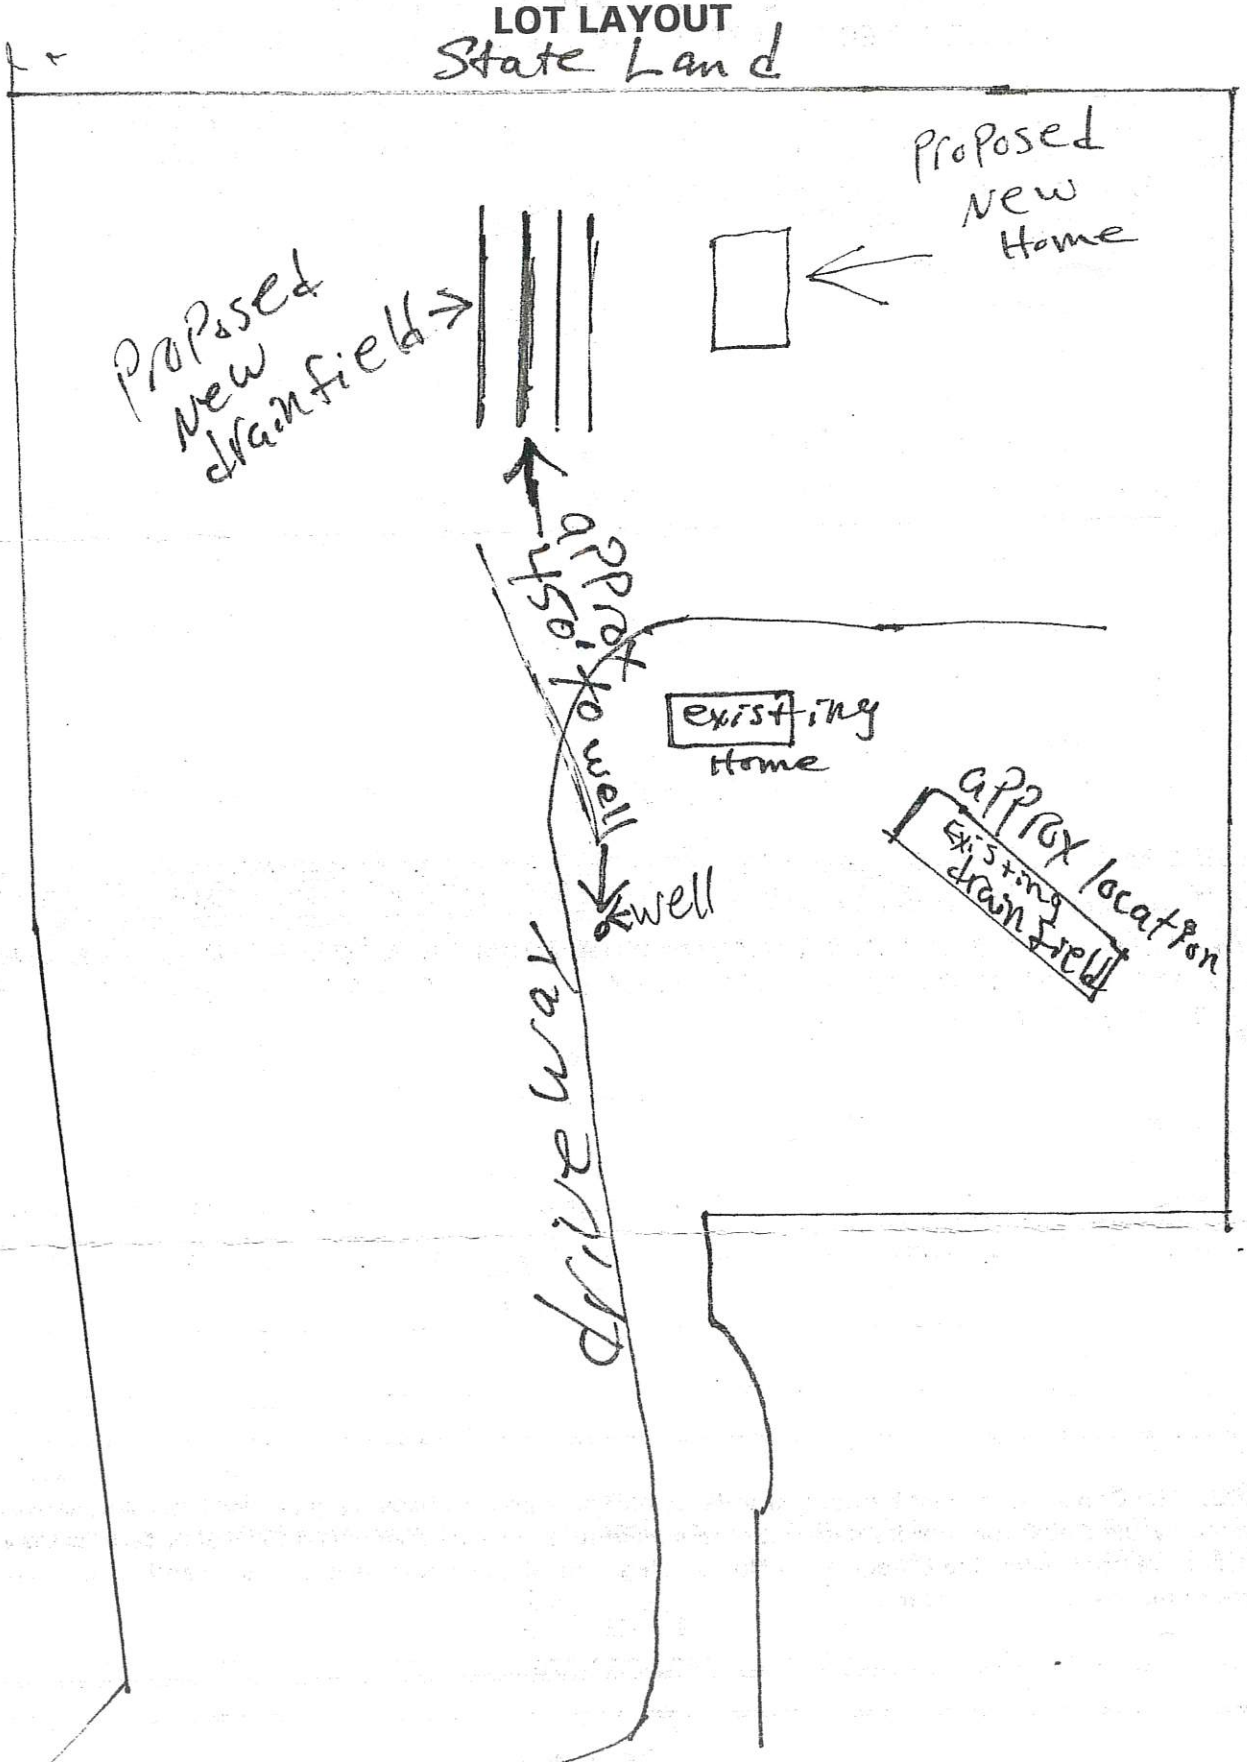
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


State Land
Proposed New Home
Proposed New drainfield
approx 10' setback
existing Home
well
well
approx location Existing drain field
driveway