LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/29/2010 Expiration Date: 04/20/2011

Property Owner: Rob Knowles & Mark Jordan c/o: Jere Johnson

Address: [redacted]

Telephone: [redacted]

Installer: License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing shared pressure-dosed system to provide treatment and disposal for two (2) 3-bedroom single-family residential dwellings to be constructed on this property.

Parcel Description:

Legal: S28 T36 R27 Tract B

Address or Location: Briggs Shadow Drive

Approved Design Criteria:

Bedrooms: 6 Septic Tank Size: 2000 gallons Drainfield Size: 400 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, JERE JOHNSON'S DESIGN SPECIFICATIONS, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

KNOWLES/JORDAN PROPERTY

TRACT B, SECTION 28-T36N-R27W
LINCOLN COUNTY

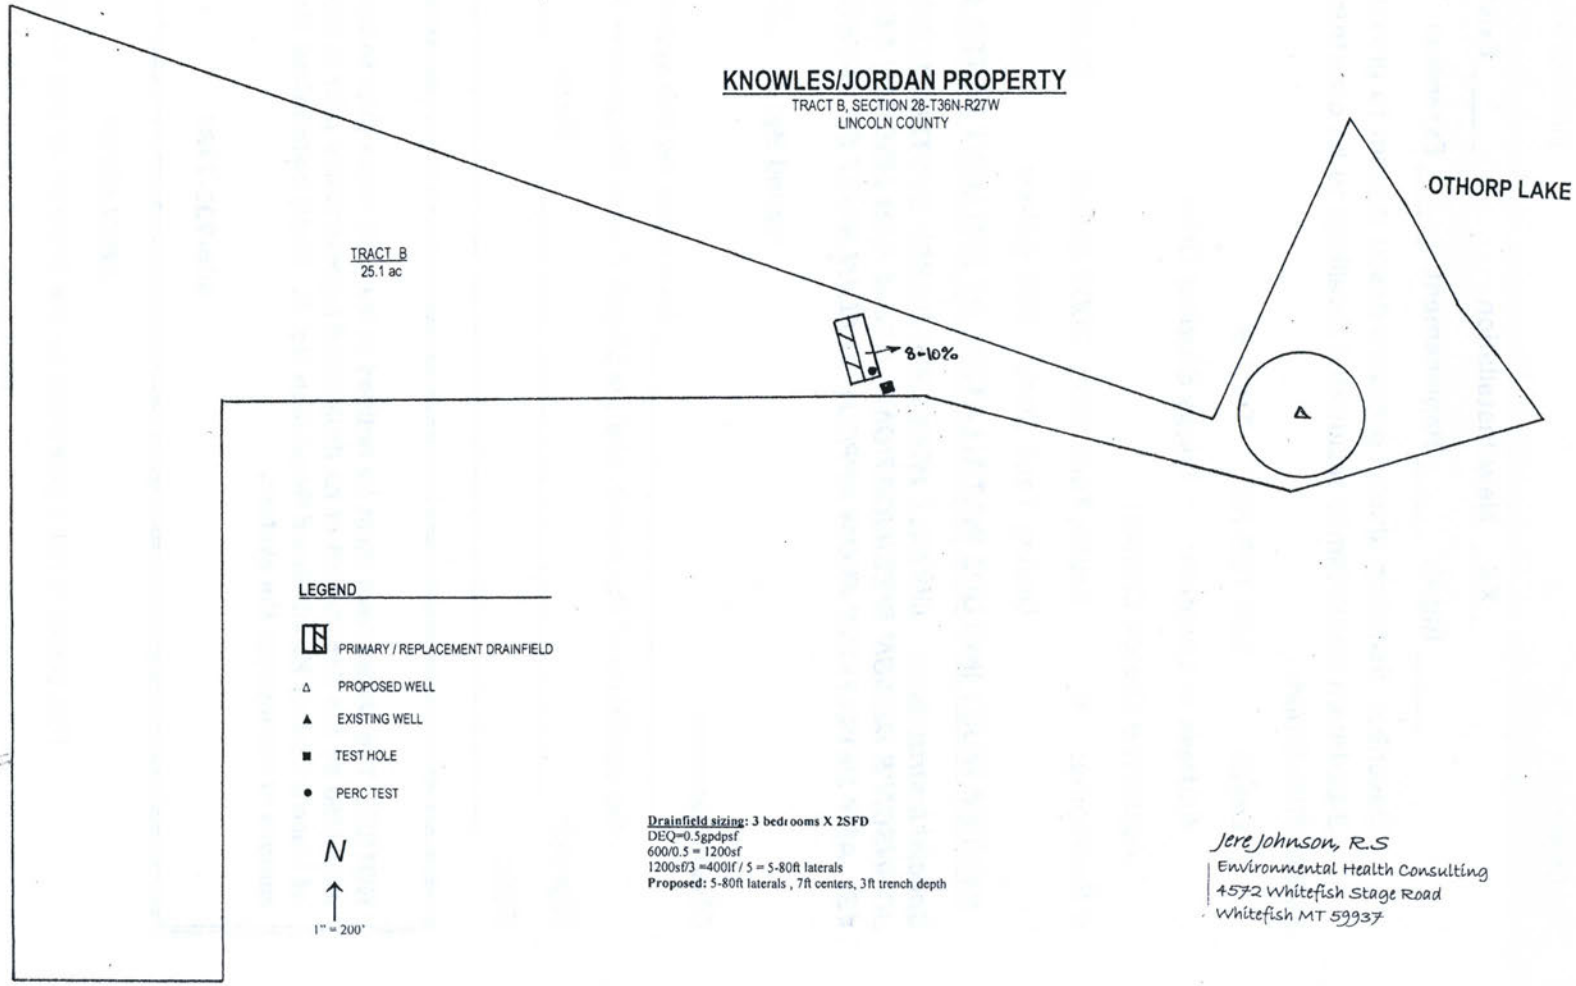

Drainfield sizing: 3 bedrooms X 2SFD
DEQ=0.5gpdpsf
600/0.5 = 1200sf
1200sf/3 =400lf / 5 = 5-80ft laterals
Proposed: 5-80ft laterals , 7ft centers, 3ft trench depth

Jere Johnson, R.S
Environmental Health Consulting
4572 Whitefish Stage Road
Whitefish MT 59937