LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/07/2010 Expiration Date: 04/08/2011

Property Owner: Mike & Pam Kroschel c/o: Steve Webster/Miller Electric

Address: [redacted]

Telephone: [redacted]

Installer: Steve Webster/Miller Electric License No. 116

____ New Installation __XX__ Existing System

_____ Repair _____ Replacement __XX__ Extension _____ Other

Describe: Adding 60-feet of drainfield to existing under-sized system to provide needed additional treatment area.

Parcel Description:

Legal: E-1/2 E-1/2 SE-1/4 NE-1/4 S33 T31 R33

Address or Location: 329 Taylor Loope

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 170 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

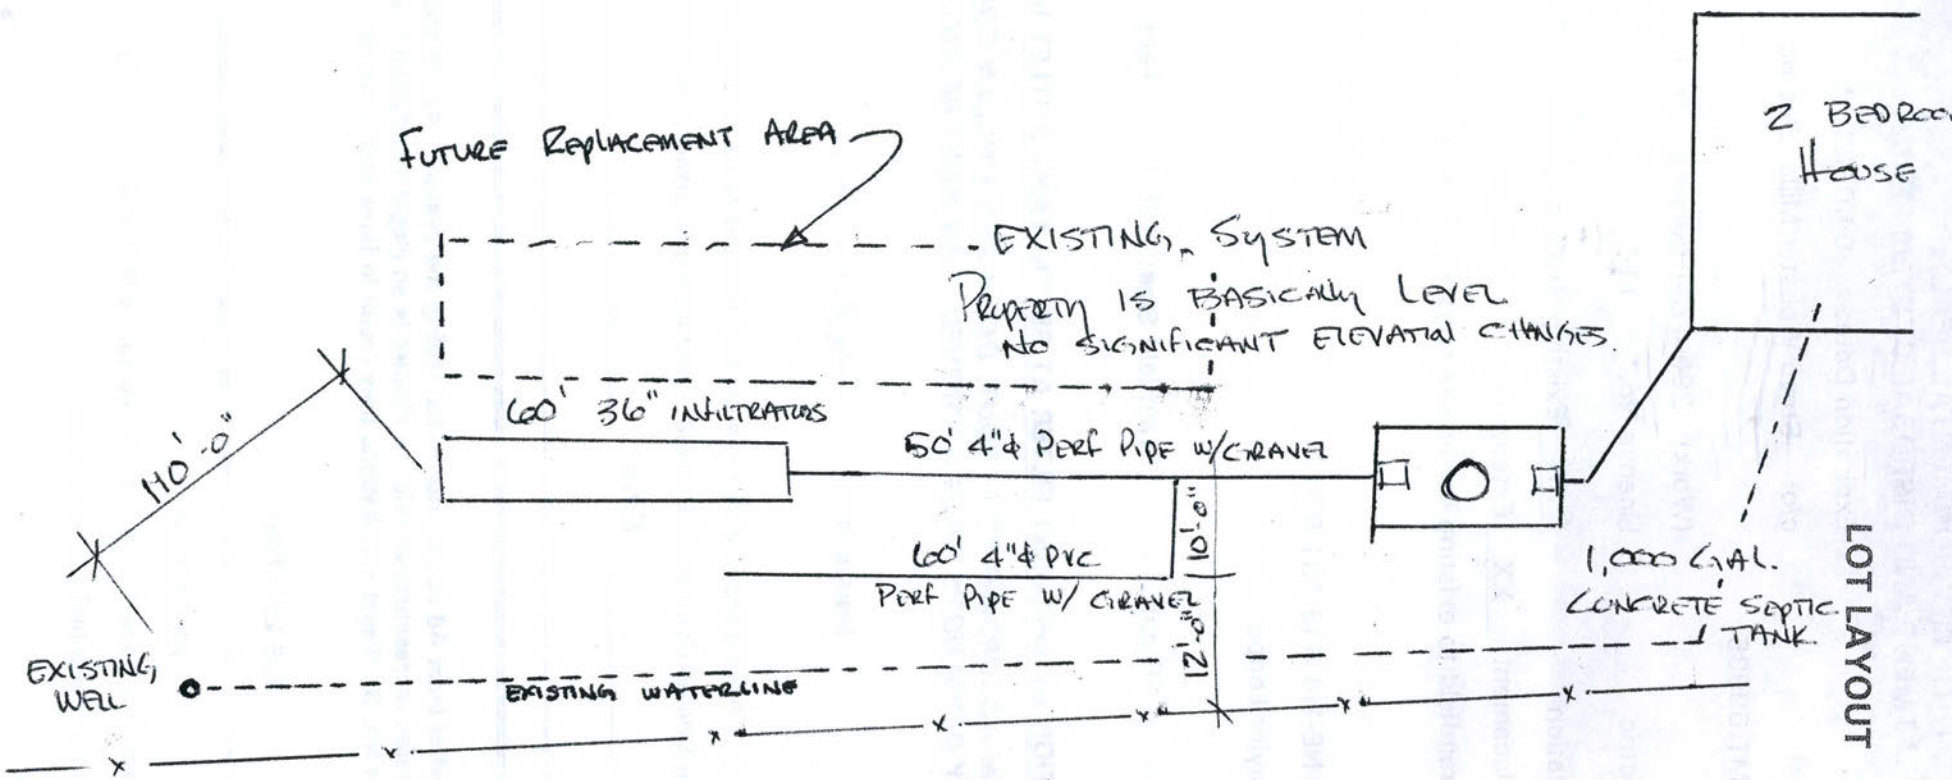
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

KROSCHELS


N
FUTURE REPLACEMENT AREA
EXISTING SYSTEM
PROPERTY IS BASICALLY LEVEL
NO SIGNIFICANT ELEVATIAL CHANGES.
2 BEDROOM HOUSE
60' 36" INFILTRATORS
50' 4"ϕ PERF PIPE W/GRAVEL
110'-0"
10'-0"
60' 4"ϕ PVC
PERF PIPE W/ GRAVEL
1,000 GAL.
CONCRETE SEPTIC
TANK
12'-0"
EXISTING WELL
EXISTING WATERLINE
LOT LAYOUT