LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/10/2010 Expiration Date: 09/11/2011

Property Owner: Justin & Wendi McNeil c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Rupert Schreiner License No. 19

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: E-1/2 SE-1/4 S18 T34 R25

Parcel Description:

Legal: S14 T37 R28

Address or Location: Tract 2C (adjacent to Trego Bench Subdivision)

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 300 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

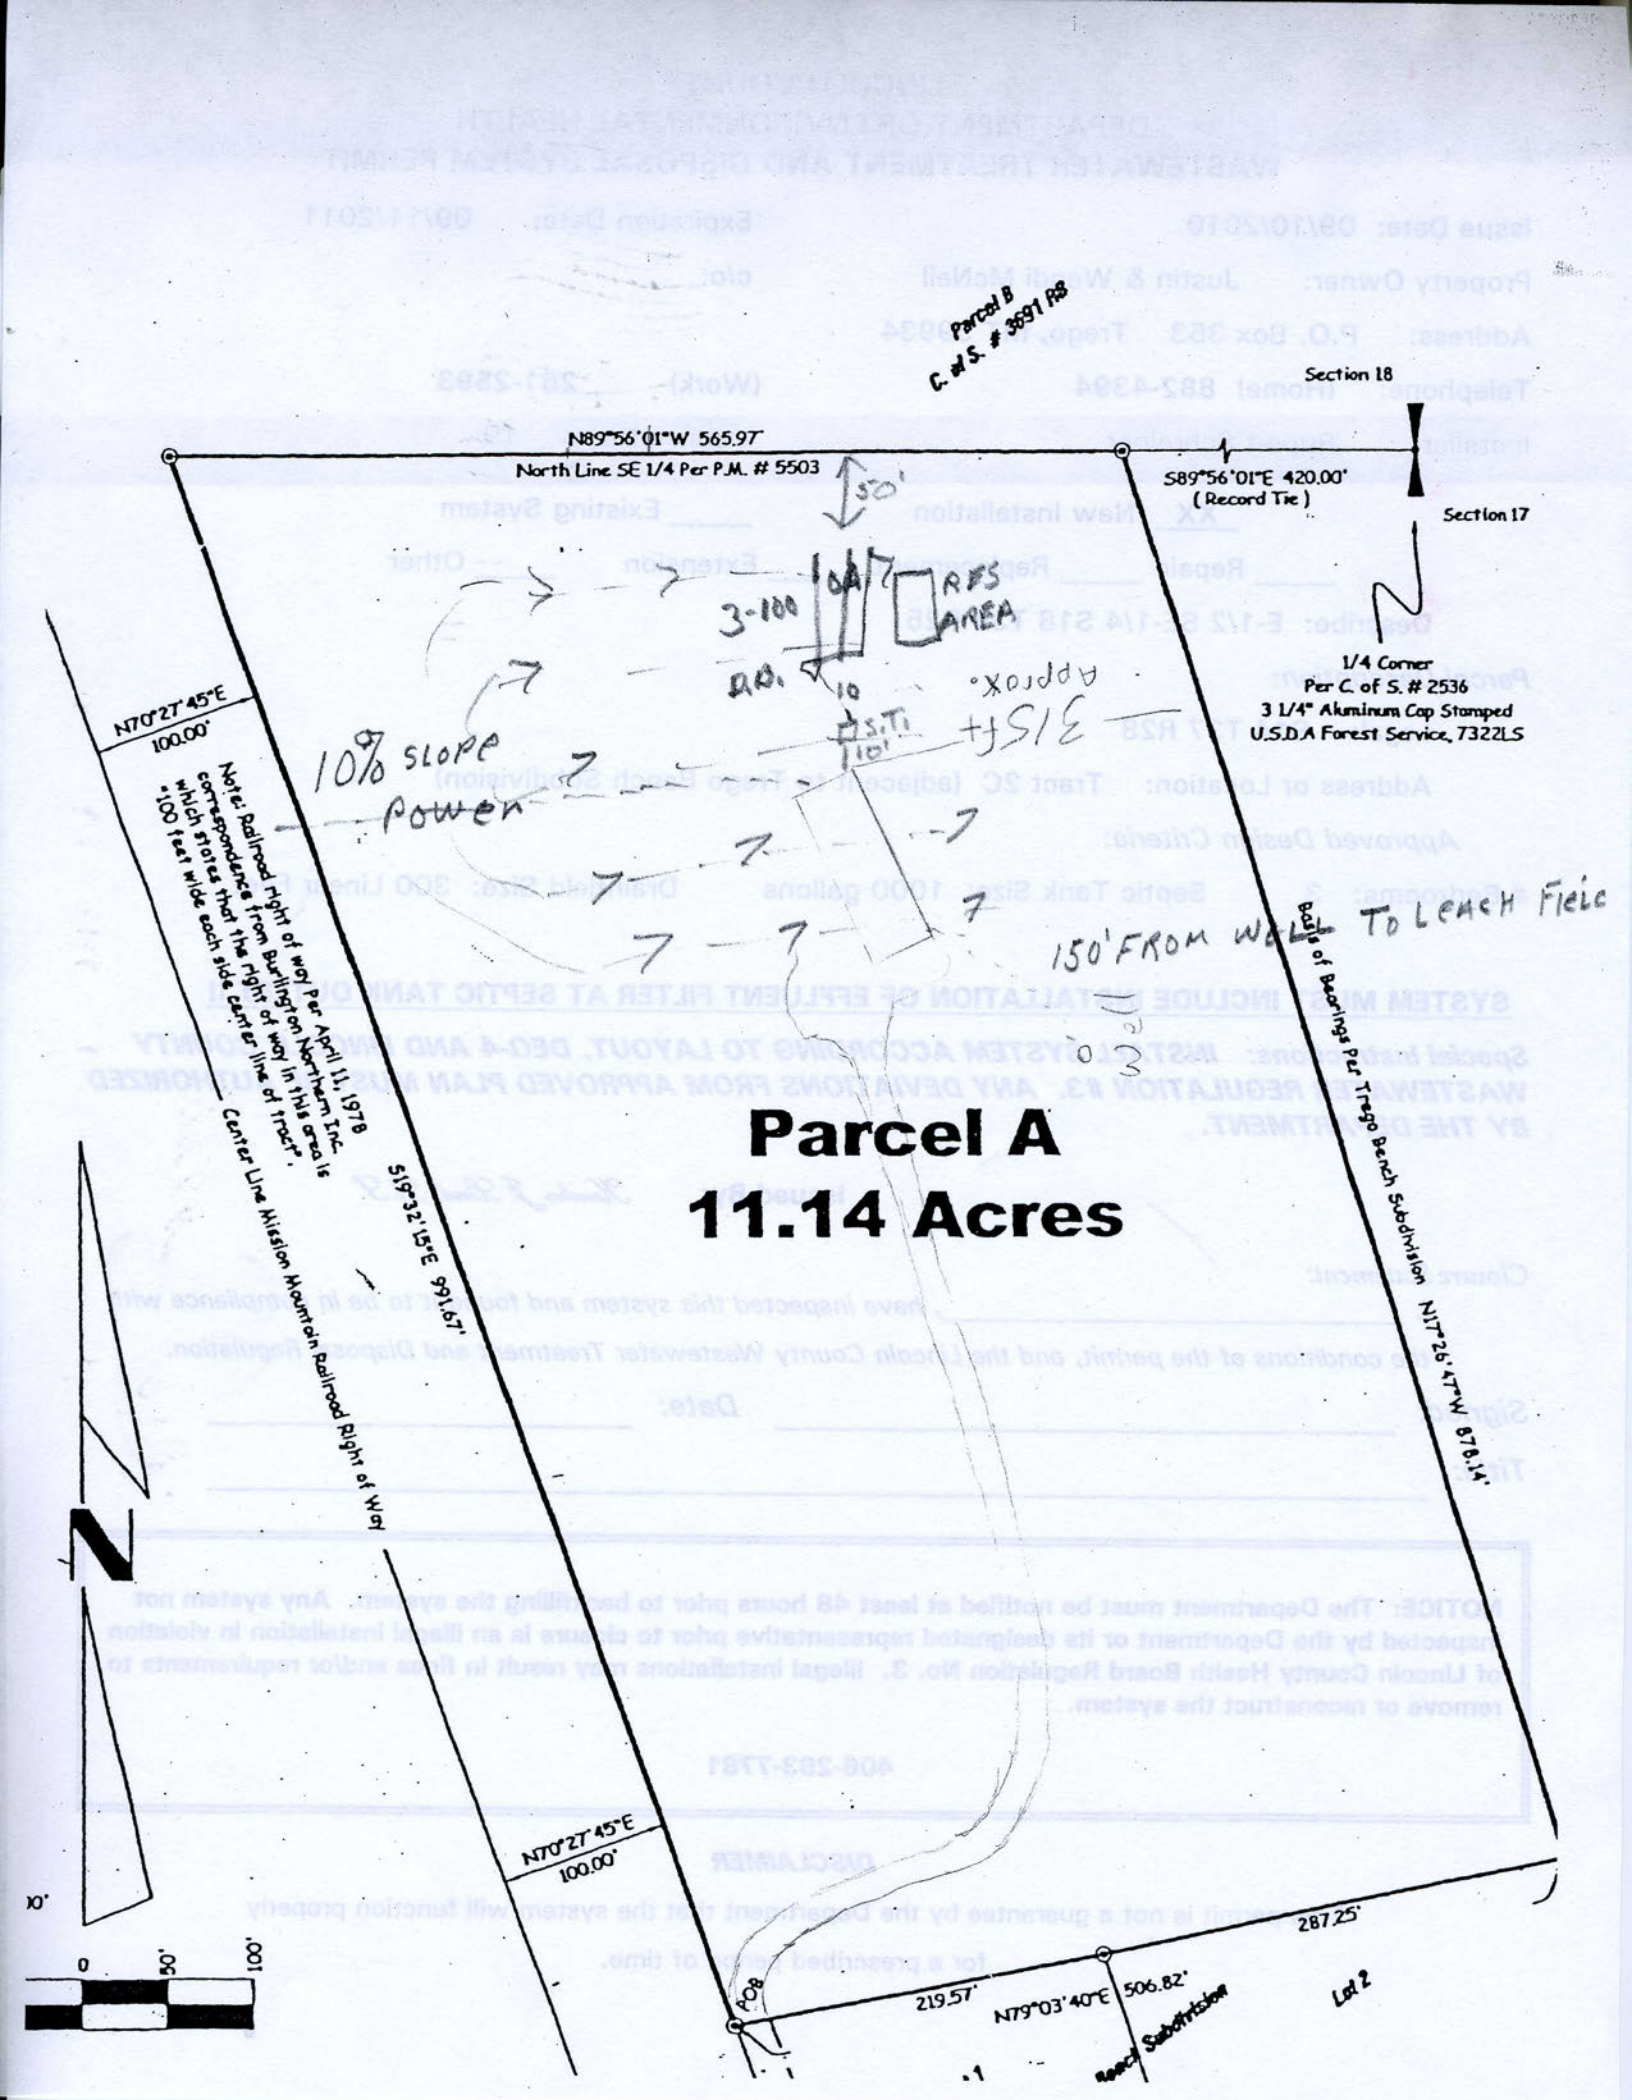
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Parcel B
C. of S. # 3697 RS
Section 18
N89°56'01"W 565.97'
North Line SE 1/4 Per P.M. # 5503
S89°56'01"E 420.00'
(Record Tie)
Section 17
50'
3-100
DA
RFS AREA
DA
10
Approx. 315ft
S.T.
10'
10% SLOPE
Power
1/4 Corner
Per C. of S. # 2536
3 1/4" Aluminum Cap Stamped
U.S.D.A Forest Service, 7322LS
N70°27'45"E
100.00'
Note: Railroad right of way Per April 11, 1978 correspondence from Burlington Northern Inc which states that the right of way in this area is 100 feet wide each side center line of tract.
150' FROM WELL TO LEACH Field
Parcel A
11.14 Acres
S19°32'15"E 991.67'
Center Line Mission Mountain Railroad Right of Way
Basis of Bearings Per Trego Bench Subdivision N17°26'47"W 878.14'
N70°27'45"E
100.00'
287.25'
219.57'
N79°03'40"E 506.82'
POB
Trego Bench Subdivision
Lot 2
10'
0
50'
100'