LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/08/2010 Expiration Date: 01/09/2011

Property Owner: Louis J. & Janet M. Myers c/o: dba "Lil Bandit Meats, LLC"

Address: [redacted]

Telephone: [redacted] (Work)

Installer: Tally Hoe License No. 01

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Wastewater holding tank system for "Lil Bandit Meats, LLC". ***Use of this system for disposal of residential wastewater is strictly prohibited. Use of this system by any other commercial operation without prior review and approval of a "change of use" proposal by the Department is prohibited. Tank must be leak tested annually & results reported to the Department.***

Parcel Description:

Legal: NE-1/4 NE-1/4 S8 T31 R31 Lot 2 of Ivar Subdivision

Address or Location: 163 Bobtail Lane

Approved Design Criteria:

Approx. Discharge: 40-gallons per production run Holding Tank Size: 3000 gallons

Pumping Schedule: Following every 62nd production run, or within 48-hours of activation of tank alarm.

Special Instructions: INSTALL WASTEWATER HOLDING TANK SYSTEM ACCORDING TO LOT LAYOUT, CIRCULAR DEQ-4 CHAPTER 24 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Ivar Subdivision Lot #2 Rewrite
Lincoln County, Montana
NE¼ NE¼ Section 8, T31N, R31W, PMM

RECEIVED
JAN 06 2010
MT DEQ PUBLIC WATER & SUBDIVISION BUREAU

EQ # 10-1517

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality / PCD
Local Reviewer — Date 01/05/2010

Accepted under contract
DEQ Representative — Date 1/6/10

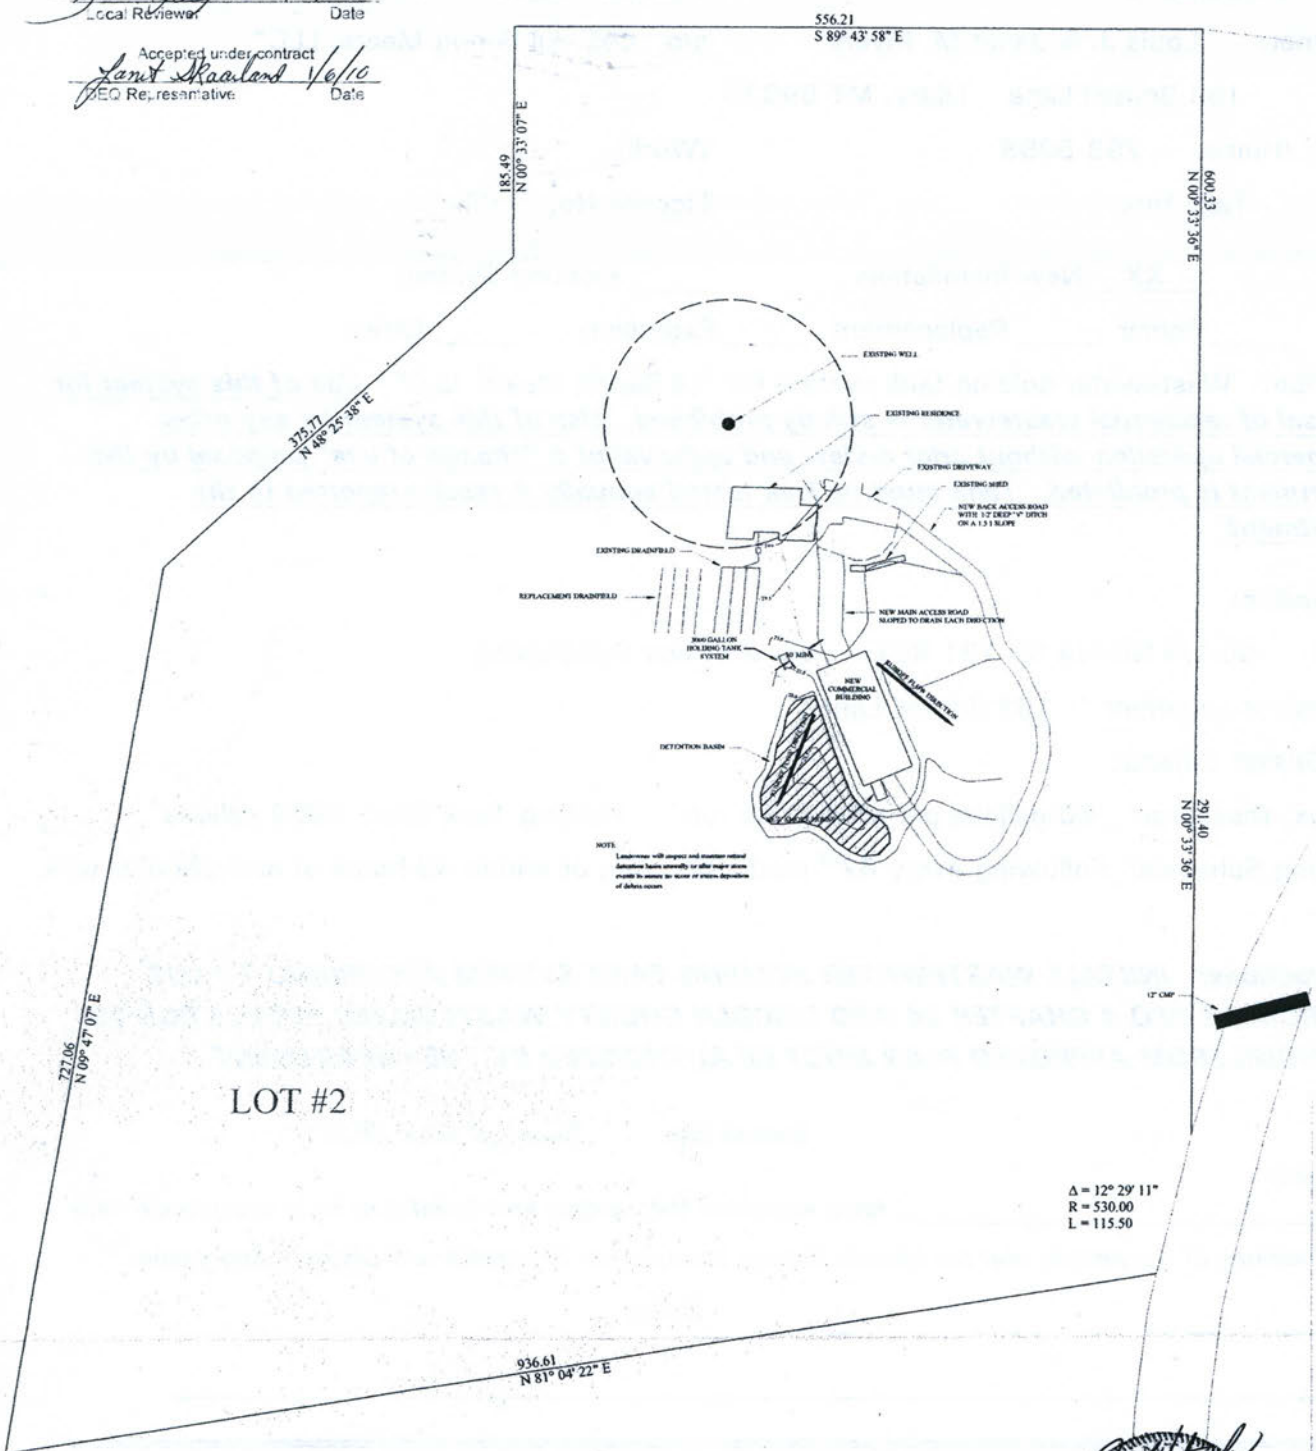

CONTOUR INTERVAL
0.25 FEET - MINOR
0.50 FEET - MAJOR

FEET
0 100 200

FRANK E. NOTARICH 3790 ES PROFESSIONAL ENGINEER 1/4/2010

SHEET No. A	LOT #2 REWRITE	SHEET TITLE	COMPILED BY Frank Notarich/Don Hilliard DRAWN BY AOT Drafting Service APPROVED BY	MYERS' COMMERCIAL BUILDING LOT #2 REWRITE APPENDIX A LIBBY, MT	TLC ENGINEERING, PE, LLC 103 W. LINCOLN BLVD LIBBY, MONTANA 59923 406-293-5950 FILE No. JOB 09-30

REVISION | SEAL