LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/28/06 Expiration Date: 07/29/07

Property Owner: Carolyn Peck c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Terry Oedewaldt License No. 2

_XX_ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Sand-lined trenches required. Using infiltrators – 25% size reduction allowed.

Parcel Description:

Legal: S35 T30 R31

Address or Location: 5664 Highway 2 South

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 144 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SAND-LINED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

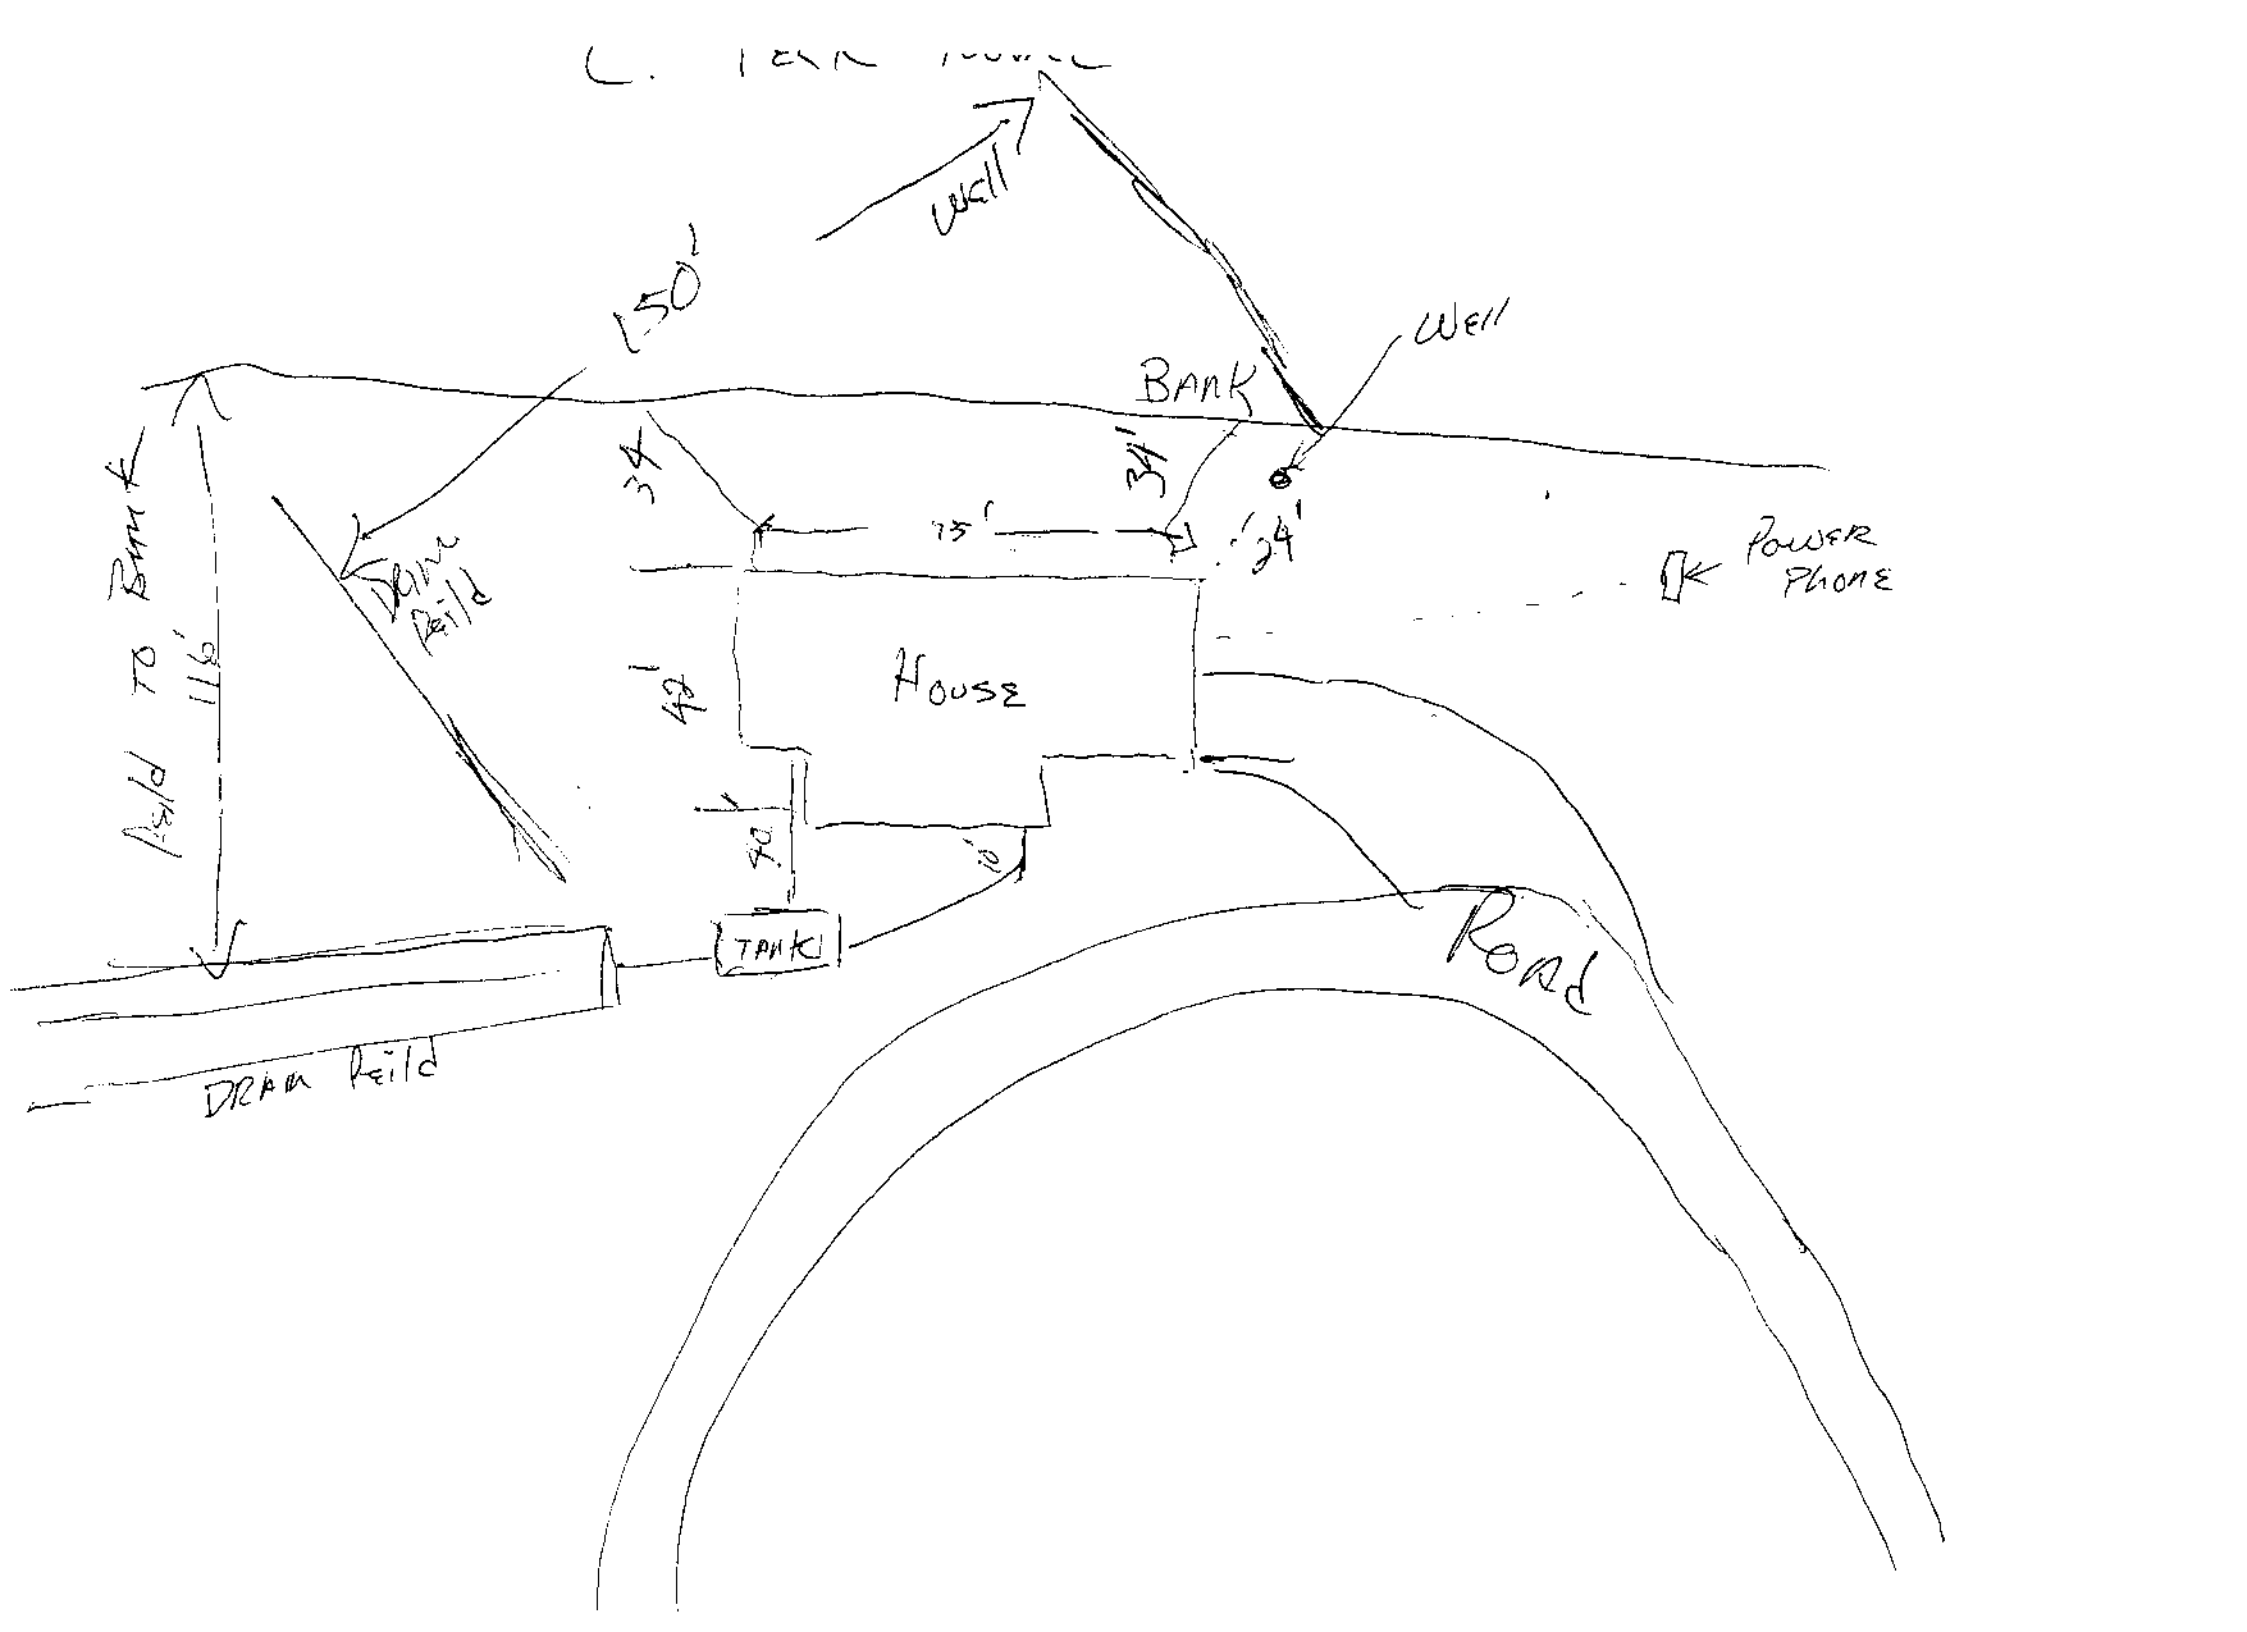
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Well
150'
Well
Bank
34'
34'
75'
24'
Power Phone
House
42'
20'
10'
TANK
Road
Drain Field
Drain Field
Bank to Bank
116'