LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/26/2010 Expiration Date: 05/27/2011

Property Owner: Allan Randall c/o: Linda Garrison

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Linda Garrison License No. 114

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers for installation

Parcel Description:

Legal: T35 R31 & 32 in Unsurveyed HES #339 – Tract B

Address or Location: Lot 3 of Purcell View

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 160 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

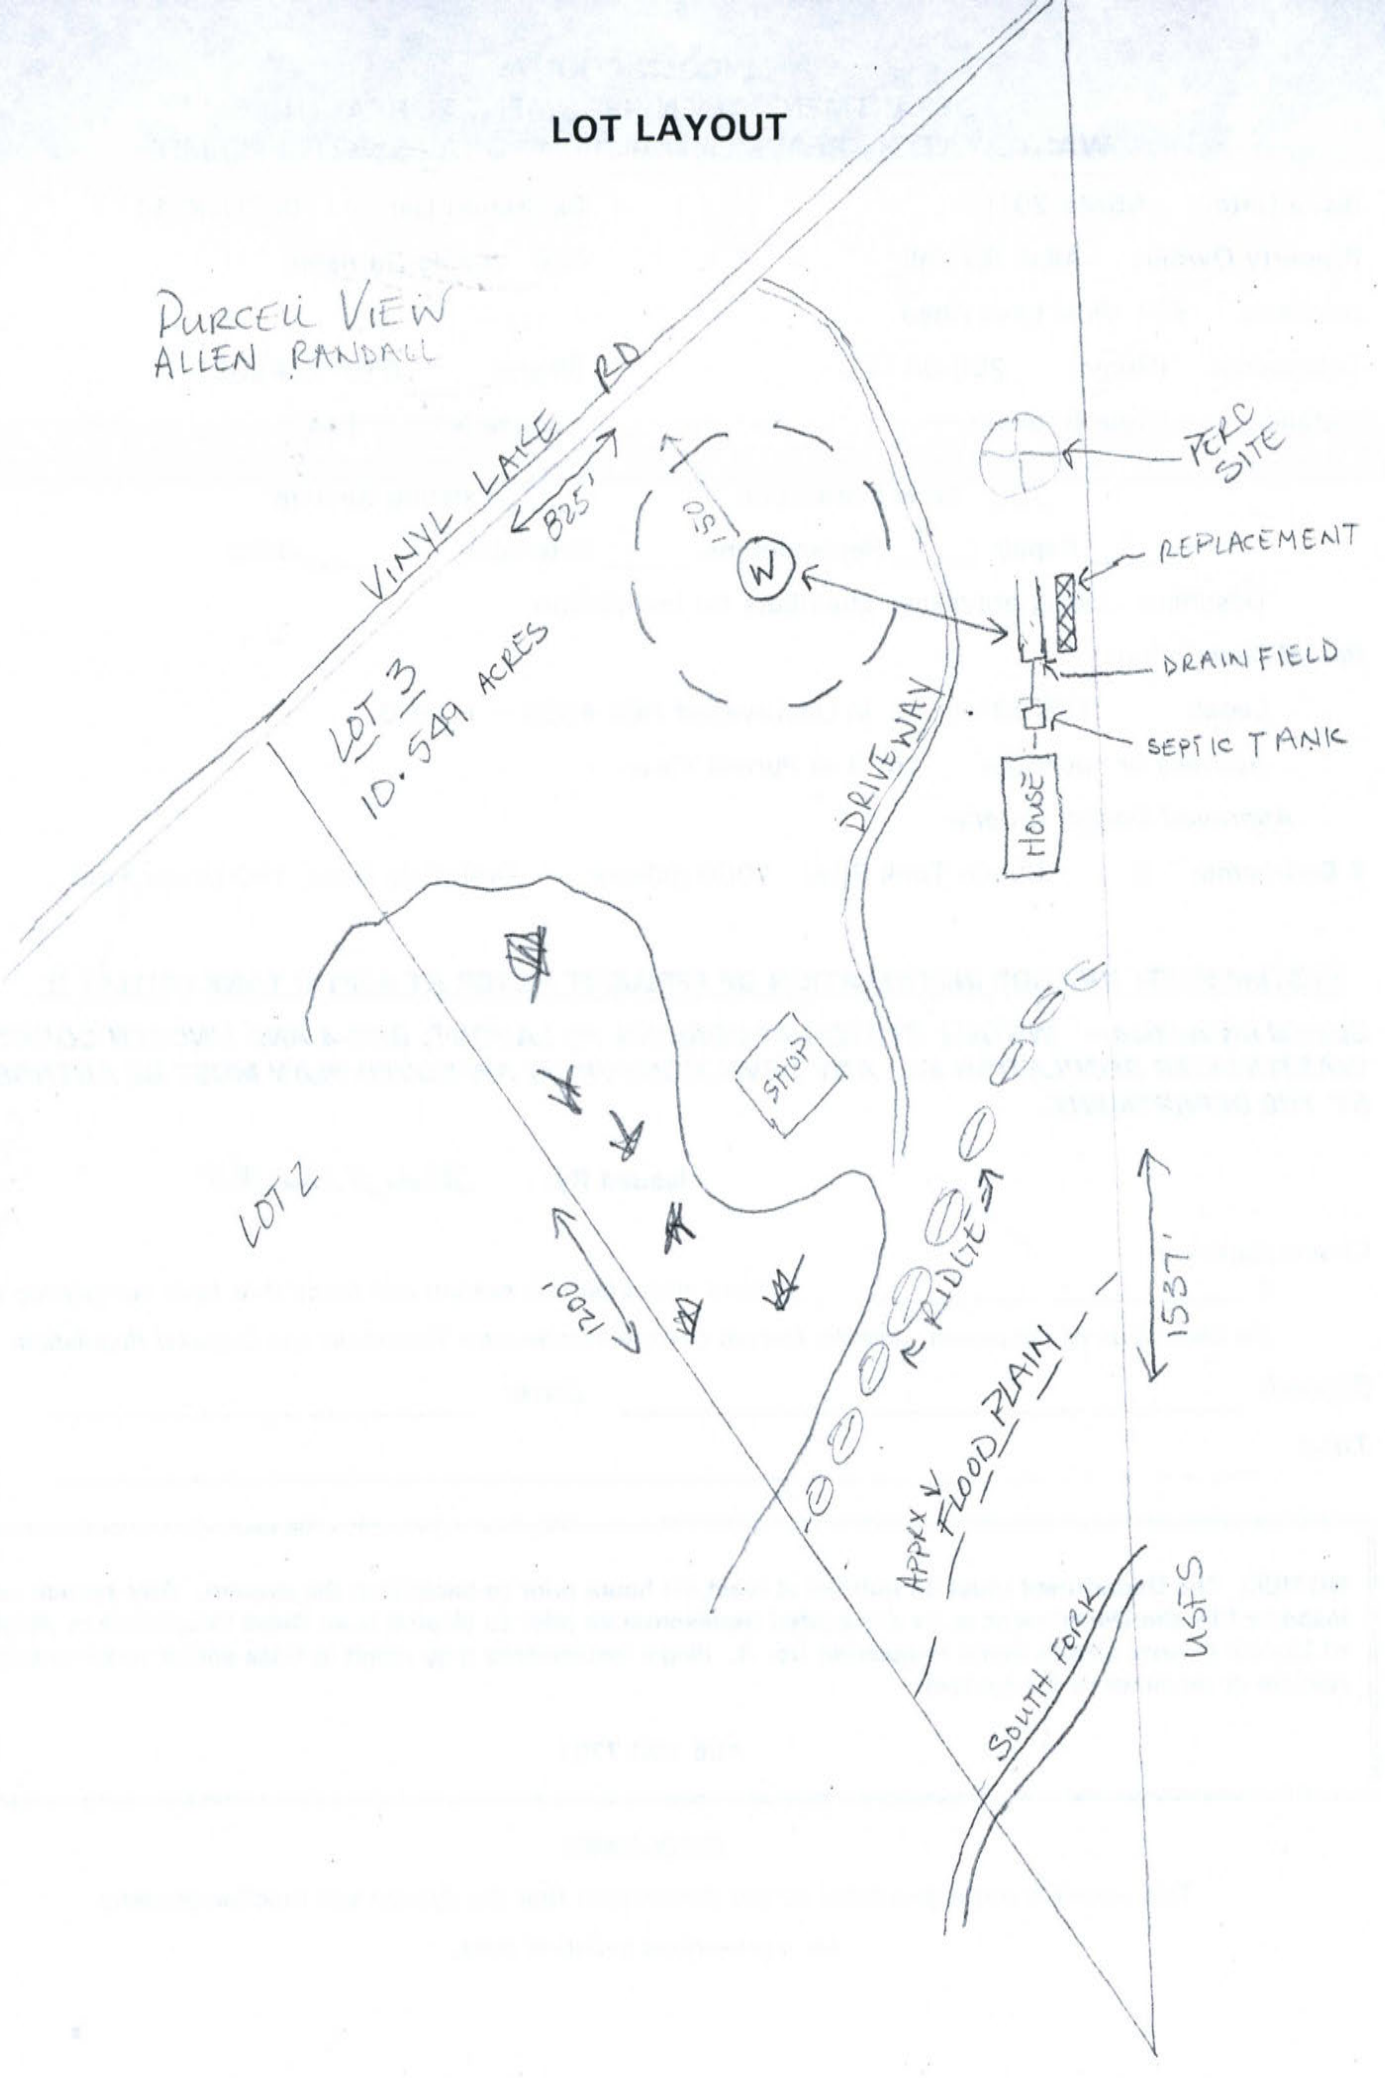
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


PURCELL VIEW
ALLEN RANDALL
VINYL LANE RD
825'
150'
W
PCRC SITE
REPLACEMENT
DRAIN FIELD
SEPTIC TANK
House
DRIVEWAY
LOT 3
10.549 ACRES
SHOP
LOT 2
1200'
RIDGE
1537'
APPRX FLOOD PLAIN
SOUTH FORK
USFS