LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/31/2010 Expiration Date: ~~09/01/2011~~ 2013.

Property Owner: Ann Stevens c/o: Mike Helburg

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: [redacted] Tully Hoe License No. 1~~K~~ 1

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Install pressure-dosed system with ~~three~~ Four 63' laterals in 3-foot wide trenches.

Parcel Description:

Legal: S13 & S24 T31 R32

Address or Location: Lot 18 of Quartz Mountain Estates

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: ~~189~~ 252 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ APPROVAL DOCUMENTS, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, Thomas Jcole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Th Thomas J Cole Date: 2-22-13

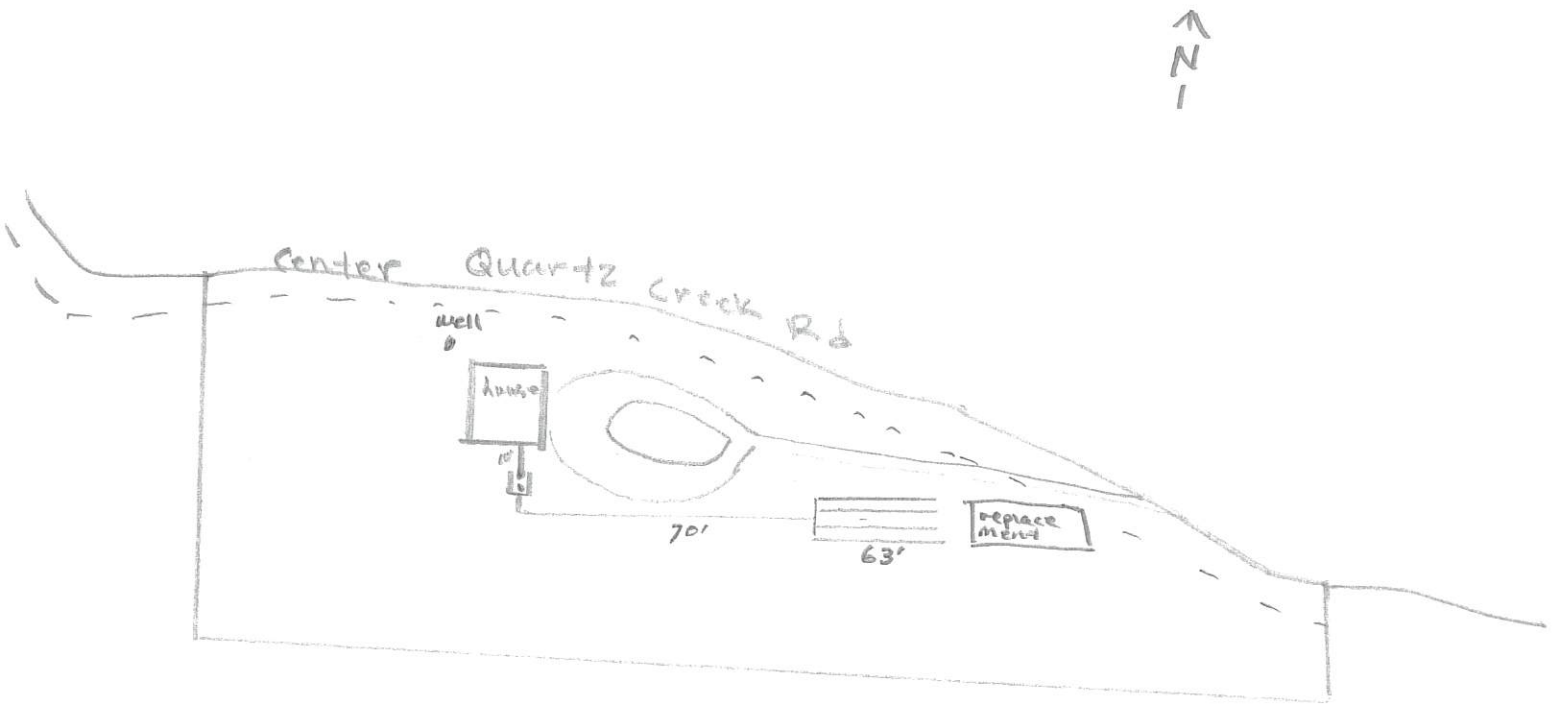
Title: owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
Center Quartz Creek Rd
well
house
10'
70'
63'
replace ment