LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/18/10 Expiration Date: 6/17/11

Property Owner: Larry Struklund c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☐ Repair ☒ Replacement ☐ Extension ☐ Other _____

Describe: new concrete tank and drainfield

Parcel Description:

Legal: S33 T31N R31W

Address or Location: 66 Three Corner Rd, Libby, MT

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 3 dry wells

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

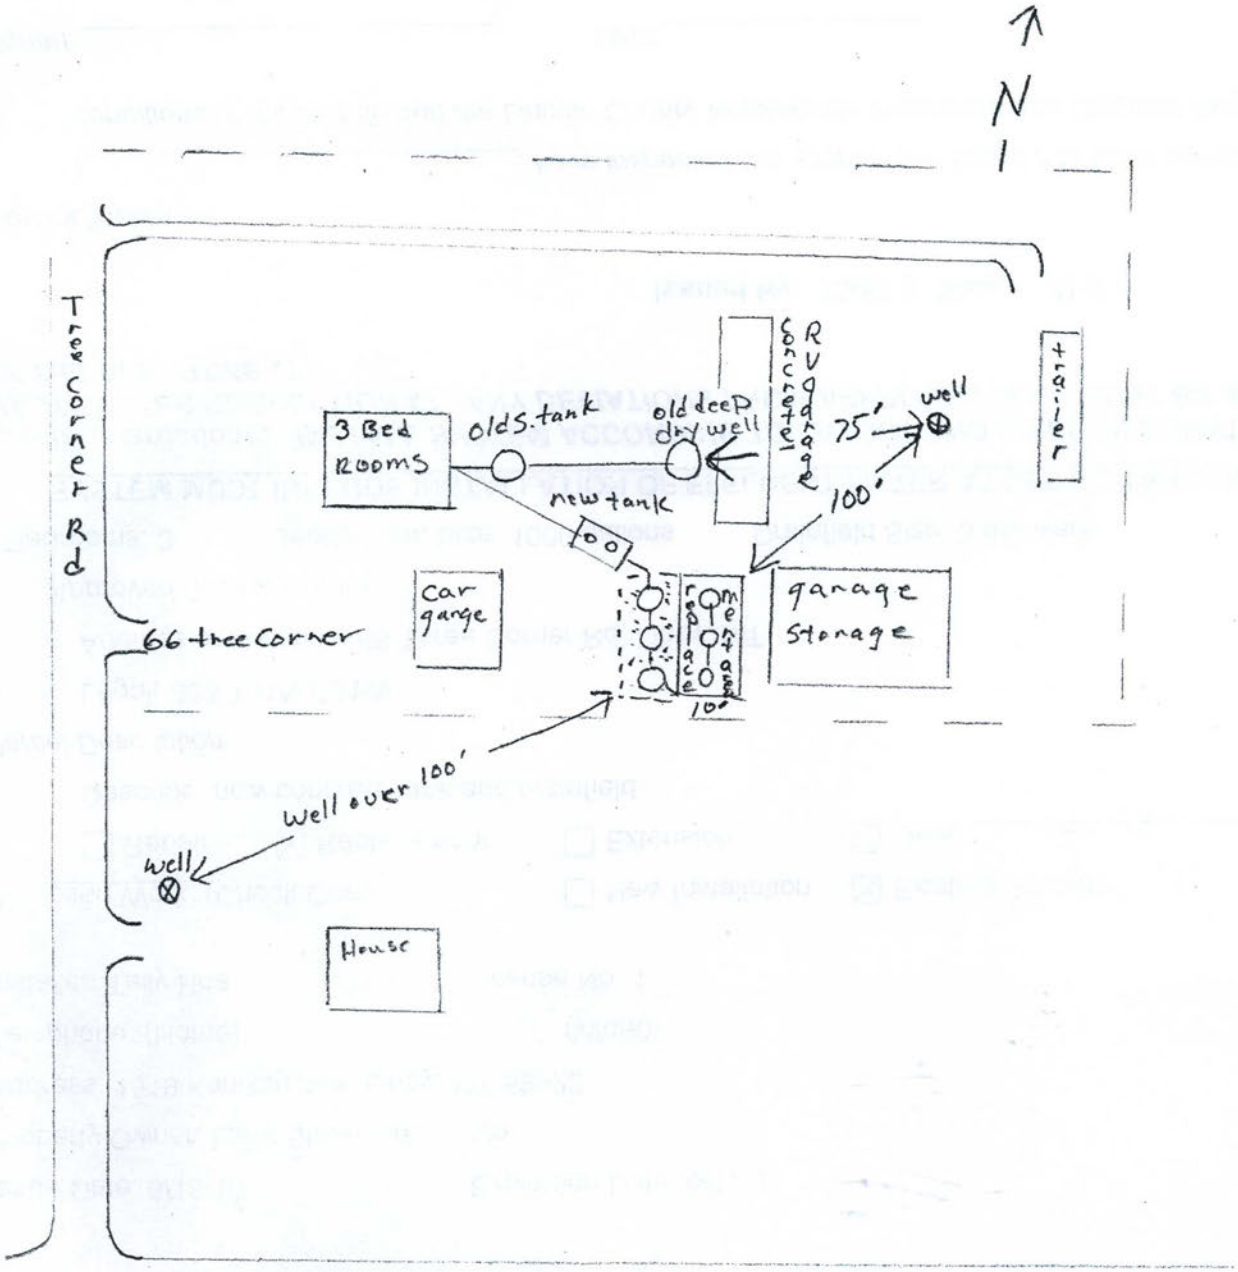
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781 x228

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
Tree corner Rd
3 Bed Rooms
olds. tank
old deep dry well
concrete
RV garage
trailer
well
75'
100'
new tank
car garage
replace
one stall
garage Storage
10'
66 tree Corner
well over 100'
well
House

← Hwy 2 west