LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/24/2026 Expiration Date: 03/23/2027 Permit# 26-8347

Property Owner: Dawson Young

Mailing Address: [redacted]

Installer: Dylan Parrish License #: 222

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 4 Bedroom House.

Legal: RAWLINGS ROAD 1ST ADDN, S29, T31 N, R31 W, ACRES 4.77, LOT 53

Property Address: 587 Quartz Rd., Libby, MT 59923 Assessment Code: 8347

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new pressure dosed system for 4 Bedroom House with 2 Laterals @ 55' with reduction for chambers.

# of Bedrooms: 4 Septic Tank Size: 1500/500 gallons Trench Depth: 24"-36"

# of Laterals: 2 Length of Laterals: 55' Trench Width: 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

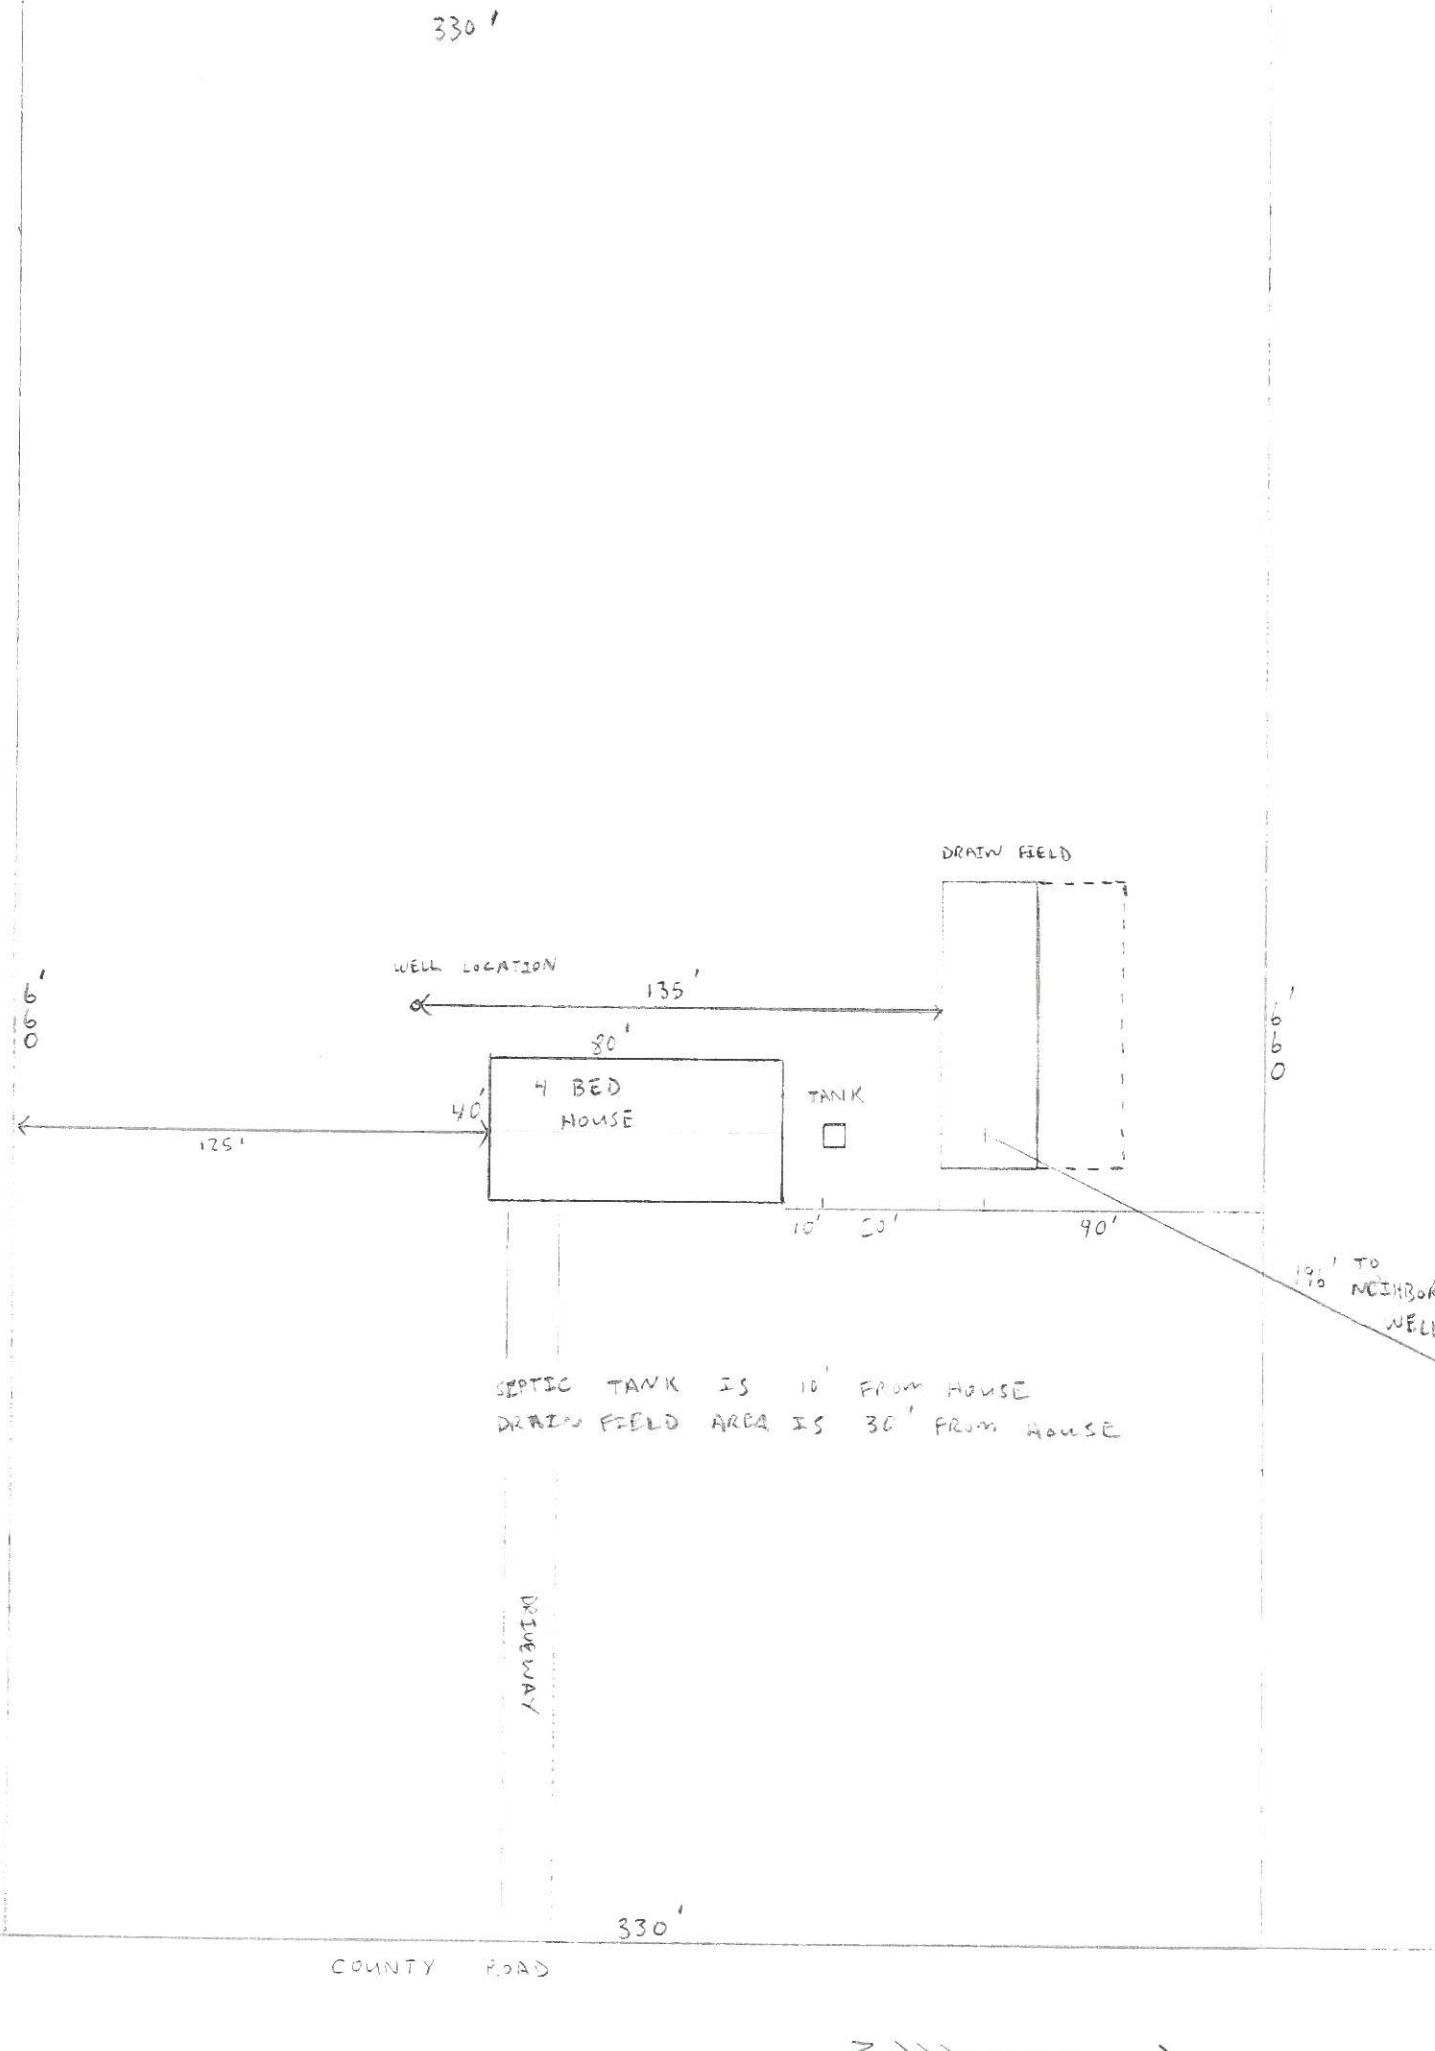
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


330'
DRAIN FIELD
WELL LOCATION
135'
660'
80'
4 BED HOUSE
TANK
40'
125'
10'
30'
90'
100' TO NEIGHBOR WELL
SEPTIC TANK IS 10' FROM HOUSE
DRAIN FIELD AREA IS 30' FROM HOUSE
DRIVEWAY
330'
COUNTY ROAD
N