LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/07/2026 Expiration Date: 04/06/2027 Permit# 26-54865

Property Owner: Gerry Elbridge c/o: Earth Works

Address: 10625 Fife Ave., Vero Beach, FL 32963

Property Address: 135 Glacier Peaks Rd., Eureka, MT 59917

Installer: Darwin Pluid License No. 164

____ Direct Connection __XX__ Grinder Pump Connection to Main ___Effluent Lift Tank Connection

Describe: Grinder pump connection to community collection system.

Parcel Description:

Legal: WILDERNESS CLUB PH 1, S32, T37 N, R27 W, LOT 161, 0.485 acres

Address or Location: WILDERNESS CLUB LOT#161

Geo/Assessors code: 54865

Approved Design Criteria:

Per the application and The Wilderness Club Engineer Design Report specifications, this lot is approved for a 3-bedroom house. This structural size may not be exceeded and wastewater flows are prohibited from exceeding 300 gallons per day per residential lot. Any proposed increase in wastewater flows must be reviewed by and receive the approval of Lincoln County Environmental Health and the Montana DEQ Subdivision Section. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL GRINDER PUMP TO CURB STOP WITH 4" SCHEDULE 40 INTO LIBERTY/EDNE GRINDERS, 200# POLY PRESSURE TO STREET CURB STOP WITH CHECK VALVE. ACCORDING TO THE ATTACHED LOT LAYOUT AND DEQ APPROVAL STATEMENT EQ#06-3006. ANY DEVIATIONS FROM THE APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE WILDERNESS DEVELOPMENT LLC, DEQ AND THE DEPARTMENT.

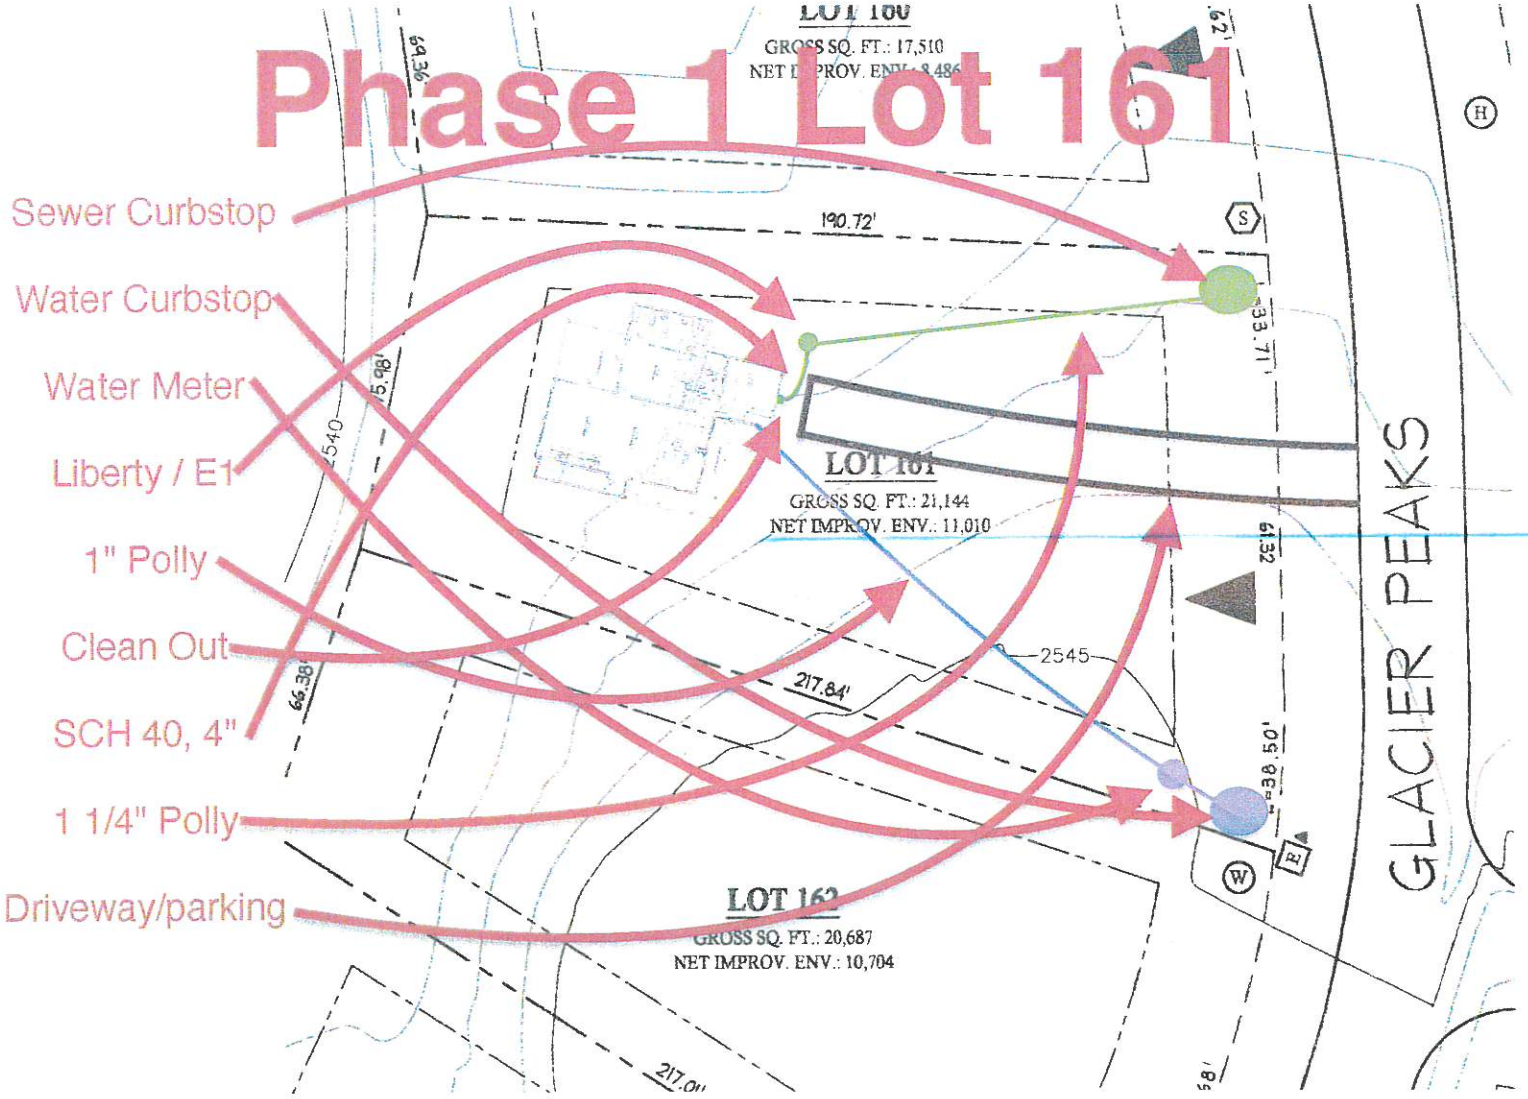
Issued By: ROBIN BLUMBERG R. S.

Signed: Darwin Pluid *Date:* 4/10/2026

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

DISCLAIMER: This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.

This permit is not finalized until the system is inspected and the closure statement is signed.


Phase 1 Lot 161
Sewer Curbstop
Water Curbstop
Water Meter
Liberty / E1
1" Polly
Clean Out
SCH 40, 4"
1 1/4" Polly
Driveway/parking
LOT 160
GROSS SQ. FT.: 17,510
LOT 161
GROSS SQ. FT.: 21,144
NET IMPROV. ENV.: 11,010
LOT 162
GROSS SQ. FT.: 20,687
NET IMPROV. ENV.: 10,704
190.72'
217.84'
2545
2540
GLACIER PEAKS