LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 3/31/26 Expiration Date: 3/20/27 Permit #26-6886

Property Owner: Finely Finished Development LLC

Mailing Address: [redacted]

Installer: Royden Caldwell License #: 171

Approved Work: Effluent Lift Tank Connection to Main

Parcel Description:

Legal: NORTH STAR LANDING, S06 T36N R27W, LOT 36

Property Address: 86 Basin Bend, Eureka, MT 59917 Assessment Code: 6886

DEQ COSA: E.Q.# 24-2554 Date: 6/19/2025

Approved Design Criteria:

Install the sewage treatment system for maximum wastewater flows of 300 gallons per day as approved in the North Star Landing Subdivision design plans and specifications, and Certificate of Subdivision Approval #24-2554.

Special Instructions: System will consist of a septic tank, an Orenco Advantex AX20 for Level II treatment system, and a recirculating pump. Tank to be two compartment, 1,500 gallon for 300 gallons per day. This system requires an Operation & Maintenance contract to include a bi-annual on-site inspection of all major components of the wastewater treatment system for the first two (2) years after use of the system begins, and annually thereafter per ARM 17.30.718(8) and Circular DEQ 4 Appendix D. Annual sampling in accordance with Circular DEQ 4 Appendix D is required for the life of the system. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES OR DEVIATIONS FROM THE APPROVED PLAN MUST BE PRE-AUTHORIZED BY DEQ AND THE LINCOLN COUNTY HEALTH DEPARTMENT.

Issued By: Kathi Hooper, RS

NOTICE: The Department must be notified at least 48 hours prior to installation of this system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: [signature] *Date:* 4/9/26

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Douglas Hill

Spec 2

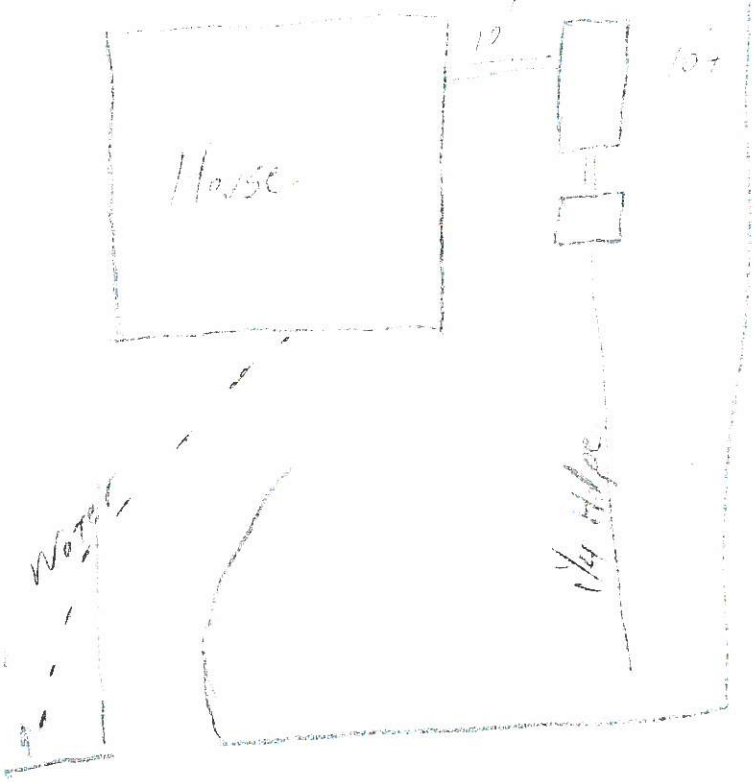

N