LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/06/2009 Expiration Date: 11/07/2010

Property Owner: Greg Hanson c/o: Kootenai Sand & Gravel

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Kootenai Sand & Gravel, Inc. License No. 109

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Pressure-dosed system per approved engineered plan by 48 North, p.c., to serve commercial units on both Lots (three on Lot 1 and one on Lot two).

Parcel Description:

Legal: S9 T36 R27 -- System serving both Lots 1 & 2

Address or Location: Amended Lot 1 of Riverdrive Estates Unit No. 2

Approved Design Criteria: Commercial unit for each Lot has individual 1000 gallon septic tank.

Max. Flows: 312 GPD Septic Tank Size: 2 x 1000 gallons Drainfield Size: 140 Linear Feet

Dosing Tank Size: 1500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO APPROVED ENGINEERED DESIGN BY 48 NORTH, LOT LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kenda J. Lind, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Dan D Zumm pres *Date:* 1/19/10


Title: Pres

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

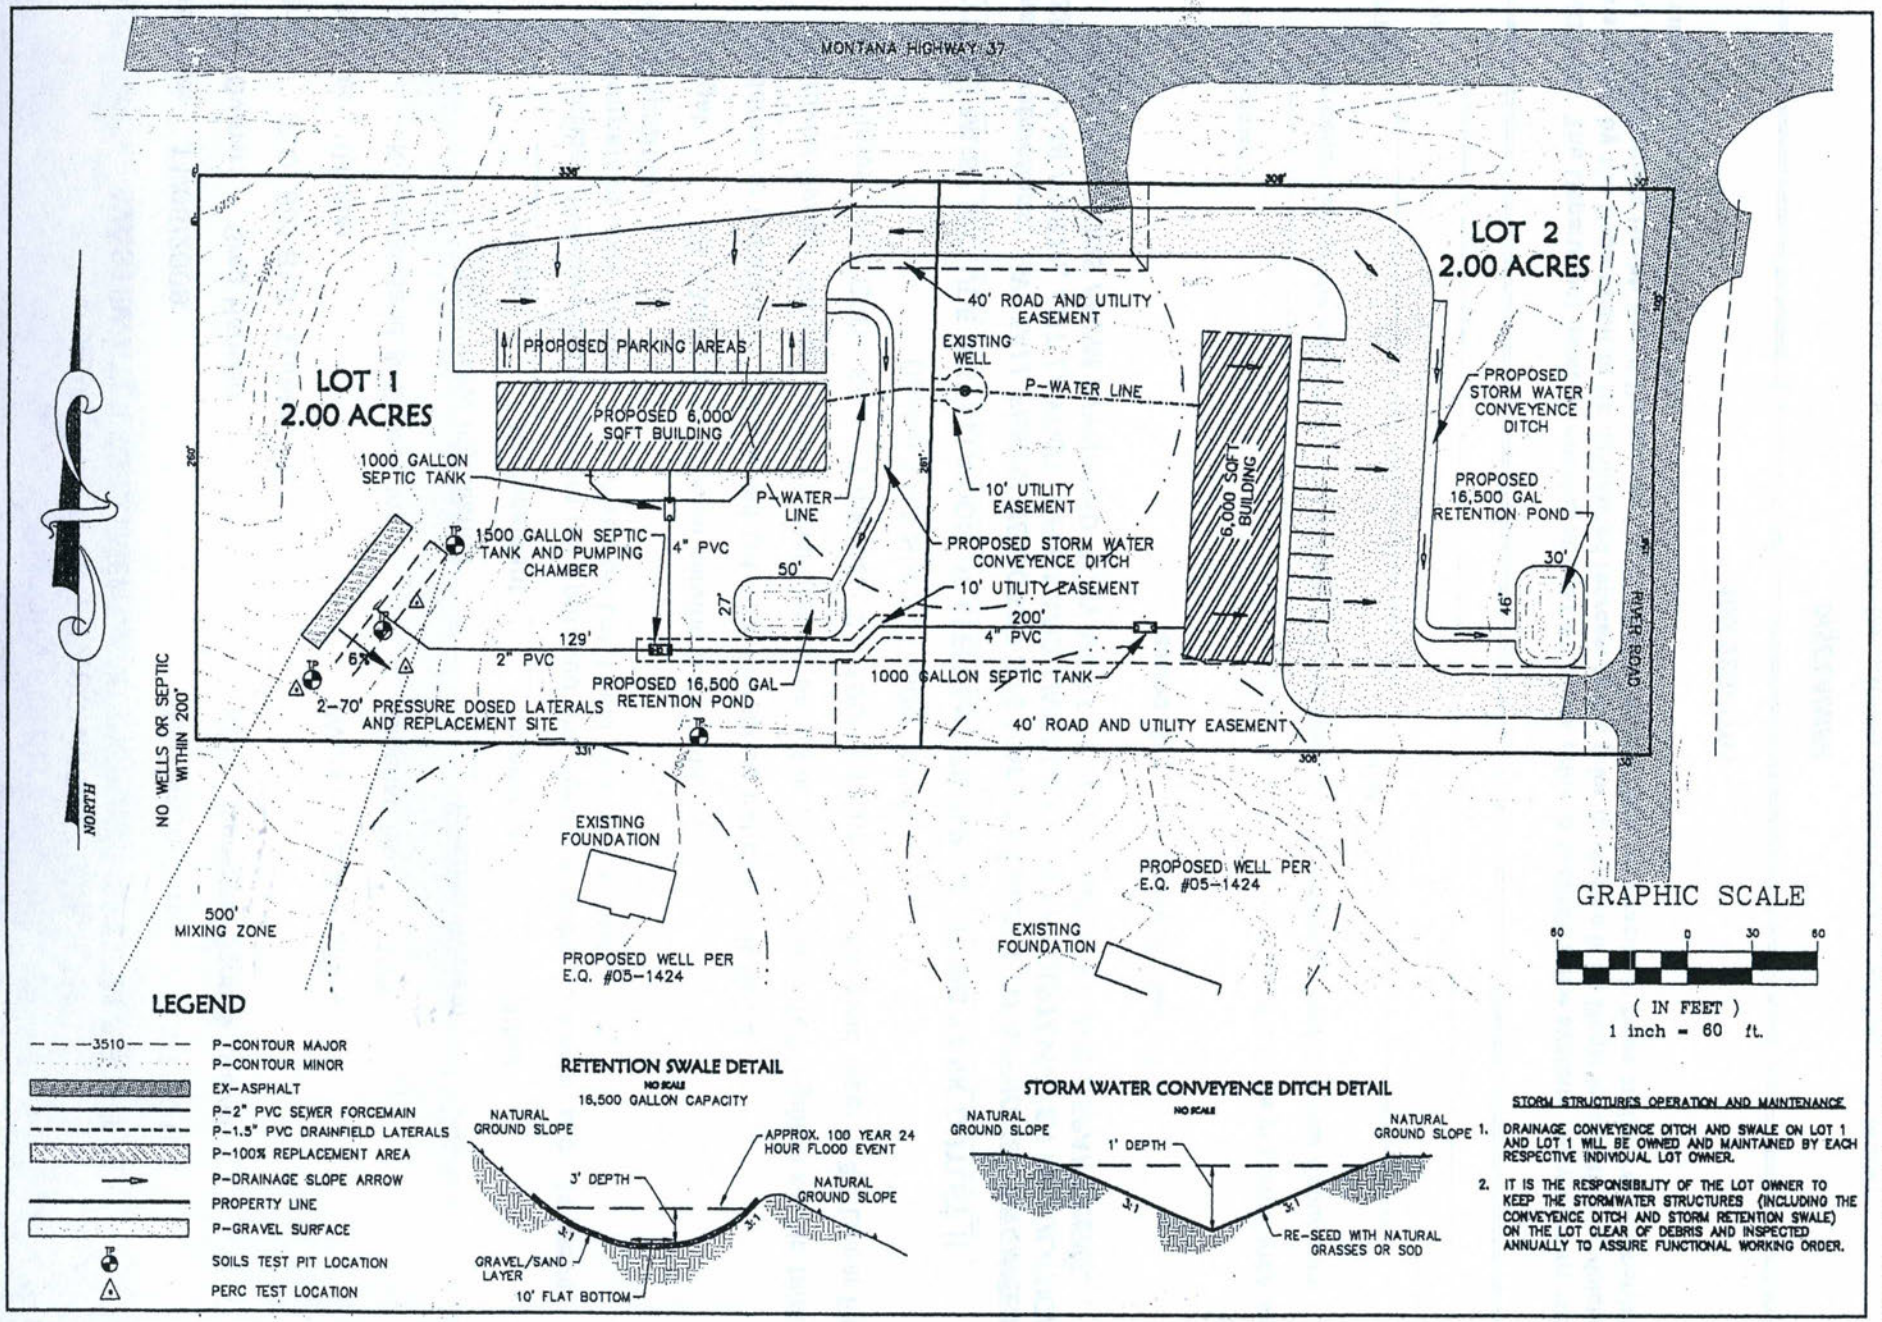

LEGEND

- 3510 — P-CONTOUR MAJOR
- P-CONTOUR MINOR
- EX-ASPHALT
- P-2" PVC SEWER FORCEMAIN
- P-1.5" PVC DRAINFIELD LATERALS
- P-100% REPLACEMENT AREA
- P-DRAINAGE SLOPE ARROW
- PROPERTY LINE
- P-GRAVEL SURFACE
- TP SOILS TEST PIT LOCATION
- PERC TEST LOCATION

RETENTION SWALE DETAIL

NO SCALE

16,500 GALLON CAPACITY

STORM WATER CONVEYENCE DITCH DETAIL

NO SCALE

STORM STRUCTURES OPERATION AND MAINTENANCE

1. DRAINAGE CONVEYENCE DITCH AND SWALE ON LOT 1 AND LOT 1 WILL BE OWNED AND MAINTAINED BY EACH RESPECTIVE INDIVIDUAL LOT OWNER.
2. IT IS THE RESPONSIBILITY OF THE LOT OWNER TO KEEP THE STORMWATER STRUCTURES (INCLUDING THE CONVEYENCE DITCH AND STORM RETENTION SWALE) ON THE LOT CLEAR OF DEBRIS AND INSPECTED ANNUALLY TO ASSURE FUNCTIONAL WORKING ORDER.

48 NORTH P.C. Civil Engineering Services

AM LOT 1 RIVERDRIVE ESTATES UNIT NO. 2
SEC 9, T36N, R 27W, P.M.M.T.

DRAWING SET DATE
WORK REVISIONS
No. Date Purpose By Check
1 12-3-2008 AM

PROJECT NUMBER
SHEET TITLE
FILE No.
BOOK PAGE
DRAWN BY: Brett McCully

SHEET No. 1 OF 1