LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/23/2026 Expiration Date: 04/22/2027 Permit#26-9870

Property Owner: Christopher and Katie Hennigan

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☒ New Installation ☒ Existing System

☒ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system to replace undersized system for 3 Bedroom House.

Parcel Description:

Legal: S33, T30 N, R31 W, COS 1444, PARCEL B, ACRES 7.324

Property Address: 4340 Granite Lake Rd., Libby, MT 59923 Assessment Code: 9870

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new gravity system to replace undersized system for 3 Bedroom House with 3 Laterals @ 50' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

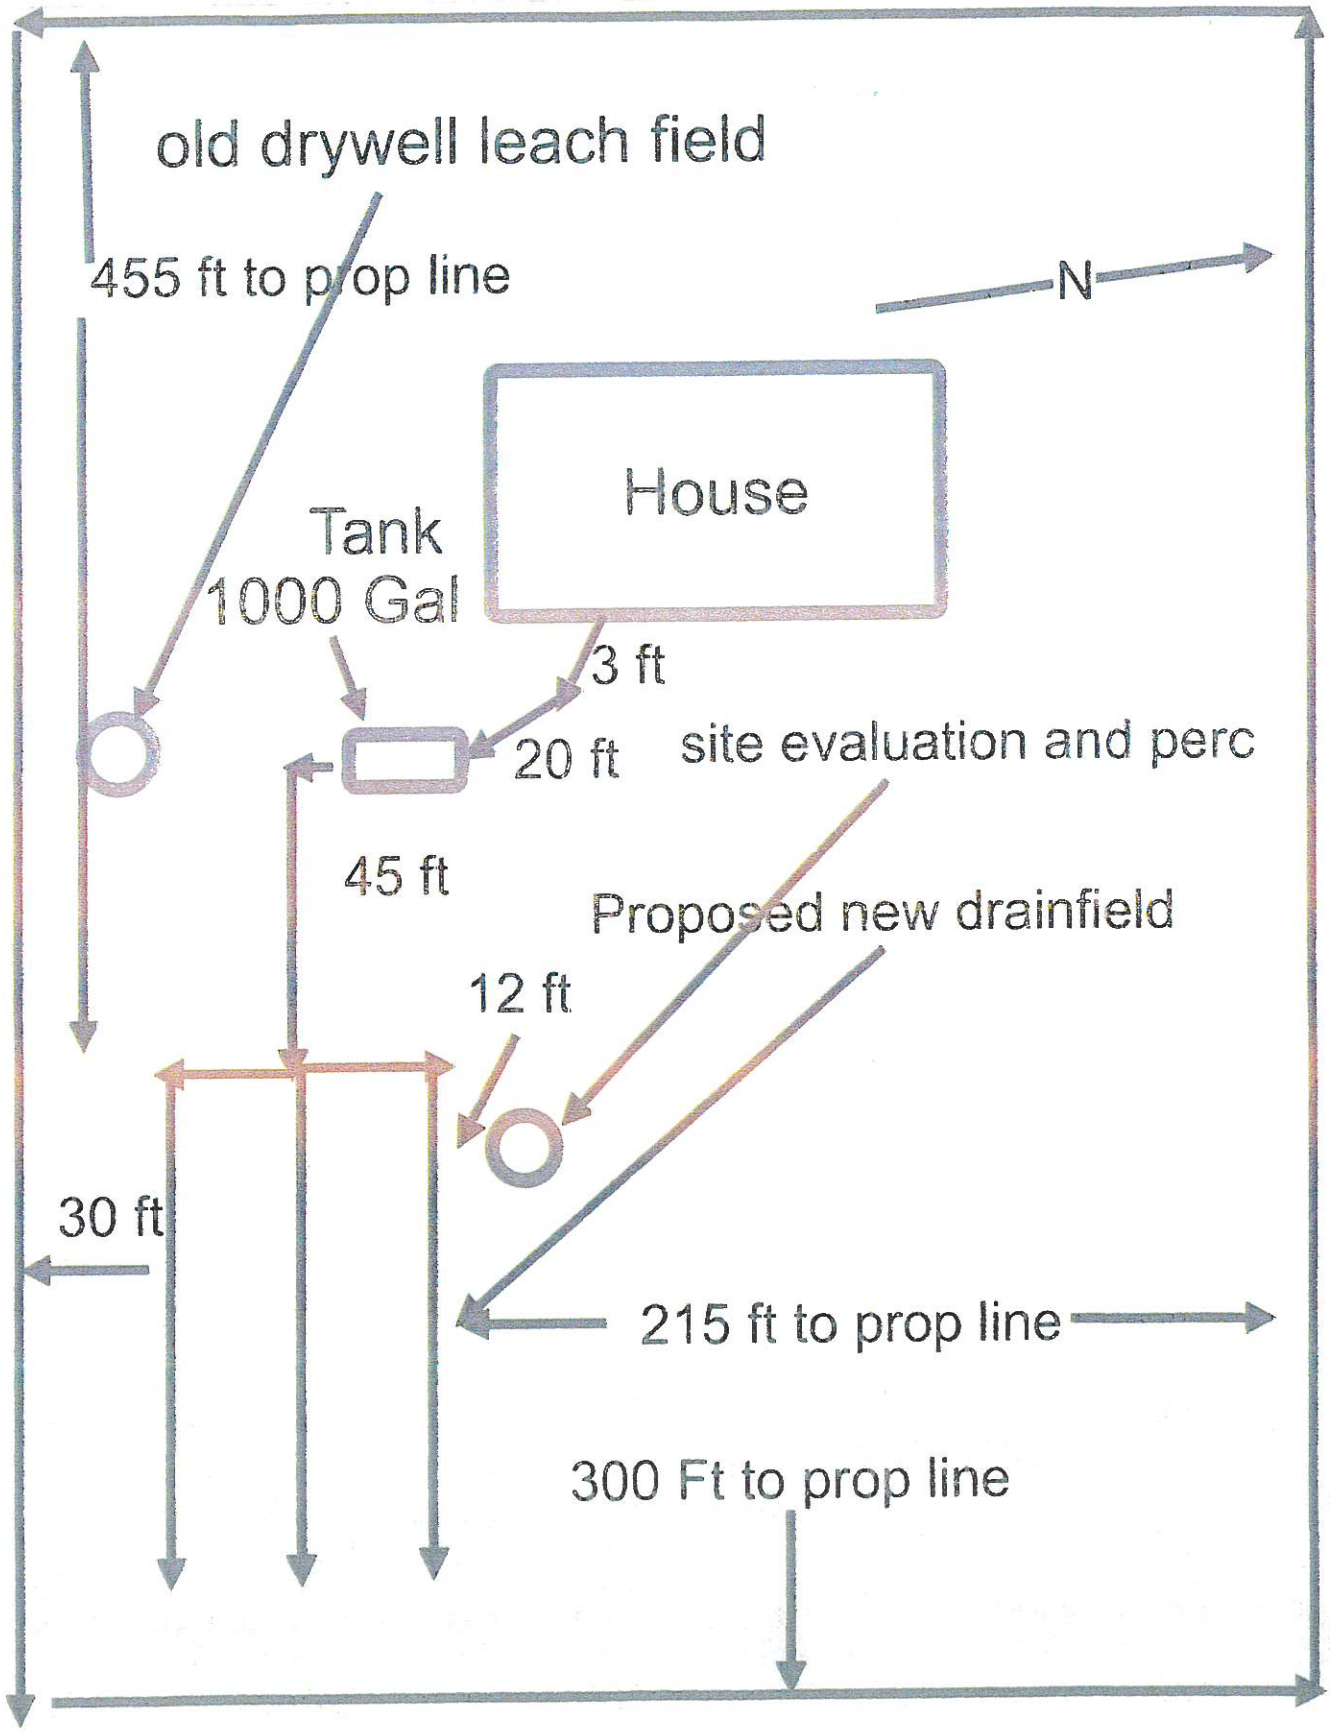
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


old drywell leach field
455 ft to prop line
N
House
Tank
1000 Gal
3 ft
20 ft
site evaluation and perc
45 ft
Proposed new drainfield
12 ft
30 ft
215 ft to prop line
300 Ft to prop line